



Catalog 726-6

PreciseLine® Horizontal and Vertical Air Handler

Models BCHD, BCVD, and BCAD (600 to 5000 CFM)



Sizes 006-020



Sizes 030-050



Table of Contents	3	Hydronic Coil Connections	19
AHRI Certification	3	Condensate Drain Pan Traps	20
Agency Listed	3	Engineering Data	21
Nomenclature	4	Operation Limitations	21
Overview	5	Physical Data	23
PreciseLine® Air Handler Units	5	Component Weights	23
Unit Sizes 006 – 020	5	Fan and Motor Data	24
Unit Sizes 030 – 050	5	Horizontal Filter Data	25
Introduction	6	Vertical Filter Data	25
The PreciseLine® Advantage	6	Unit Selection	26
For building owners	6	Basic Design Data	26
For specifying engineers	6	Unit Size	26
For contractors	6	Coil Types	26
Features and Benefits	7	Four-Pipe Systems	26
Model BCHD Features	7	Two-Pipe Systems	26
Features and Benefits	8	Four and Two-Pipe Performance Measurements	27
Double-Wall Cabinet Construction	8	Electrical Data	27
Mixing Box	8	Electric Heat Safety	27
Damper Actuator	8	Valve Package Selections	28
Discharge Plenum	8	Performance Data	29
Features and Benefits	9	Horizontal Performance Data – Primary Coil	29
Factory Installed Valve Packages	9	Horizontal Performance Data – Secondary Coil	30
Slide-Out Fan Assembly and Coil Section	9	Vertical Performance Data – Primary Coil	31
Options and Accessories	10	Vertical Performance Data – Secondary Coil	32
Electric Heat (Option)	10	Direct Expansion (DX) Coil	33
Application Considerations	14	Minimum Allowable Air Volume For Units With Electric Heat .	36
Controls	14	Electric Heat kW Options	39
Fan Speed Control	14	Electric Heat kW Options	40
Valve Modulation	14	Electric Heat Heater Amps	41
Electric Heat Control	14	Fan Curves	42
Condensate Overflow	14	Dimensional Data	44
Coil Freeze Protection	14	Unit Dimensions – Horizontal Unit Sizes 006-020	44
Electric Heat Control	14	Unit Dimensions – Vertical Unit Sizes 006-020	46
Valve Control	14	Unit Dimensions – Horizontal Unit Sizes 030-050	47
Motor Controls	15	Unit Dimensions – Vertical Unit Sizes 030-050	50
Damper Control	15	Mixing Box Dimensions	54
Mixing Box (Optional) – Field Provided Damper Actuator ..	15	Discharge Plenum Dimensions	58
Mounting and Access	16	Guide Specifications	60
Horizontal Unit Mounting Isolation	18	BCHD Guide Specifications	60
Spring Mount—Sizes 030, 040, 050	18	Appendix A	65
Vertical Unit Mounting Isolation	18	Arrangement Examples – Main Unit, Mixing Box	65
Access Panels and Doors	19	Arrangement Examples – Discharge Plenum	66

AHRI Certification



Units certified in accordance with Central Station Air-Handlers certification program, which is based on AHRI Standard 430.

Agency Listed



All standard units
All Canadian units

1-2	3	4	6-8	5	9	10	11	12	13	14	15	16	17	18	19	20-21	22	23-25	26	27
BC	H	D	012	1	E	L	W	R	L	W	A	T	A	B	P	E1	E	005	D	D

Category	Code Option	Code Designation	Description
Model Type	1-2	BC	= Daikin Air Handler
Unit Arrangement	3	H	= Horizontal
		V	= Vertical (Sizes 030+)
		A	= AVD/Compact Vertical (Sizes 006-020)
Fan Arrangement	4	D	= Draw Thru
Model Size	6-8	006	= Nominal 600 CFM
		008	= Nominal 800 CFM
		010	= Nominal 1,000 CFM
		012	= Nominal 1,200 CFM
		016	= Nominal 1,600 CFM
		018	= Nominal 1,800 CFM
		020	= Nominal 2,000 CFM
		030	= Nominal 3,000 CFM
		040	= Nominal 4,000 CFM
		050	= Nominal 5,000 CFM
Design Series	5	1	= 1st Vintage
Voltage	9	A	= 115/60/1
		E	= 208/60/1
		G	= 460/60/1
		K	= 230/60/1
		P	= 277/60/1
		D	= 208/60/3
		L	= 230/60/3
		T	= 460/60/3
		W	= 575/60/3
Primary Coil Connection Location	10	L	= Left Hand (Air back of the head)
		R	= Right Hand (Air back of the head)
		C	= Center
Primary Coil Type	11	W	= Water / Glycol
		D	= DX / 410A
		V	= VRV
Secondary (Heating) Coil Location	12	P	= Preheat
		R	= Reheat
		Y	= None
Secondary (Heating) Coil Connection Location	13	L	= Left Hand (Air back of the head)
		R	= Right Hand (Air back of the head)
		Y	= None
		C	= Center
Secondary (Heating) Coil Type	14	W	= Hot Water / Glycol
		Y	= None
		S	= Steam
Corrosion Package	15	A	= (Coil Casing) Stainless / (Fin Coating) None / (Drip Pan Corrosion Pkg.) Stainless
		Y	= (Coil Casing) Galvanized / (Fin Coating) None / (Drip Pan Corrosion Pkg.) Galvanized
Mix Box Openings	16	T	= Top + Rear
		B	= Bottom + Rear
		Y	= None
Mix Box Actuator Type	17	T	= On/Off
		A	= 0-10V M
		M	= Manual
		Y	= None
Discharge Plenum Opening	18	B	= Bottom
		T	= Top
		E	= End
		Y	= None - No Discharge Plenum
		R	= Right Hand (Air back of the head)
		L	= Left Hand (Air back of the head)
		F	= Field Cut-Out (Has A Plenum,
Electric Heat Location	19	P	= Preheat
		Y	= None
		R	= Reheat
Electric Heat Stages	20-21	E1	= 1st Stage Electric Heat
		SS	= SCR (Silicone Controlled Rectifier)
		Y	= None
Electric Heat Power Supply	22	A	= 115/60/1
		E	= 208/60/1
		G	= 460/60/1
		K	= 230/60/1
		P	= 277/60/1
		D	= 208/60/3
		L	= 230/60/3
		T	= 460/60/3
		W	= 575/60/3
		Y	= None
Electric Heat Size	23-25	00A	= 0.5 kW Electric Heat
		001	= 1.0 kW Electric Heat
		002	= 2.0 kW Electric Heat
		003	= 3.0 kW Electric Heat
		004	= 4.0 kW Electric Heat
		005	= 5.0 kW Electric Heat
		006	= 6.0 kW Electric Heat
		008	= 8.0 kW Electric Heat
		009	= 9.0 kW Electric Heat
		010	= 10.0 kW Electric Heat
		011	= 11.0 kW Electric Heat
		012	= 12.0 kW Electric Heat
		013	= 13.0 kW Electric Heat
		015	= 15.0 kW Electric Heat
		018	= 18.0 kW Electric Heat
		020	= 20.0 kW Electric Heat
		021	= 21.0 kW Electric Heat
		024	= 24.0 kW Electric Heat
		030	= 30.0 kW Electric Heat
		036	= 36.0 kW Electric Heat
		039	= 39.0 kW Electric Heat
		YYY	= None
Primary (Cooling) Coil Piping Package Type	26	B	= Basic
		D	= Deluxe (Includes Strainer and Circuit Setter)
		N	= No Valve Package - Coil Stub Out Only
		Y	= No Valve Package - Included Piping and Threaded Connection
Secondary (Heating) Coil Piping Package Type	27	B	= Basic
		D	= Deluxe (Includes Strainer and Circuit Setter)
		N	= No Valve Package - Coil Stub Out Only
		Y	= No Valve Package - Included Piping and Threaded Connection

Overview

PreciseLine® Air Handler Units

Unit Sizes 006 – 020

Standard Features

- 1" double wall cabinet with R-6 rating
- Galvanized or powder coated finish
- Premium efficiency direct drive EC motors
- 120V, 208V, 240V, 277V and 460V single phase power
- Low voltage controls
- Field adjustable 3 speed or analog modulating fan control
- 2, 4, or 6 row hydronic primary coil with multiple circuiting options
- 2" or 4" filters available in MERV 4, 8 or 13
- Left or right hand FPT field connections
- Centered internal connections on vertical units

Factory Installed Optional Features

- Single circuit, 3 row or 6 row Dx cooling coil
- 1 or 2 row secondary heating coil available as preheat or reheat
- Single point power electric heat with on-off or SCR modulating control 0.4kW - 20kW
- Basic valve package complete with on-off or modulating control valve, P/T ports, and ball isolation valves
- Deluxe valve package complete with on-off or modulating control valve, sweat unions, P/T ports, strainer, manual or automatic circuit setter and ball isolation valves
- Mixing box with manual, On/Off, or modulating damper control
- Discharge plenum with sound reduction package
- VRV-ready coils (controls separate)



Unit Sizes 030 – 050

Standard Features

- 1" double wall cabinet with R-6 rating
- Galvanized or powder coated finish
- Premium efficiency direct drive motors
- 208V, 240V, 460V and 575V three phase power
- Low voltage controls
- Analog modulating fan control
- 2, 4, 6, or 8 row hydronic primary coil with multiple circuiting options
- 2" or 4" filters available in MERV 4, 8 or 13
- Left or right hand SW field connections

Factory Installed Optional Features

- Single circuit and interlaced 3 row or 6 row Dx cooling coil
- 1 or 2 row secondary heating coil available as preheat or reheat
- Single point power electric heat with on-off or SCR modulating control; 7.4kW - 39kW
- Mixing box with manual, On/Off, or modulating damper control
- Discharge plenum with sound reduction package
- VRV-ready 3 row cooling coil



The PreciseLine® Advantage

“One of the shortest cabinet profiles in the industry and its slim 30” width fits through most standard door openings.”

PreciseLine horizontal and vertical air handlers feature durable, thermally insulated, double-wall panel construction plus all the attributes that many building owners, specifying engineers, and contractors look for. The PreciseLine air handler combines a low profile, space-saving design in a large capacity, sleek, modern, optional pre-painted cabinet. This unit has many factory options to suit any application including: a mixing box that satisfies outdoor air requirements, discharge air plenum to efficiently redirect air in any direction, electric heat in the preheat section, valve packages with coil connections terminating outside the cabinet for easy piping, and much more.

For building owners

PreciseLine air handlers offer quiet and energy efficient operation. They fully comply with ASHRAE 62.1-2010 standards for high indoor air quality, and protect to minimize pathogens, contaminants, and fiberglass strands. Double-wall panel construction eliminates any contact the conditioned air has to insulation resulting in an easy to clean cabinet without the risk of mold and mildew growth. This is essential for facility managers of schools and medical facilities where clean, healthy air is a must. The double-wall, foam injected cabinet brings substantial gains to the R-value in addition to eliminating thermal bridging. The combination of these two things resist the transfer of heat between the cabinet and the space directly surrounding the cabinet (plenum area or mechanical room). Whether the building is calling for chilled water or hot water, these thermally resilient cabinets keep the energy you pay for conditioning the air that will be delivered to the space, not the air in your mechanical room or ceiling plenum space.

Lightweight, nimble and responsive, PreciseLine units provide the modularity of an air handler in a system serving larger spaces, but in a smaller package at an affordable price.

- Routine maintenance time is reduced as the fan assembly and coil assembly slide-out from the cabinet on a track, making maintenance easier.
- Easy fan deck removal provides quick access for inspection, maintenance or repair.
- The optional Mixing Box delivers economizer cooling when outdoor temperature and humidity are right, satisfying fresh air levels required by ASHRAE 62.1.

For specifying engineers

PreciseLine air handlers provide levels up to 5000 cfm to match a building's air handling demand at a blower coil price point.

Precision control: maintain space requirements based on modulating valve, fan, electric heat, and fresh-air dampers. Double wall “R-6” (1-inch thick) foam-injected cabinet panel insulation sets Daikin units apart from the competition, with increased R-value, improved air quality and lower sound levels.


- Factory installed mixing box with manual, 24VAC open/close, or 0-10VDC actuators help satisfy outdoor air requirements
- Integrated discharge plenum smoothly changes airflow direction, as “tight space” applications require from a light air handler. Unlike competitors' models where an “add-on” plenum must be fabricated, to direct or turn air downstream of the discharge. Where lower sound levels are necessary, an optional sound attenuation package is available in the discharge plenum.
- Electric heat, single point power in ranges of 1-39kW, located in the main cabinet. Competitors append an electric duct type heater module to the end of the unit, consuming space and adding cost.
- Factory installed, 0-10VDC or 24V open/close valve packages for two and four-pipe systems for unit sizes 020 and smaller.
- Stainless steel main drain pan and optional stainless steel drip pan work together to keep pathogens and contaminants out of the airstream.
- Units are ETL and cETL listed. Performance is AHRI 430 certified.

For contractors

PreciseLine air handlers feature Quick Ship options for fast delivery and a number of features that make installation fast and simple.

- Factory-mounted, wired and tested valve and piping packages for quick hookup to the building piping to reduce installation time. Valve and piping packages are designed for entering water temperature sampling. This eliminates the need for inefficient bleed lines to sense automatic changeover on two-pipe units.
- Factory-mounted and tested controls minimize field setup. Depending on the option requested, controls can be wired with a 24 VAC transformer to provide a single-source low-voltage power connection to the unit. Several options are available for wall-mounted thermostats and unit or wall-mounted sensors. All wall-mounted thermostat and zone sensors require only low-voltage control wiring from the device to the unit control box.
- Easy to remove access panel allows for quick and easy wiring.

Model BCHD Features

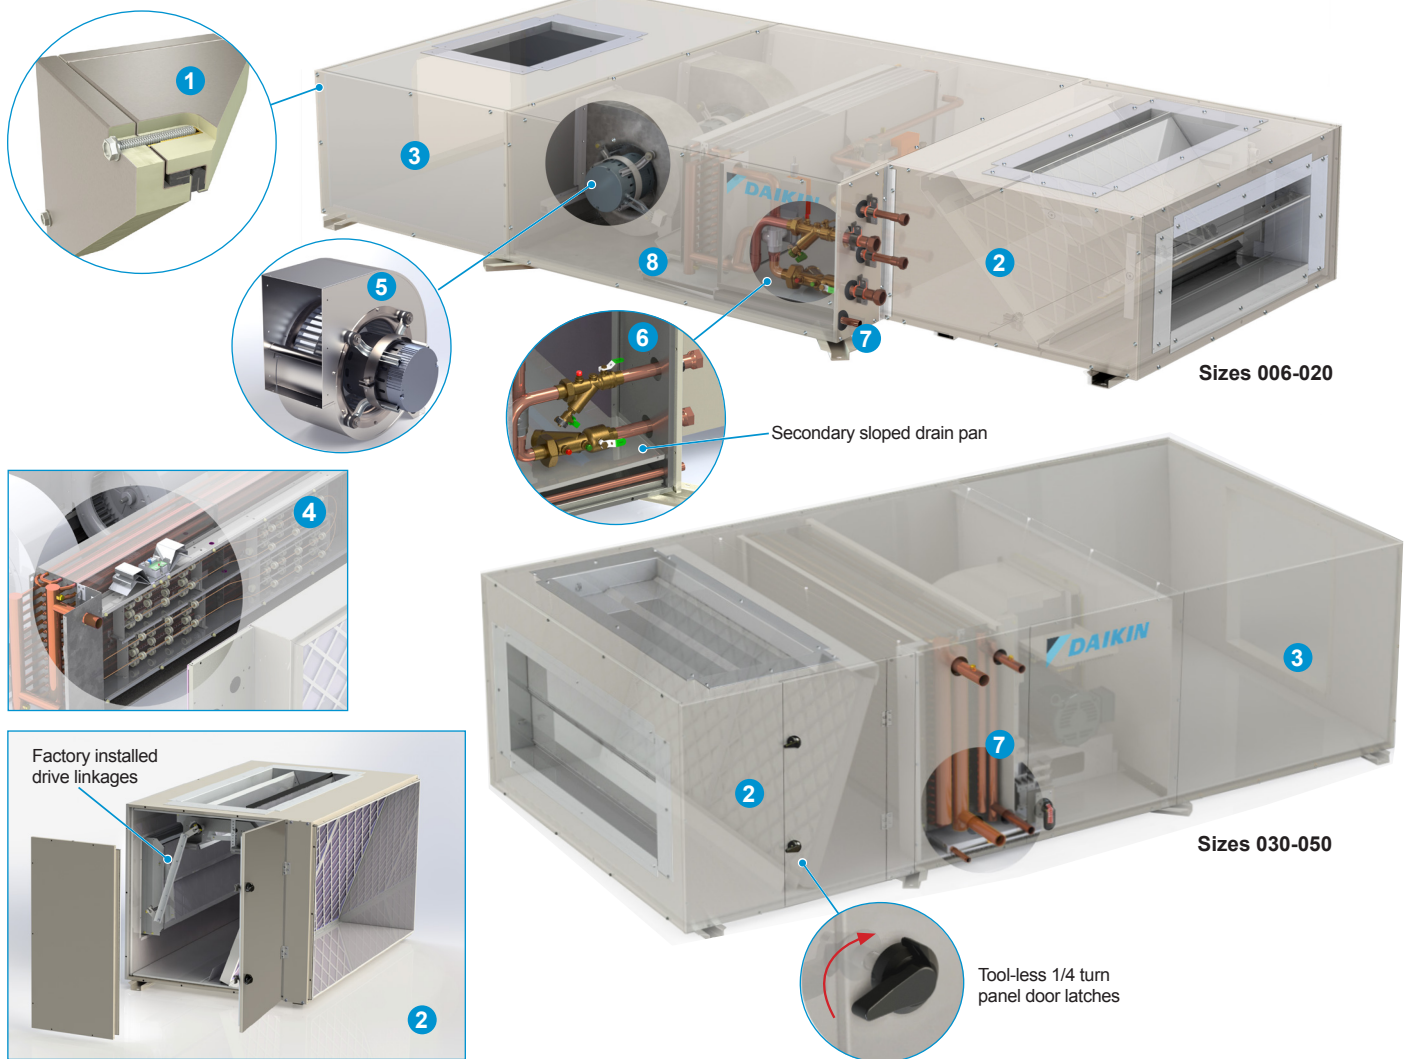

1 Cabinet

- Double-wall, foam injected panel
- R-6.5 thermally resistive cabinet
- Fully Gasketed for low air/energy leakage
- Smooth interior liner for easy cleaning
- Draw-through fan/coil arrangement, providing uniform airflow over coil for better performance, as well as partial reheat from fan motor to reduce downstream condensation risk

2 Mixing box (option)

- Factory installed 0-10VDC or 24VAC actuators
- Factory installed drive linkages

3 Discharge plenum (option)

- Smoothly changes air flow to any direction
- Optional sound attenuation package for units in close proximity to a sound sensitive environment

4 Electric heat (2-pipe only)

- 1/2kW to 39kW
- Single point power
- Factory safeties
- Single stage or SCR control

5 Fully modulating fan motors

- 0-10VDC modulating control
- Internal thermal protection
- 3-speed functionality for compatibility with fan coil style thermostats (Size 006-020)
- Double-shielded, fully sealed bearings
- Constant speed EC motor (sizes 006-020)
- VFD mated to NEMA premium ODP motor (sizes 030-050)
- Fan efficiency exceeds future proposed FEI requirements by DOE and CARB

6 Multiple valve packages

- Internal to cabinet to reduce insulation requirement

7 Multiple coil options


- 2, 4, 6, and 8 row hydronic primary coil options, with 12, 14, and 16 FPI options
- 1 row steam or 1 to 2 row hot water row reheat or preheat secondary coils
- Stainless steel coil casings
- Single circuit and interlaced 3 row or 6 row Dx coil option
- VRV-ready 3 row cooling coil

8 Stainless steel drain pan

- Double Sloped
- ASHRAE 62.1 Compliant

Double-Wall Cabinet Construction

“Unique Thermally Insulated Cabinetry.”

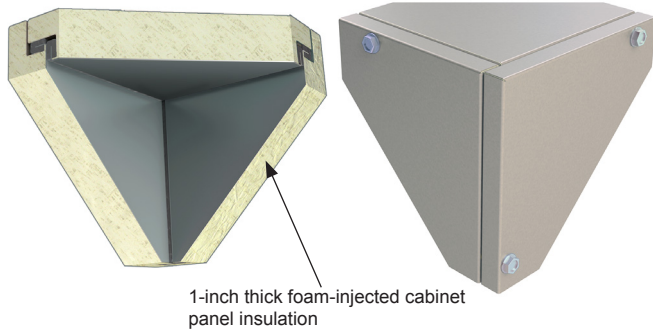


Many competitor units offer single-wall panels lined with thin, adhesive-back foam or fiberglass insulation. Daikin PreciseLine units utilize a galvanized double wall, 1-inch foam injected, thermally isolated panel. This panel construction means more thermal insulation, raising the cabinet’s thermal resistance to R6. This thermal resistance is more effective at keeping air cold in cooling mode and hot when in heating mode. Traditional single wall fiber-faced insulation allows heat to flow in and out of the cabinet more easily, heating up cold air in cooling, and cooling down hot air in heating. PreciseLine’s thermally insulated cabinetry helps keep insulation fibers from entering the air stream, reducing the chance of pathogens in the system, providing a cleanable surface, and increased panel rigidity for long-life. Foam injected insulation conforms to ASTM C1071 (including C665, UL 181 for erosion, and 25/50 rating for flame spread/smoke developed per ASTM E-84, UL 723 and NFPA 90A.

Mixing Box

The Daikin air handling unit can be configured with an optional factory installed mixing box. The mixing box is perfect for economizer operation, satisfying outdoor air requirements via mixing of indoor and outdoor air. The mix box is constructed of Daikin’s innovative 1-inch thick foam injected, double wall panel.



The mix box duct collar is flush with the cabinet and easily bends out along the perforations by the installer, reducing time and labor.

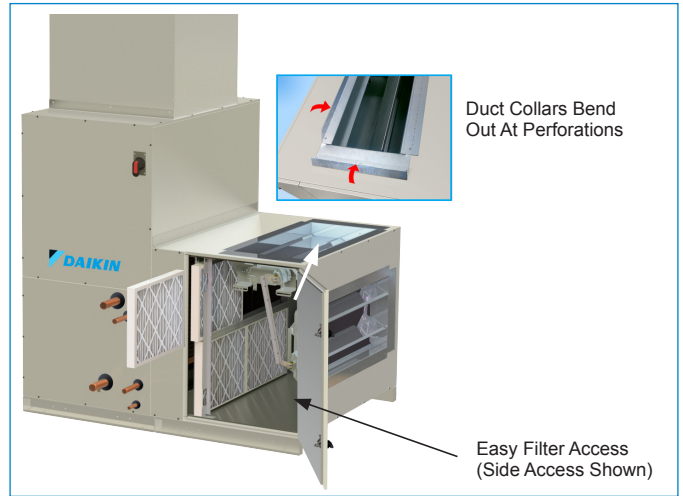


Damper Actuator


Damper actuators for mixing box control are factory installed and wired. Control styles include 24VAC (ON/OFF) and 0-10VDC fully modulating for economizing control. The damper actuators are spring return and field-reversible. A manual damper is also available for fixed damper applications. Coil freeze protection is the responsibility of the installing party and must be carefully considered when using this unit to condition outdoor air. Actuators listed under UL 873, CE, CSA, and C22.2.

On unit sizes 06-20, the damper actuator is located on the side opposite the coils. On unit sizes 30-50, the actuator is located on the same side as the coils.

Discharge Plenum

Daikin offers an optional discharge plenum, factory mounted and shipped assembled on the discharge end of the main unit. The plenum is available in multiple discharge configurations. It can be ordered with an industry-leading sound-attenuation package, minimizing sound amplitude and improving sound quality. Competitor models require plenums or discharge sections to be field fabricated in order to turn the discharge air, adding fabrication and labor costs, with no sound dampening option.

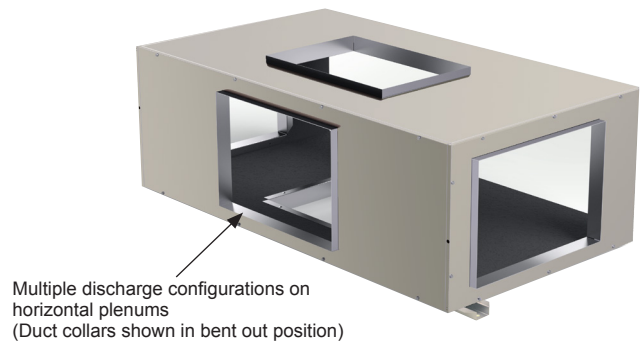


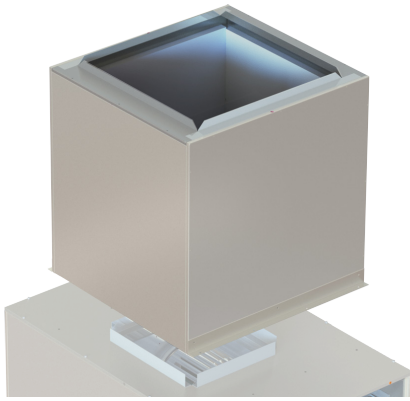


Note: Top Discharge Only

Factory Installed Valve Packages

Factory valve and piping packages are available for both two-pipe and four pipe systems for sizes 020 and smaller. All factory assembled packages are leak tested and ship supported by an expandable foam agent. The valve packages are assembled inside the cabinet and water connections terminate outside the cabinet for quick field hook-up. Valve piping is easily accessible through a single panel, for easy service. A secondary sloped drain pan covers the span of the internal valve package making pipe insulation unnecessary for the piping package inside of the cabinet.

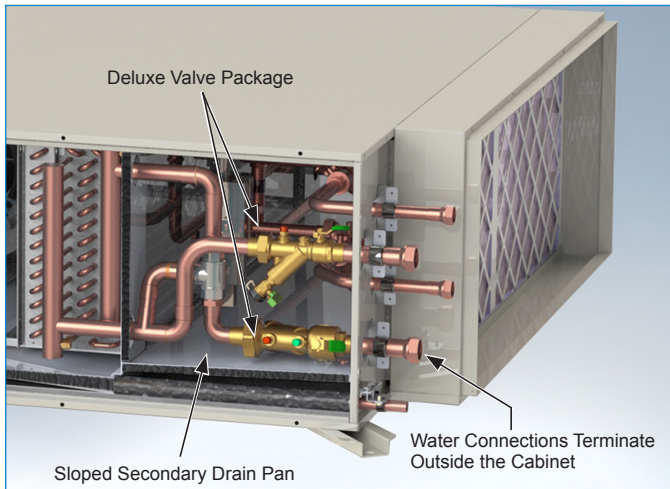


Valve packages provide added value by reducing installing contractors time. Connection points are pre-determined, allowing the building supply and return piping to be pre-installed before the arrival of the air handler.

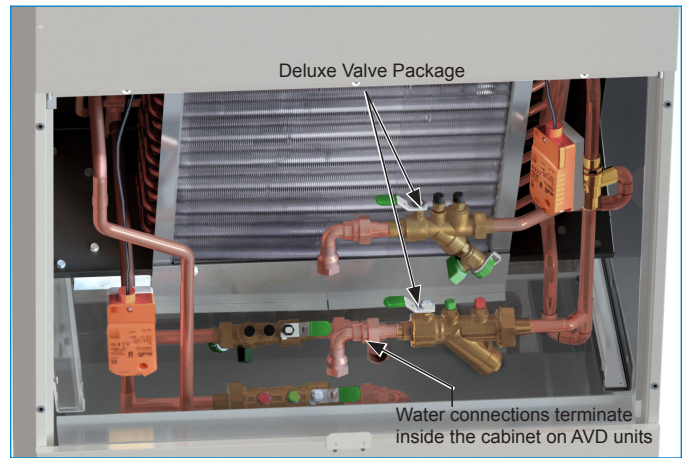


Slide-Out Fan Assembly and Coil Section

The DWDI Forward-Curved (FC) fans have an easy duct to flex collar. Sizes 020 and smaller have internally isolated, EC fan motors, while sizes 030 through 050 have Forward-Curved (FC) fans driven by ODP motors mated to factory installed Variable Frequency Drives (VFD)s. The fan design allows pressure ratings up to 3" Total Static Pressure (TSP) or 1.5" External Static Pressure (ESP) in certain applications. The motor and fan housing assembly slide out on a rail and track system for easy maintenance.

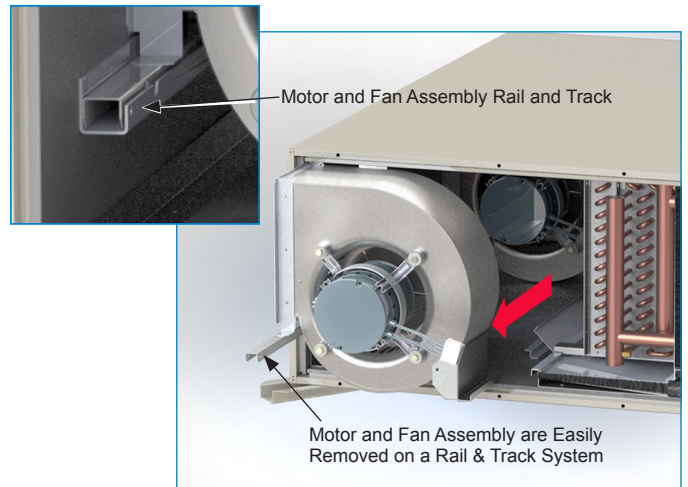




The coil section assembly slides out providing easy service and maintenance access. Valve package unions disconnect on the coil piping side, and the coil removed without disrupting the buildings supply and return water connections.


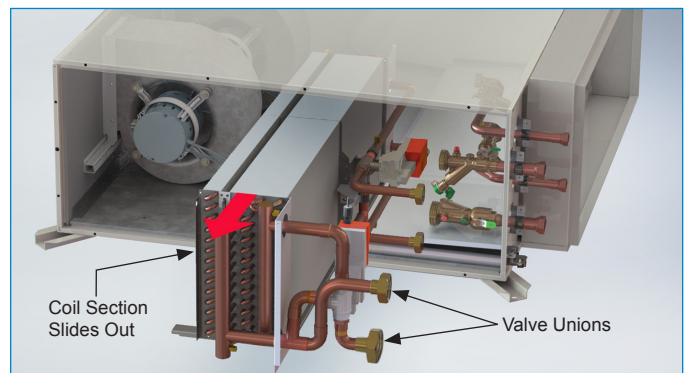




Electric Heat (Option)

The optional factory installed electric heat section consists of an open coil heater rack mounted to the units' primary coil. The heating coil is in the preheat position for horizontal units and the reheat position for vertical units. Electric heat is designed to operate only when the supply fan is running, heating the air as it passes through the heating elements. The electric heat section consists of the mounting rack, electric elements, contactor, optional SCR module and the manual and automatic reset thermal limits with multiple on-board control systems for safety. Electric heat comes pre-wired to the main control box for a single point power connection to the unit.



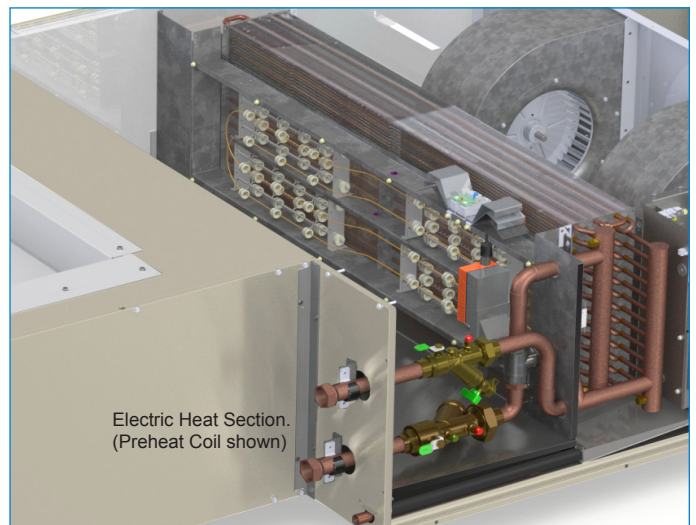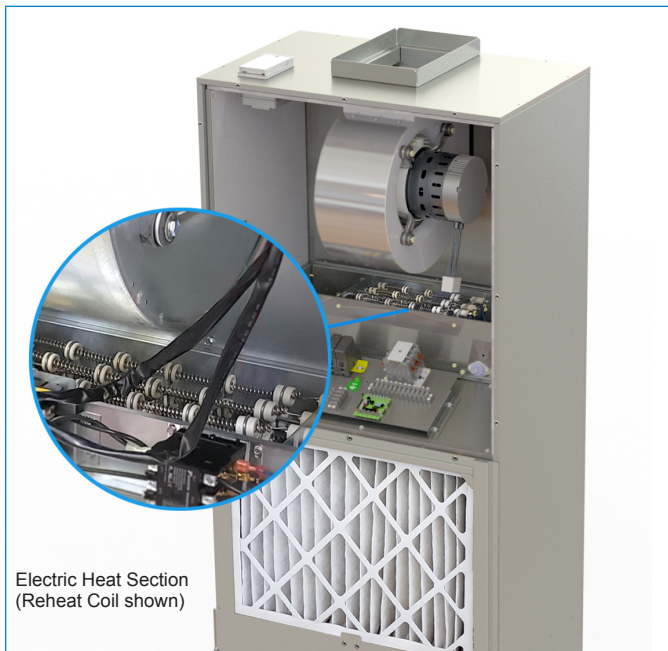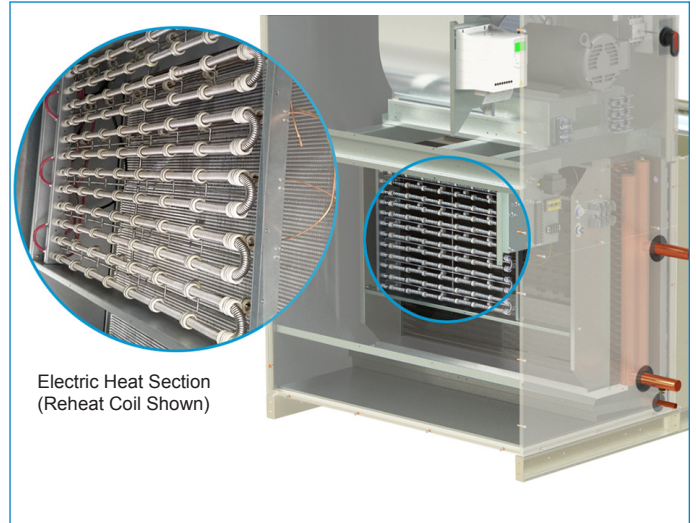




Available in a wide range from 1-39kW, these heating elements can be controlled with a 24VAC ON/OFF signal, or with a 0-10VDC, fully modulating Silicone Controlled Rectifier (SCR). The SCR modulates the electric heat element which means no noisy relays clicking on and off, precise temperature control, increased thermal comfort and improved energy efficiency. Electric heat is available on 2-pipe systems only.



Shutoff and Ball Valves			
<p>Shut-off Valve w/Y-Strainer</p> 	<p>Autoflow Shut-off Valve w/Strainer</p> 	<p>Shut-off Ball Valve</p> 	<p>Manual Circuit Setter</p> 

The deluxe factory installed piping package includes a fully modulating 0-10VDC or 24V ON/OFF control valve (2-way/3-way), a water strainer with blowout, P/T ports, unions, shut-off isolation valves, and an auto-flow circuit setter. This control scheme matched with a fully modulating fan allows for maximum space comfort and energy efficiency.

All piping packages are installed with Belimo control valves, Nexus automatic and manual circuit setters, Nexus strainers, and Nexus shut-offs. The control valve and circuit setter are located on the return side of the coil, (with the exception of size 006 and 008 vertical units) The strainer is located on the supply side of the coil. Several control valve types are available.

Control Valves																															
<p>Two-Way On/Off (2-Position) Valves</p>	<p>Three-Way On/Off (2-Position) Valves</p>	<p>Two-Way Modulating Valves</p>	<p>Three-Way Fully Modulating Valves</p>																												
<p>2-Way, 0.50FPT, On/Off, 24V, NO</p> 	<p>3-Way, 0.75FPT, 24Cv, On/Off, 24V, NC</p> 	<p>2-Way, 0.50FPT, 16Cv, Modulating, 0-10VDC</p> 	<p>3-Way, 0.50FPT, 16Cv, Modulating, 0-10VDC</p> 																												
<p>2-Way, 0.75FPT, On/Off, 24V, NC</p> 	<p>3-Way, .050FPT, On/Off, 24V, *Adjustable to NO or NC</p> 	<p>Two-way modulating valves allow for finely-tuned water flow which improves space comfort control as well as energy management. Modulating valves respond to a 0-10VDC signal from your thermostat or terminal controller. The valve body operates as an equal-percentage flow type. A method of relieving pump head pressure should be employed when selecting two-way valves.</p>	<p>Three-way modulating valves allow for finely-tuned water flow which improves space comfort control as well as energy management. Modulating valves respond to a 0-10VDC signal from your thermostat or terminal controller. The valve body operates as an equal-percentage flow type. A method of relieving pump head pressure should be employed when selecting three-way valves.</p>																												
<p>2-Way, 0.50FPT, On/Off, 24V, *Adjustable to NO or NC</p> 	<p>These valves will either be in a fully OPEN or fully CLOSED state in response to a 24VAC signal from the controller. Normally Closed or Normally Open are available, both are of spring-return type. Three way valves are of the mixing type.</p>	<p>Selecting Correct Valve Characteristics Daikin Select tools is automatically configured to match the valve body size to the selected coil. Valve Cv can be automatically selected based on the pressure drop through the coil and required GPM or user selected for more versatility.</p>																													
<p>These valves will either be in a fully OPEN or fully CLOSED state in response to a 24VAC signal from the controller. Normally Closed or Normally Open are available, both are of spring-return type. A method of relieving pump head pressure should be employed when selecting two-way valves.</p>	<p>Belimo ZoneTight Valves (Size 006 and 008 vertical units) can be field-adjusted to be normally open or normally closed. By adjusting the manual clip, Cv values for the valve can be altered.</p> <table border="1"> <thead> <tr> <th rowspan="2">Size</th> <th rowspan="2">Valve Model</th> <th colspan="8">Clip Position for Cv Adjustment (2-Way Valves)</th> </tr> <tr> <th>1</th> <th>2</th> <th>3</th> <th>4</th> <th>5</th> <th>6</th> <th>N</th> <th>No Clip</th> </tr> </thead> <tbody> <tr> <td>1/2"</td> <td>Z2050Q-J</td> <td>0.5</td> <td>0.7</td> <td>1.2</td> <td>1.7</td> <td>2.4</td> <td>3.4</td> <td>4.8</td> <td>5.9</td> </tr> </tbody> </table>			Size	Valve Model	Clip Position for Cv Adjustment (2-Way Valves)								1	2	3	4	5	6	N	No Clip	1/2"	Z2050Q-J	0.5	0.7	1.2	1.7	2.4	3.4	4.8	5.9
Size	Valve Model	Clip Position for Cv Adjustment (2-Way Valves)																													
		1	2	3	4	5	6	N	No Clip																						
1/2"	Z2050Q-J	0.5	0.7	1.2	1.7	2.4	3.4	4.8	5.9																						

Filter Options for Horizontal Units

Tool-less filter access on all sizes of the main unit can be ordered as side, bottom or top removal, (right or left hand). Top and bottom filter access is available on horizontal units through an easily removed sliding plate. AVD units come with side, top, or internal access to the filter. Side filter access is through the slotted end plate that removes easily from tabs along the filter frame. Units with the optional mix box have hinged access doors with tool-less 1/4-turn door latch(es) and are orderable as side filter access (right or left hand) or bottom access (horizontal only; not available with bottom return). Filter racks are factory configurable to accept 4", 2" or 2" + 2" filter options. Merv 4, Merv 8, and Merv 13 rated filters are available from the factory. Daikin's PreciseLine air handler comes standard with a 2" Merv 4 filter to prevent construction dust and debris from entering the unit upon startup, installation, and storage.

Merv Rating	Filter Depth	
	2"	4"
4	Available	—
8	Available	Available
13	Available	Available

For filter details refer to, [Table 12 on page 25](#).

Figure 1: Unit Size 020 Bottom or Top Filter Access

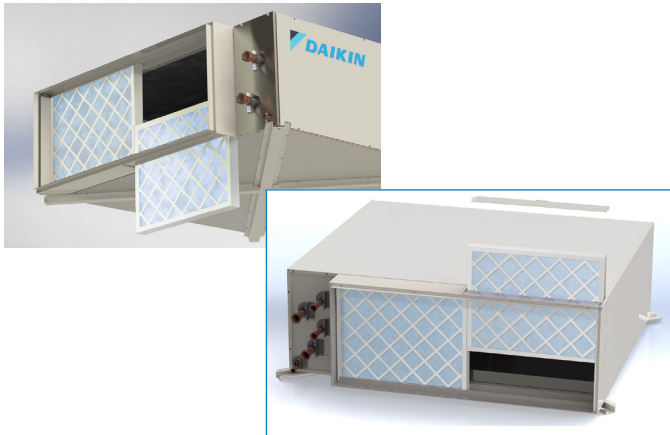


Figure 2: Unit Size 020 Side Filter Access

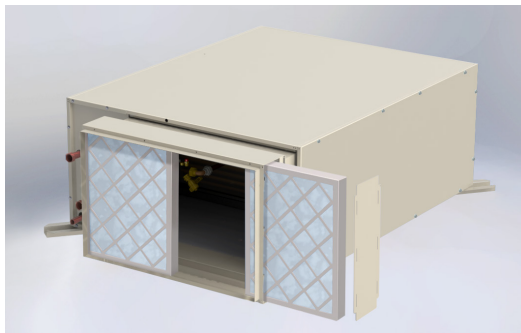


Figure 3: Unit Size 040 Bottom or Top Filter Access

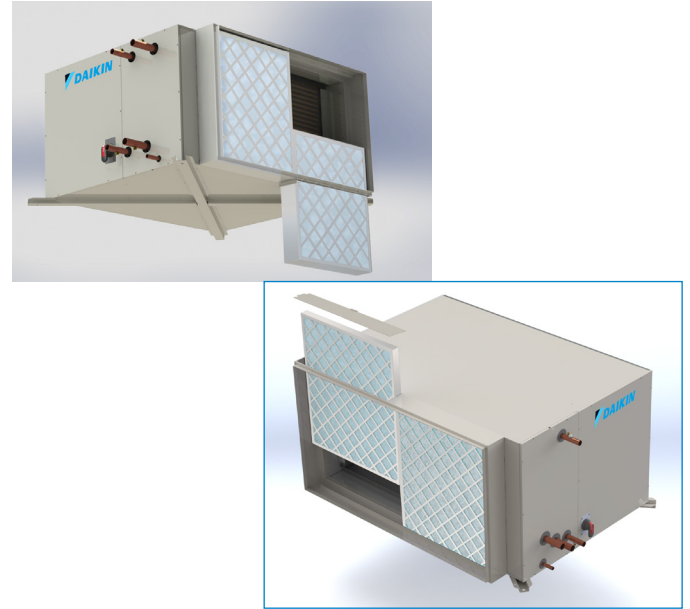


Figure 4: Unit Size 040 Side Filter Access



Figure 5: Unit Size 020 Optional Mixing Box with Side Filter Access


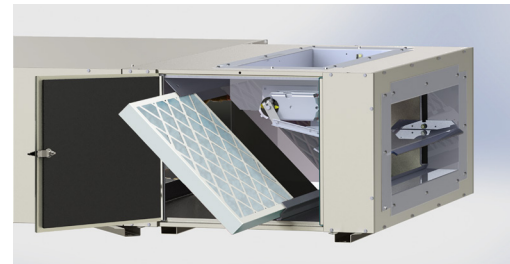


Figure 6: Optional Mixing Box Bottom Filter Access

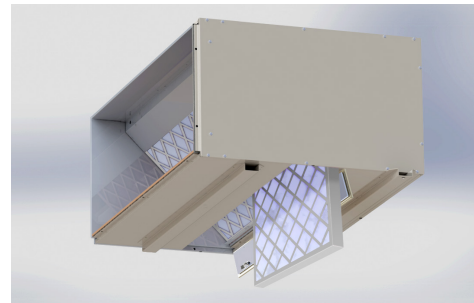

Filter Options for Vertical Units

Note: If the unit has an internal filter and has its inlet ducted, the ducting will need to be removed to access the filter.

Tool-less filter access on all sizes of the main unit can be ordered as side, bottom or top removal, (right or left hand). Top and bottom filter access is available on horizontal units through an easily removed sliding plate. AVD units come with side, top, or internal access to the filter. Side filter access is through the slotted end plate that removes easily from tabs along the filter frame. Units with the optional mix box have hinged access doors with tool-less 1/4-turn door latch(es) and are orderable as side filter access (right or left hand) or bottom access (horizontal only; not available with bottom return). Filter racks are factory configurable to accept 4", 2" or 2" + 2" filter options. Merv 4, Merv 8, and Merv 13 rated filters are available from the factory. Daikin's PreciseLine air handler comes standard with a 2" Merv 4 filter to prevent construction dust and debris from entering the unit upon startup, installation, and storage.

Merv Rating	Filter Depth	
	2"	4"
4	Available	—
8	Available	Available
13	Available	Available

Figure 7: Unit Size 006 - 020 External Filter Removal on Left Side

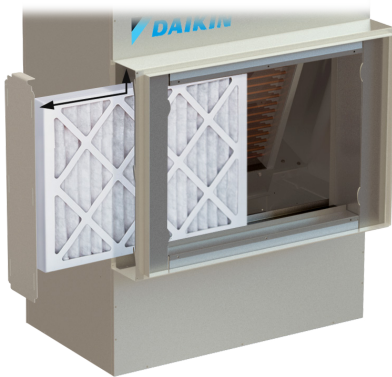


Figure 8: Unit Size 006 - 020 External Filter Removal on Right Side

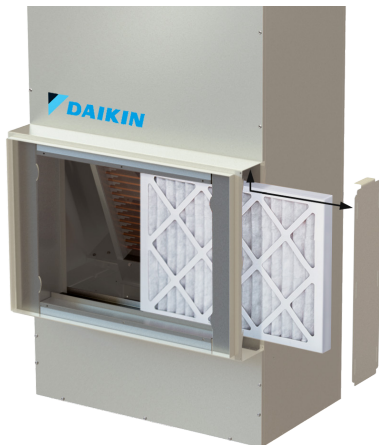


Figure 9: Unit Size 006 - 020 Internal Filter Removal



Figure 10: Size 030 - 050 Filter Access



Figure 11: Size 030 - 050 Side Filter Access



Application Considerations

Controls

Fan Speed Control

0-10 VDC Analog Control

Fan modulation control allows the space temperature to be controlled by constantly adjusting the airflow rate across the coil. Increasing and decreasing the CFM across the coil in response to changes in space temperature essentially changes the capacity of the coil to match the current load for improved comfort and reduced energy consumption and unit noise. While fan modulation is typically used with on-off valve control which allows the maximum design GPM through the coil it may also be used with a modulating control valve to provide even greater temperature control. Fan modulation control requires a controller or thermostat capable of generating and changing the 0-10VDC signal in response to the changes in space temperature.

3-Speed Discrete Control

Three speed fan control runs the fan continuously at one of 3 programmed speeds. These 3 speeds can be changed on the factory installed speed adjustment board. This type of control requires a 24VAC binary signal control signal applied to one of the motors speed terminals. The motor will run at the corresponding speed for as long as the signal is maintained. This type of fan control allows the unit to be controlled with 3 position fan switch or a simple fan coil type thermostat.

Valve Modulation

Valve modulation controls space temperature by constantly adjusting the water flow rate through the coil to modulate coil capacity and improve comfort. Unlike fan modulation, valve modulation is less effective at reducing energy consumption and does not reduce unit noise.

0-10 VDC Analog Control

The valve actuator responds to a 0-10 VDC input from the controller. As space demand increases and decreases, water flow rates are adjusted as well.

Open/Closed 24VAC Control

The valve actuator responds to a binary 24VAC signal. Can be configured for an "on-with-demand" (Normally Closed) or "off-with-demand" (Normally Open) control scheme. The water flow rate is designated by the auto flow valve (circuit setter).

Electric Heat Control

Electric heat control may be binary (on-off) or modulating. With binary the full capacity of the electric heating element turns on with a 24VAC signal from the controller and stays on until the set point is reached. Modulating control which requires a 0 – 10VDC signal from the thermostat or controller uses an SCR switching module to vary the heat output of the electric element. Matching the heat output to space load increases comfort and reduces noise and energy consumption. It is the responsibility of the

controls contractor or the customer to ensure that the electric heating elements never operate without the minimum airflow as listed in [Table 24 on page 36](#). Factory provided safety limits built in to the electric heat assembly and the SCR module prevent overheating should a fan failure occur. [See Electric Heat Safety on page 27](#) for more information on the operation of the safety limits.

Condensate Overflow

The factory installed overflow switch is a normally closed dry contact that will open when water in the primary drain pan rises to the designated level. The switch must be wired to a controller or thermostat with an appropriate alarm input that will close the cooling valve and possibly turn off the fan when the switch opens. If necessary, the normal state of the dry contact may be changed to normally open by turning the float over on the guide pin. With this change the dry contact will close when water reaches the designated level.

Coil Freeze Protection

Coil freeze protection is the sole responsibility of the customer. If there is the possibility of entering air temperatures below 40°F, the use of some type of freeze protection is strongly advised. Freeze protection may be in the form of adding glycol to the water in the system to prevent coil rupture or through the use of a low temperature thermostat capillary tube mounted on the inlet side of the primary or preheat coil. If glycol is used the type and amount of glycol should be determined by the application requirements and must be accounted for in the coil performance calculations. A low temperature thermostat capillary tube should be connected to a controller, capable of closing the outside air damper and opening the control valve to allow water flow through the coil. It should also send an alarm to the BAS or maintenance station to alert the appropriate personnel.

Electric Heat Control

1. Electric heat control can be factory configured for either on-off or analog control.
2. On-off control requires a 24VAC signal applied to the terminal labeled EH 24+ to cycle the electric heat elements.
3. Analog control uses an SCR control module to power the electric elements and requires a 0-10VDC signal applied to the terminal labeled EH 0-10V, to modulate heat output.

Valve Control

1. Valve control can be factory configured for either on-off or analog control.
2. On-off control requires a 24VAC signal applied to the terminal labeled VLV1 24+ or VLV2 24+ to control the valve.
3. Analog control requires a 0-10VDC signal, applied to the terminal labeled VLV1 0-10V or VLV2 0-10V to modulate the valve.

Motor Controls

1. Unit sizes 006 – 020 ship with an EC motor factory configured for either three speed or analog control.
2. The three speed control option provides three separate field adjustable motor speeds that can be activated by applying a 24VAC signal to the appropriate terminal. This allows fan control with a conventional three position fan switch or fan coil style thermostat. The speed terminals in the unit are labeled FLO 1, FLO 2, and FLO 3 and correspond to the low, medium and high speed terminals on the switch. Speed adjustment is made at the EVO board by turning the dial adjacent to the speed terminal to change the motor's RPM for that speed.
3. The analog speed control option requires a 0-10VDC signal applied to the terminal labeled FAN 0-10V on terminal block TB4 to control motor RPM. 0VDC runs the motor at the minimum RPM and a 10VDC signal runs the motor at maximum RPM.
4. Unit sizes 030 – 050 are provided with a factory installed VFD programmed for analog motor speed control. A 0-10VDC signal applied to the terminal labeled FAN 0-10V on terminal block TB4 allows motor RPM to be adjusted.

Damper Control

1. Damper control can be factory configured for either on-off or analog control.
2. On-off control requires a 24VAC signal applied to the terminal labeled ACT 24+ to cycle the damper.
3. Analog control requires a 0-10VDC signal applied to the terminal labeled ACT 0-10V to modulate the damper.

Mixing Box (Optional) – Field Provided Damper Actuator

The optional mixing box includes a fresh air and return air damper that are linked together and driven from the same actuator. It may be ordered with or without the factory mounted damper actuator. Those with the factory mounted actuator ship prewired to the main unit control box and do not require field adjustment of the hardware or linkage.

For the mixing box ordered without the factory mounted damper actuator one must be provided in the field that meets the following criteria.

- Maximum range of rotation = 95°
- Maximum torque = 62 in/lbs
- On-off control = spring return
- Modulating control = 0-10VDC fail in place
- Damper shaft size = 0.5" diameter

A mounting plate is provided on the shaft side of the damper frame to accommodate a variety of actuators. However, due to the number of options, size variations, and arrangements available, some actuators may require alternate field provided mounting hardware. Proper support for the actuator is important to avoid putting excess stress on the cabinet, linkage, or damper shafts. The installing contractor is responsible for mounting, and wiring of the actuator and adjustment of the damper linkage.

Optional Mixing Box Damper or Discharge Plenum Loss

For reference, losses are similar to those used in custom openings, however, their coefficients are multipliers of velocity pressure based on opening size. These are multipliers of coil velocity pressure. The intake loss assumes a fully open damper in line with the unit, based on the sudden expansion into the unit of 2× the face area and 20% drag from the blade. The discharge loss assumes the sudden expansion of the fan of 10× then a sudden contraction at the discharge of 3× the face area. Losses from a grille are not taken into account.

$$\text{Intake, intake with damper or discharge plenum loss} = \left(\frac{V \cdot C}{4005} \right)^2$$

V = velocity through the opening

C:	Straight intake without damper = 0.75
	Turned intake without damper = 1.0
	Straight intake with damper = 1.0
	Turned intake with damper = 1.33
	Straight discharge = 1.5
	Turned discharge = 2

Example:

For a selection at 1000 ft/min, mix box with rear intake and discharge plenum down discharge:

Intake loss is $(1000 \cdot 1 / 4005)^2 = 0.062''$

Discharge loss is $(1000 \cdot 1.5 / 4005)^2 = 0.140''$

Mounting and Access

The air handler unit must be installed on a flat and level surface (or verify that the unit is level when hanging from the ceiling). Where surface irregularities allow the equipment to distort, shim the appropriate base rails to straighten the unit. Distorted units can cause misfit between sections, cabinet leaks, binding of the doors and access panels and prevent proper draining of drain pans.

Leave adequate space around the unit for piping, coils, and drains. Always have access to at least one side of the unit for regular service and maintenance. Refer to images in [Figure 12](#) and [8](#) for servicing space requirements. Routine maintenance examples include filter replacement, drain pan inspection/cleaning, and motor bearing lubrication.

Note that compact vertical units are accessed from the front of the unit. If they are ducted, access will require removal of the duct.

Provide sufficient space on the controls access side of the unit for filter replacement, drain pan cleaning and coil removal, if necessary.

Leave at least 42" of clearance in front of electrical power devices (starters, VFDs, disconnect switches, and combination devices) mounted behind service panels.

Factory ordered spring isolators are recommended on unit sizes 030, 040 and 050.

Figure 12: Clearance and Access Requirements for Horizontal Units





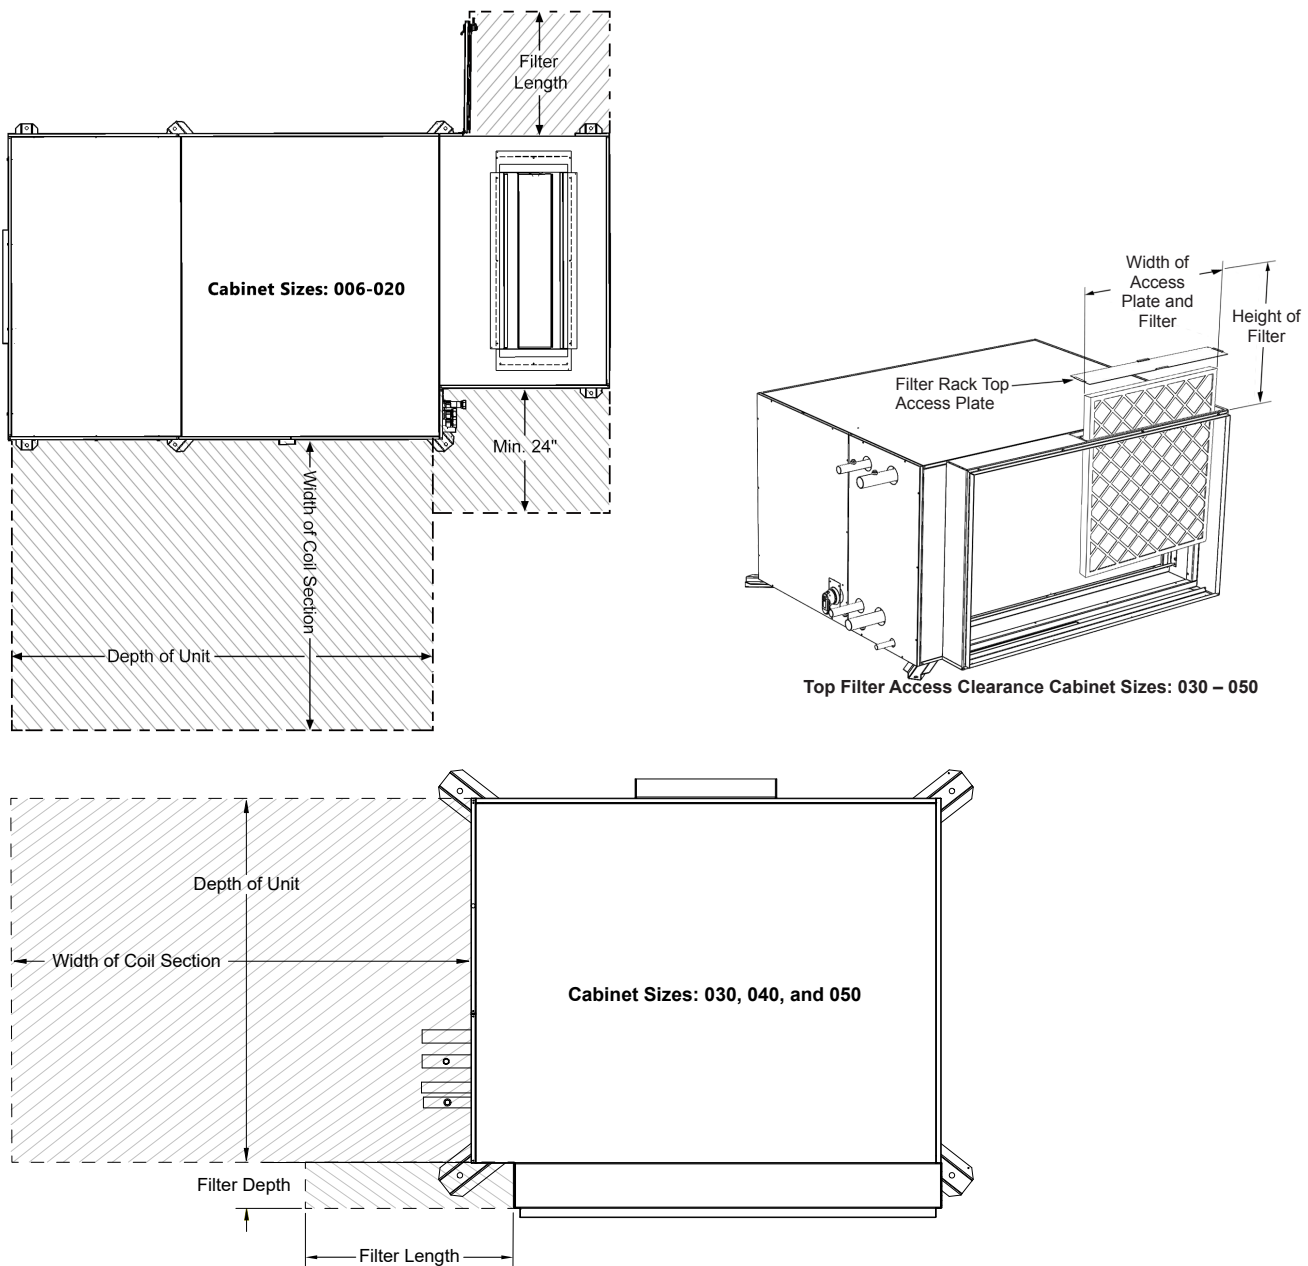



Figure 13: Clearance and Access Requirements for Vertical Units

Note: AVD units require field-cut holes on the sides or back, depending on piping orientation. These holes should either be drilled prior to unit installation, or a clearance of 24" should be left on the side requiring field work.

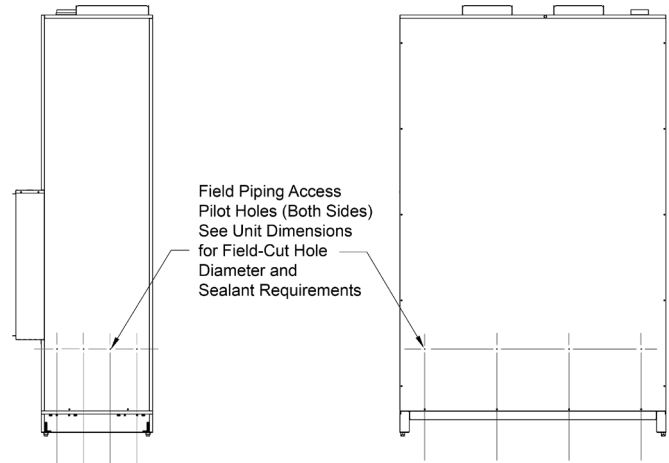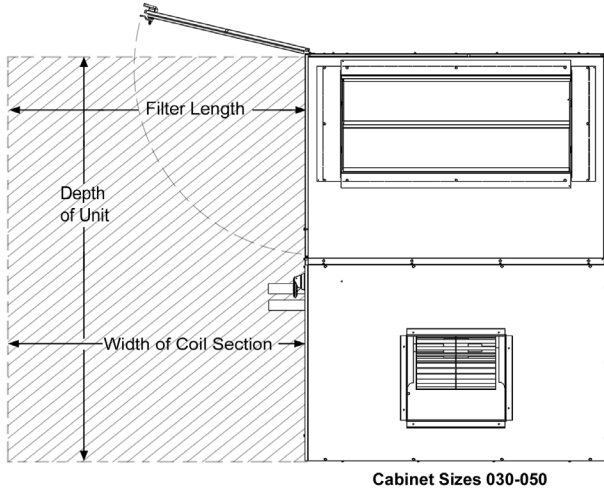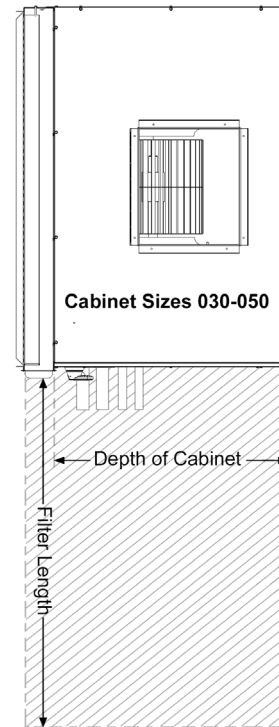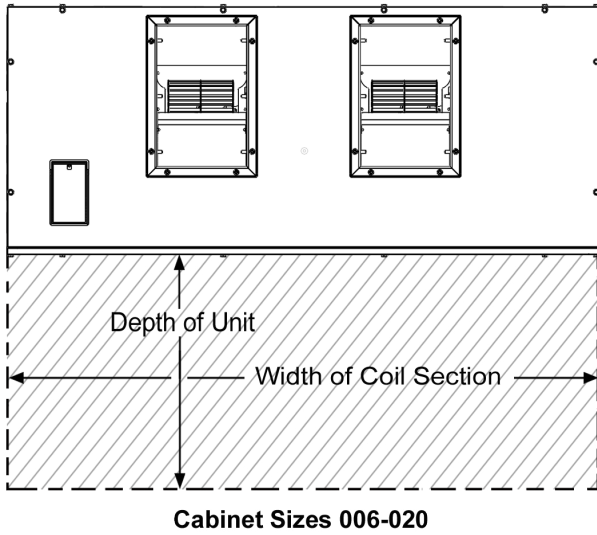

Horizontal Unit Mounting Isolation

Figure 14: Ceiling Hung with Rubber Isolators - Unit Sizes 030-050.

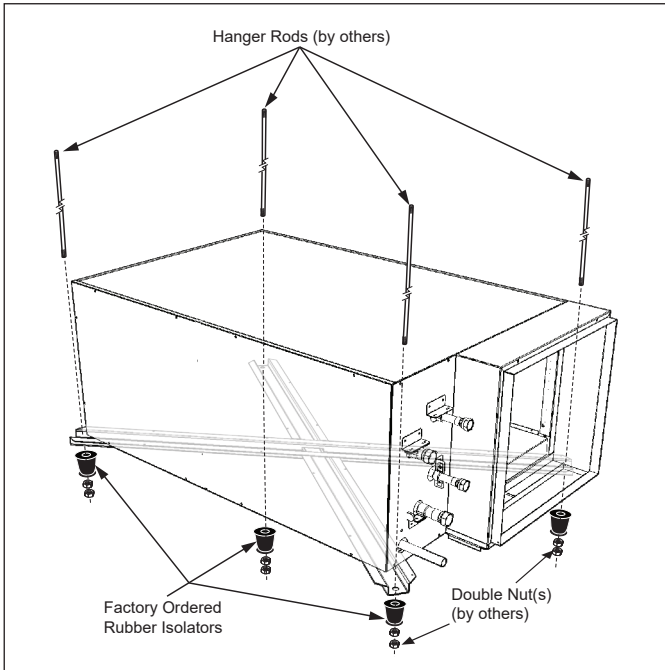

Spring Mount—Sizes 030, 040, 050

Factory ordered spring isolators are recommended on unit sizes 030, 040 and 050. The isolators should all be at the same height opening.

Figure 15: Floor Mounted Spring Isolation - Unit Sizes 030, 040, 050.


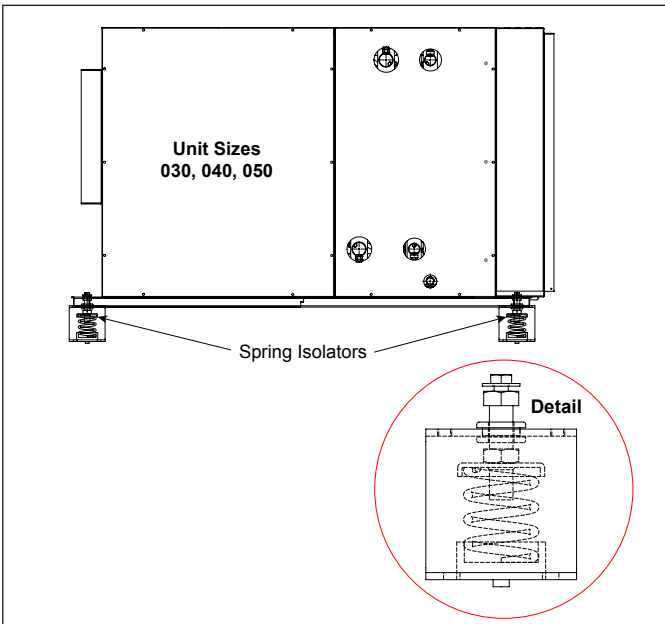



Figure 16: Ceiling Hung Spring Isolation - Unit Sizes 030, 040, 050.

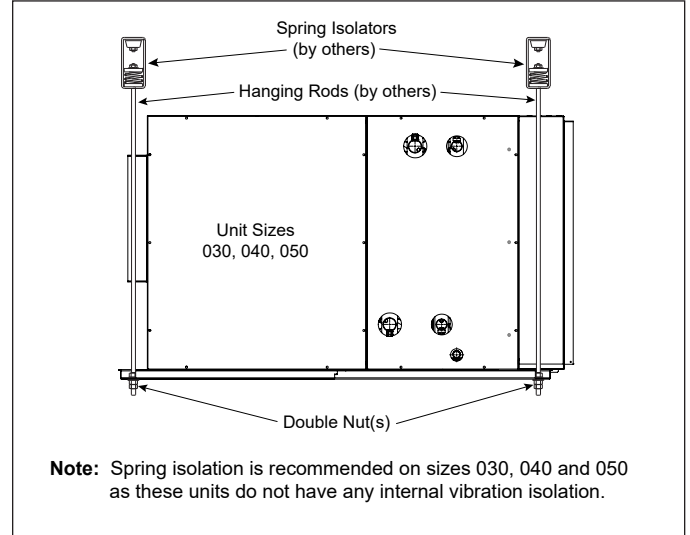

Vertical Unit Mounting Isolation

Neoprene pads and/or spring isolators are to be provided by others, if required.

Figure 17: Unit Size 040 Mounting Rail Holes Detail

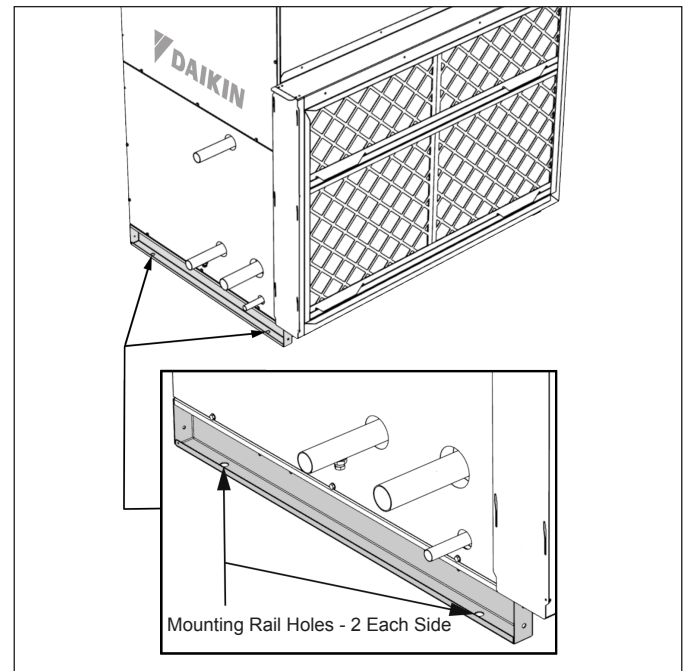

Access Panels and Doors

PreciseLine air handlers have hinged access doors or screw-on panels that can be easily removed and handled. To gain access through a side panel, remove the fasteners along the sides of the panel and lift the panel off. Allow sufficient space for service panel removal and to meet the service clearance requirement of the section it accesses. Service panels are not interchangeable with service panels on the opposite side of the unit.

Figure 18: Panel Removal

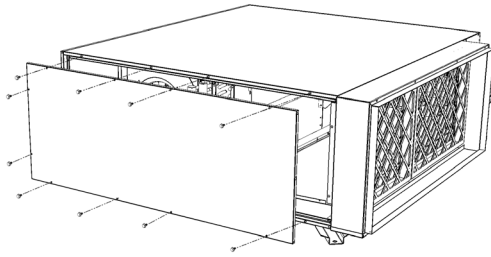


Figure 19: Filter Access Doors


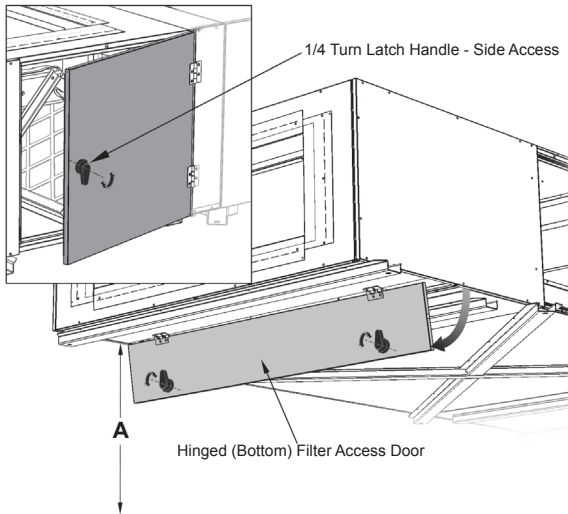


Table 1: Bottom Filter Access Clearance

Unit Size	006 – 020	030	040	050
A	18.00	24.00	28.00	30.00

Figure 20: Filter Access Doors

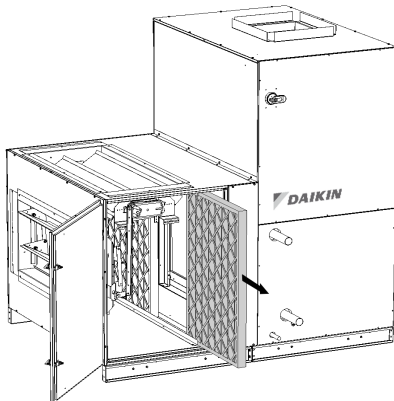

Piping and Coils

Follow applicable piping design, sizing, and installation information presented in ASHRAE Handbooks in the design and installation of piping. Observe all local codes and industry standards. Piping field connection locations are the same for units with and without the optional factory installed valve package. Refer to Table 2 for the connection size and type. Refer to dimensional drawings beginning on page 44 for connection locations and dimensions.

Hydronic Coil Connections

For all units Sizes 30-50; hydronic supply, return, and drain stubs extend through the end panel of the cabinet, with field connections made outside the cabinet. **All stubs are labeled on the end panel.** A "No Piping" option is available with internal coil stubs. Chilled water supply, return, and drain stubs may terminate inside or outside the cabinet on compact horizontal units, and necessarily terminate in a central location inside the cabinet on AVD units. Stub outs are labeled individually and/or on the end panel.

Hydronic supply and return connections are copper FPT on sizes 006 through 020 and copper sweat on sizes 030 through 050. Refer to Table 2 on page 22 for connection sizes and type.

Hydronic heating coil guidelines are listed below.

1. Hot water coils are not recommended for use with entering air below 40°F.
2. If fresh air and return air are to be heated by a hot water coil, take care in the design of the system to provide thorough mixing before air enters the coil.

Figure 21: Coil Connections, Unit Sizes 006 Thru 020

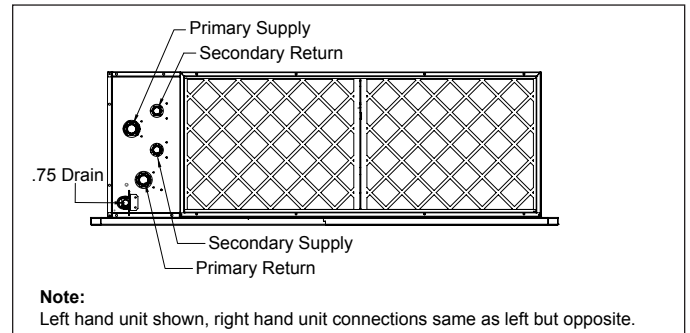


Figure 22: Field Pipe Connections, Unit Sizes 030, 040, 050 (preheat coil option shown)


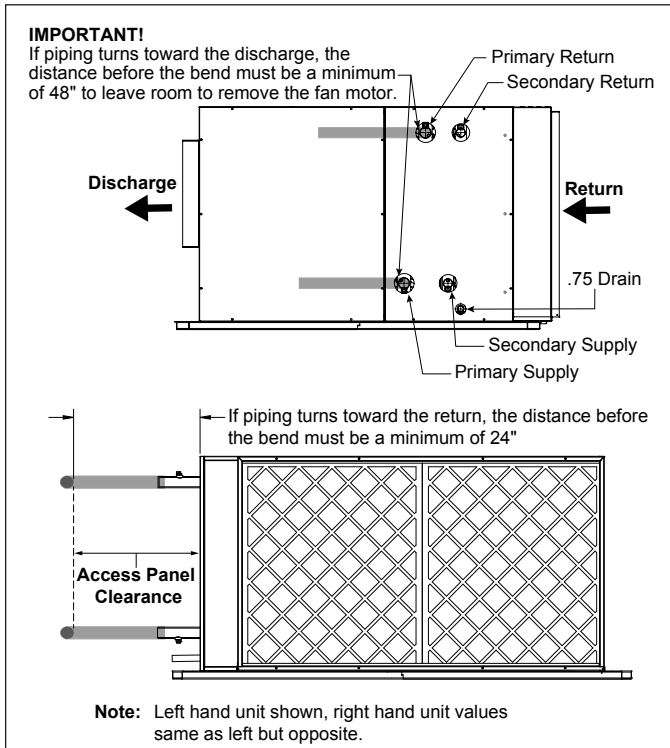


Figure 24: DX Interlaced Coil, Unit Sizes 030-050

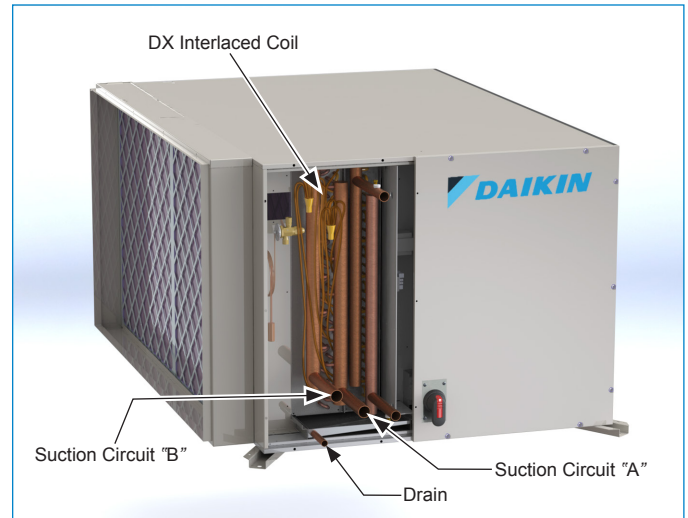

Condensate Drain Pan Traps

Condensate drain stub is .75 O.D.. Drain lines and traps should run full size from the drain pan stub. Drain pans should have traps to allow condensate from coils to drain freely. The trap depth and distance between the trap outlet and the drain pan outlet should be twice the static pressure in the drain pan section under normal operation for the trap to remain sealed. Refer to [Figure 25](#).

Figure 23: Coil Connections, Unit Sizes 030 Thru 050


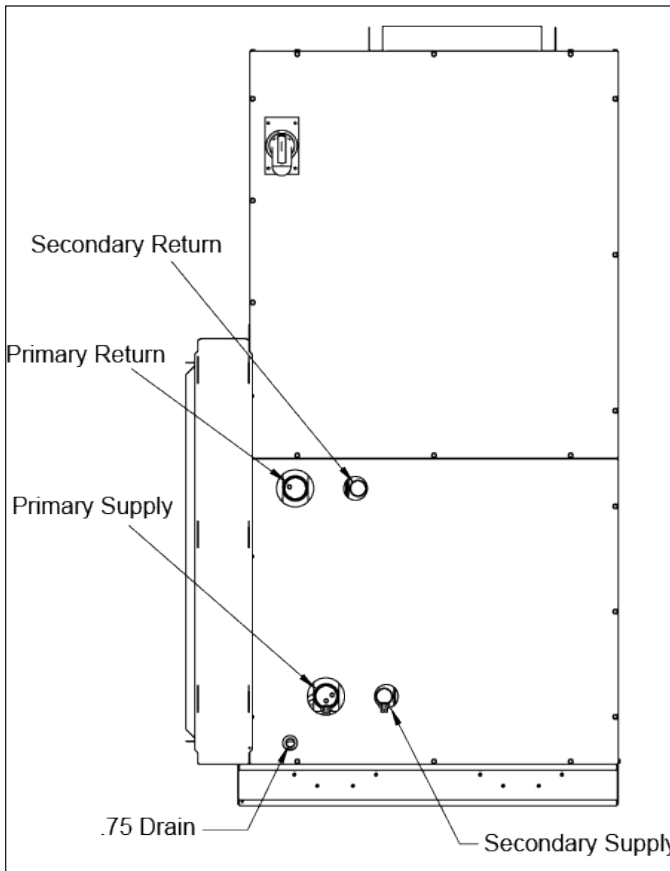


Figure 25: Allow Adequate Distance Between Trap Outlet and Drain Outlet

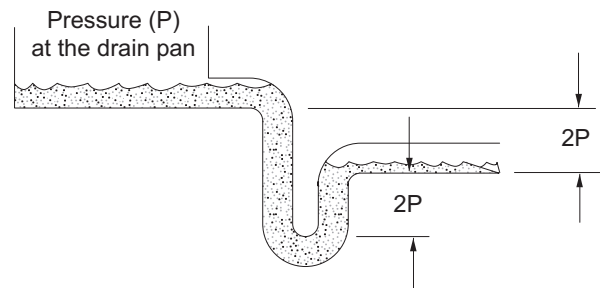

Operation Limitations

Leaving Air Temperature

- Daikin's PreciseLine is a draw thru style air handler which means the fan housing and motor assembly are in the conditioned part of the air stream. Coil leaving air temperatures over 125°F are not recommended and threaten the longevity of the unit.

Entering Air Temperatures

- The coils used in PreciseLine are not suitable for exposure to freezing temperatures. Proper consideration must be taken to keep the air temperature seen by the coil above the freezing point of the coil's working fluid. Units with a mixing box must be especially careful because large temperature

differences between return air and outdoor air can leave the coil vulnerable through air stratification.

Entering Water Temperatures

- Entering water temperatures above 200°F are not recommended as PreciseLine's coils are tested and rated to 200°F in accordance with UL 1995.

Voltage Variance

- To preserve longevity of electrical components supplied voltage must be within 10% of the nominal nameplate voltage.

Table 2: Horizontal Hydronic Coil Size and Connection Type

Unit Size	006	008	010	012	016	018	020	030	040	050
Connection Type	FPT					F-SWT				
2-Row Cooling	0.500	0.500	0.500	0.500	0.750	0.750	0.750	1.125	1.125	1.375
4-Row Cooling	0.500	0.500	0.750	0.750	0.750	1.000	1.000	1.375	1.625	1.625
6-Row Cooling	0.500	0.500	0.750	0.750	1.000	1.000	1.000	1.375	1.625	1.625
8-Row Cooling	—	—	—	—	—	—	—	1.375	1.625	1.625
1-Row Heating	0.500	0.500	0.500	0.500	0.500	0.500	0.500	0.625	0.875	1.125
2-Row Heating	0.500	0.500	0.500	0.500	0.750	0.750	0.750	1.125	1.125	1.375

Table 3: Vertical Hydronic Coil Size and Connection Type

Unit Size	006	008	012	016	020	030	040	050
Connection Type	FPT					F-SWT		
2-Row Cooling	0.500	0.500	0.500	0.750	0.750	1.125	1.375	1.375
4-Row Cooling	0.500	0.500	0.750	0.750	1.000	1.375	1.625	1.625
6-Row Cooling	0.500	0.500	0.750	1.000	1.000	1.625	1.625	2.125
8-Row Cooling	—	—	—	—	—	1.625	2.125	2.125
1-Row Heating	0.500	0.500	0.500	0.500	0.500	0.625	0.875	1.125
2-Row Heating	0.500	0.500	0.500	0.750	0.750	1.125	1.375	1.375

Table 4: Hydronic Coil Size and Type with No Piping Option

Unit Size	006	008	012	016	020
Connection Type	M-SWT				
2-Row Cooling	0.625	0.625	0.625	0.875	0.875
4-Row Cooling	0.625	0.625	0.875	0.875	1.125
6-Row Cooling	0.625	0.875	0.875	1.125	1.125
8-Row Cooling	—	—	—	—	—
1-Row Heating	0.625	0.625	0.625	0.625	0.625
2-Row Heating	0.625	0.625	0.625	0.875	0.875

Table 5: Vertical Steam Coil Size and Type

Unit Size	006	008	012	016	020	030	040	050
Connection Type	M-SWT							
Supply	1.125	1.125	1.125	1.125	1.125	1.125	1.125	1.375
Return	0.875	0.875	0.875	0.875	0.875	1.125	1.125	1.375
Fin Spacing								
FPI	10							

Table 6: Horizontal Steam Coil Size and Type (Piping)

Unit Size	006	008	010	012	016	018	020	030	040	050
Connection Type	FPT							M-SWT		
Supply	0.750	0.750	0.750	0.750	0.750	0.750	0.750	1.125	1.125	1.375
Return	0.500	0.500	0.500	0.500	0.500	0.500	0.500	1.125	1.125	1.375

Table 7: Horizontal Steam Coil Size and Type (No Piping)

Unit Size	006	008	010	012	016	018	020
Connection Type	FPT						
Supply	0.875	0.875	0.875	0.875	0.875	0.875	0.875
Return	0.625	0.625	0.625	0.625	0.625	0.625	0.625
Coil Size							
Finned Height	12	12	12	12	12	12	12
Finned Length	6.5	10.5	19	19	27	35.5	35.5

Note: FPI of 10 may be selected.

Table 8: VRV Coil Size and Type

Unit Size	Rows	Fin Height	Fin Length	FPI	Connection Size (M-SWT)	
					Distributor	Suction
006	3	14	12.5	12	0.375	0.750
008	3	14	16.5	12	0.375	0.750
010	3	14	25	12	0.375	0.875
012	3	14	25	12	0.375	0.875
016	3	14	33	12	0.375	1.125
018	3	14	41.5	12	0.375	1.125
020	3	14	41.5	12	0.375	1.125
030	3	22	39.5	10	0.500	1.375
040	3	26	44.5	12	0.625	1.375
050	3	28	51.5	12	0.625	1.625

Table 9: DX Coil Size and Type

Unit Size	Rows	Circuits		Connection Size (M-SWT)	
		Number	Type	Distributor	Suction
006	3	1	Normal	0.500	0.750
006	6	1	Normal	0.500	0.750
008	3	1	Normal	0.500	0.875
008	6	1	Normal	0.500	0.875
012	3	1	Normal	0.500	1.125
012	6	1	Normal	0.625	1.125
016	3	1	Normal	0.625	1.125
016	6	1	Normal	0.875	1.125
020	3	1	Normal	0.875	1.375
020	6	1	Normal	0.875	1.375
030	3	1	Normal	0.875	1.625
		2	Interlaced	0.625	0.875
030	6	1	Normal	—	—
		2	Interlaced	0.875	0.875
040	3	1	Normal	0.875	1.625
		2	Interlaced	0.875	1.125
040	6	1	Normal	—	—
		2	Interlaced	0.875	1.375
050	3	1	Normal	0.875	1.625
		2	Interlaced	0.875	1.375
050	6	1	Normal	—	—
		2	Interlaced	0.875	1.625

Note: FPI of 12, 14, or 16 may be selected.

Physical Data

Component Weights

Table 10: Horizontal Component Weights

Component	Rows	FPI	Weight—lbs (kg)									
			006	008	010	012	016	018	020	030	040	050
Coil (Wet)	1	12	6 (3)	7 (4)	9 (5)	9 (5)	10 (5)	11 (5)	11 (5)	20 (10)	26 (12)	33 (15)
Coil (Wet)	1	16	7 (4)	7 (4)	9 (5)	9 (5)	11 (5)	12 (6)	12 (6)	21 (10)	28 (13)	35 (16)
Coil (Wet)	2	12	9 (5)	10 (5)	13 (6)	13 (6)	17 (8)	19 (9)	19 (9)	33 (15)	43 (20)	53 (25)
Coil (Wet)	2	16	9 (5)	11 (5)	14 (7)	14 (7)	18 (9)	21 (10)	21 (10)	36 (17)	46 (21)	57 (26)
Coil (Wet)	4	12	13 (6)	16 (8)	23 (11)	23 (11)	28(13)	35 (16)	35 (16)	57 (26)	77 (35)	93 (43)
Coil (Wet)	4	16	14 (7)	17 (8)	24 (11)	24 (11)	30 (14)	38 (18)	38 (18)	61 (28)	84 (39)	101 (46)
Coil (Wet)	6	12	18 (9)	23 (11)	31 (15)	31 (15)	41 (19)	49 (23)	49 (23)	78 (36)	106 (49)	128 (59)
Coil (Wet)	6	16	19 (9)	25 (12)	34 (16)	34 (16)	44 (20)	54 (25)	54 (25)	85 (39)	115 (53)	140 (64)
Coil (Wet)	8	12	-	-	-	-	-	-	-	100 (46)	134 (61)	164 (75)
Coil (Wet)	8	16	-	-	-	-	-	-	-	109 (50)	147 (67)	179 (82)
Coil (Dry)	1	12	5 (3)	6 (3)	7 (4)	7 (4)	8 (4)	9(5)	9(5)	16 (8)	20 (10)	25 (12)
Coil (Dry)	1	16	5 (3)	6 (3)	7 (4)	7 (4)	8 (4)	10 (5)	10 (5)	17 (8)	22 (10)	27 (13)
Coil (Dry)	2	12	7 (4)	8 (4)	10 (5)	10 (5)	12 (6)	14 (7)	14 (7)	24 (11)	32 (15)	39 (18)
Coil (Dry)	2	16	7 (4)	8 (4)	11 (5)	11 (5)	14 (7)	16 (8)	16 (8)	27 (13)	35 (16)	43 (20)
Coil (Dry)	4	12	10 (5)	12 (6)	16 (8)	16 (8)	20 (10)	25 (12)	25 (12)	41 (19)	55 (25)	65 (30)
Coil (Dry)	4	16	11 (5)	13 (6)	18 (9)	18 (9)	23 (11)	28 (13)	28 (13)	46 (21)	61 (35)	73 (34)
Coil (Dry)	6	12	13 (6)	16 (8)	23 (11)	23 (11)	29 (14)	35 (16)	35 (16)	56 (26)	75 (35)	91 (42)
Coil (Dry)	6	16	14 (7)	18 (9)	25 (12)	25 (12)	33 (15)	40 (19)	40 (19)	63 (29)	84 (39)	102 (47)
Coil (Dry)	8	12	-	-	-	-	-	-	-	72 (33)	95 (44)	116 (53)
Coil (Dry)	8	16	-	-	-	-	-	-	-	81 (37)	107 (49)	131 (60)
DX Normal	3	12	9(5)	11 (5)	15 (7)	15 (7)	19 (9)	23 (11)	23 (11)	38 (18)	49 (23)	60 (28)
DX Interlaced	3	12	-	-	-	-	-	-	-	36 (17)	47 (22)	58 (27)
DX Normal	3	16	10 (5)	12 (6)	17 (8)	17 (8)	21 (10)	25 (12)	25 (12)	42 (20)	54 (25)	66 (30)
DX Interlaced	3	16	-	-	-	-	-	-	-	40 (19)	52 (24)	64 (30)
Standard Cabinet	-	-	180 (82)	260 (118)	324 (147)	324 (147)	440 (200)	530 (241)	530 (241)	490 (223)	585 (266)	730 (332)
Mixing Box	-	-	22 (10)	32 (15)	40 (18)	40 (18)	54 (25)	54 (25)	65 (30)	68 (31)	72 (33)	90 (41)
Discharge Plenum	-	-	20 (9)	29 (13)	36 (16)	36 (16)	49 (22)	49 (22)	59 (27)	63 (29)	67 (30)	81 (37)
Primary Valve Package	-	-	6 (3)	6 (3)	9 (4)	9 (4)	10 (5)	12 (5)	12 (5)	-	-	-
Heating Valve Package	-	-	4 (2)	4 (2)	6 (3)	6 (3)	6 (3)	8 (4)	8 (4)	-	-	-
VRV	3	12	9 (5)	11 (5)	15 (7)	15 (7)	18 (9)	22(10)	22 (10)	-	47 (22)	58 (27)
VRV	3	10	-	-	-	-	-	-	-	36 (16)	-	-

Table 11: Vertical Component Weights

Component	Rows	FPI	Weight—lbs (kg)								
			006	008	012	016	020	030	040	050	
Coil (Wet)	1	12	6 (3)	8 (4)	9 (5)	12 (6)	13 (6)	22 (10)	28 (13)	38 (18)	
Coil (Wet)	1	14	7 (4)	8 (4)	10 (5)	12 (6)	13 (6)	22 (10)	29 (14)	39 (18)	
Coil (Wet)	1	16	7 (4)	8 (4)	10 (5)	12 (6)	14 (7)	23 (11)	30 (14)	40 (19)	
Coil (Wet)	2	12	10 (5)	11 (5)	14 (7)	19 (9)	21 (10)	36 (17)	47 (22)	59 (27)	
Coil (Wet)	2	14	10 (5)	11 (5)	14 (7)	19 (9)	22 (10)	37 (17)	48 (22)	61 (28)	
Coil (Wet)	2	16	10 (5)	11 (5)	15 (7)	20 (10)	23 (11)	39 (18)	50 (23)	63 (29)	
Coil (Wet)	4	12	13 (6)	17 (8)	23 (11)	30 (14)	37 (17)	61 (28)	80 (37)	101 (46)	
Coil (Wet)	4	14	14 (7)	17 (8)	24 (11)	32 (15)	39 (18)	63 (29)	83 (38)	105 (48)	
Coil (Wet)	4	16	14 (7)	18 (9)	25 (12)	33 (15)	40 (19)	65 (30)	86 (40)	109 (50)	
Coil (Wet)	6	12	18 (9)	23 (11)	32 (15)	44 (20)	52 (24)	87 (40)	109 (50)	138 (63)	
Coil (Wet)	6	14	18 (9)	24 (11)	33 (15)	45 (21)	54 (25)	90 (41)	113 (52)	143 (65)	
Coil (Wet)	6	16	19 (9)	25 (12)	34 (16)	47 (22)	56 (26)	94 (43)	118 (54)	149 (68)	
Coil (Wet)	8	12	-	-	-	-	-	109 (50)	137 (63)	174 (79)	
Coil (Wet)	8	14	-	-	-	-	-	114 (52)	143 (65)	181 (83)	
Coil (Wet)	8	16	-	-	-	-	-	119 (54)	150 (69)	189 (86)	
Coil (Dry)	1	12	5 (3)	6 (3)	7 (4)	9 (5)	10 (5)	17 (8)	22 (10)	29 (14)	
Coil (Dry)	1	14	5 (3)	6 (3)	8 (4)	9 (5)	10 (5)	18 (9)	23 (11)	30 (14)	
Coil (Dry)	1	16	5 (3)	6 (3)	8 (4)	10 (5)	11 (5)	19 (9)	24 (11)	31 (15)	
Coil (Dry)	2	12	7 (4)	8 (4)	10 (5)	14 (7)	16 (8)	27 (13)	35 (16)	44 (20)	

Coil (Dry)	2	14	8 (4)	9 (5)	11 (5)	15 (7)	17 (8)	28 (13)	36 (17)	46 (21)
Coil (Dry)	2	16	8 (4)	9 (5)	11 (5)	15 (7)	17 (8)	30 (14)	38 (18)	48 (22)
Coil (Dry)	4	12	10 (5)	12 (6)	17 (8)	22 (10)	27 (13)	44 (20)	56 (26)	71 (33)
Coil (Dry)	4	14	10 (5)	13 (6)	18 (9)	23 (11)	28 (13)	46 (21)	59 (27)	75 (35)
Coil (Dry)	4	16	11 (5)	14 (7)	19 (9)	25 (12)	30 (14)	49 (23)	63 (29)	79 (36)
Coil (Dry)	6	12	13 (6)	17 (8)	23 (11)	31 (15)	37 (17)	61 (28)	77 (35)	97 (44)
Coil (Dry)	6	14	14 (7)	18 (9)	24 (11)	33 (15)	39 (18)	65 (30)	81 (37)	103 (47)
Coil (Dry)	6	16	14 (7)	19 (9)	25 (12)	35 (16)	42 (20)	68 (31)	86 (40)	109 (50)
Coil (Dry)	8	12	-	-	-	-	-	77 (35)	97 (44)	122 (56)
Coil (Dry)	8	14	-	-	-	-	-	82 (38)	103 (47)	130 (59)
Coil (Dry)	8	16	-	-	-	-	-	86 (40)	109 (50)	138 (63)
DX Normal	3	12	9 (5)	11 (5)	15 (7)	20 (10)	24 (11)	-	-	-
DX Interlaced	3	12	-	-	-	-	-	36 (17)	48 (22)	60 (28)
DX Normal	3	14	9 (5)	12 (6)	16 (8)	21 (10)	25 (12)	-	-	-
DX Interlaced	3	14	-	-	-	-	-	38 (18)	50 (23)	63 (29)
DX Normal	3	16	9 (5)	12 (6)	17 (8)	22 (10)	26 (12)	-	-	-
DX Interlaced	3	16	-	-	-	-	-	40 (19)	52 (24)	66 (30)
DX Normal	6	12	14 (7)	19 (9)	26 (12)	35 (16)	42 (20)	67 (31)	85 (39)	107 (49)
DX Interlaced	6	12	-	-	-	-	-	64 (30)	84 (39)	107 (49)
DX Normal	6	14	15 (7)	20 (10)	27 (13)	37 (17)	44 (20)	71 (33)	90 (41)	113 (52)
DX Interlaced	6	14	-	-	-	-	-	68 (31)	89 (41)	113 (52)
DX Normal	6	16	16 (8)	21 (10)	28 (13)	39 (18)	47 (22)	74 (34)	94 (43)	119 (54)
DX Interlaced	6	16	-	-	-	-	-	71 (33)	93 (43)	119 (54)
Standard Cabinet	-	-	119 (54)	119 (54)	119 (54)	170 (78)	170 (78)	315 (143)	336 (153)	373 (170)
Mixing Box	-	-	-	-	-	-	-	88 (40)	97 (44)	105 (48)
Discharge Plenum	-	-	20 (10)	23 (11)	25 (12)	33 (15)	35 (16)	48 (22)	52 (24)	56 (26)
Primary Valve Package	-	-	6 (3)	6 (3)	9 (4)	10 (5)	12 (5)	-	-	-
Heating Valve Package	-	-	4 (2)	4 (2)	6 (3)	6 (3)	8 (4)	-	-	-

Fan and Motor Data

Table 12: Horizontal Fan and Motor Data

Forward Curved Fan Data										
Unit Size	006	008	010	012	016	018	020	030	040	050
Fan Quantity	1	1	1	1	2	2	2	1	1	1
Fan Type	FC, DWDI	FC, DWDI	FC, DWDI	FC, DWDI	FC, DWDI	FC, DWDI	FC, DWDI	FC, DWDI	FC, DWDI	FC, DWDI
Fan Size	9.5" X 4.5"	9.5" X 4.5"	9.5" X 4.5"	9.5" X 4.5"	9.5" X 4.5"	9.5" X 4.5"	9.5" X 4.5"	10" X 10"	12" X 12"	12" X 12"
Maximum RPM	2065	2065	2065	2065	2065	2065	2065	2100	1800	1800
Class	1	1	1	1	1	1	1	2	2	2
Fan Part Number	910210867	910210867	910210867	910210867	910210867	910210867	910210867	910212478	910212479	910212477
EC Motors	1	1	1	1	2*	2*	2*	-	-	-
Poly Phase Motors	-	-	-	-	-	-	-	1	1	1
Motor 1/3 HP	X	X			X					
Motor 1/2 HP	X	X	X	X	X	X	X			
Motor 3/4 HP	X	X	X	X	X	X	X			
Motor 1 HP			X	X		X	X			
Motor 1½ HP**								X		
Motor 2 HP**								X	X	
Motor 3 HP**								X	X	
Motor 5 HP									X	X
Motor 7½ HP										X

* Motors are the same HP
 ** HP is limited by VFD size

Table 13: Vertical Fan and Motor Data

Forward Curved Fan Data								
Unit Size	006	008	012	016	020	030	040	050
Fan Quantity	1	1	1	2	2	1	1	1
Fan Type	FC, DWDI	FC, DWDI	FC, DWDI	FC, DWDI	FC, DWDI	FC, DWDI	FC, DWDI	FC, DWDI
Fan Size	9.5 x 4.5	9.5 x 4.5	9.5 x 4.5	9.5 x 4.5	9.5 x 4.5	10.5 x 10.5	12.5 x 12.5	12.5 x 12.5
Maximum RPM	2065	2065	2065	2065	2065	2100	1800	1800
Class	1	1	1	1	1	2	2	2
Fan Part Number	910210867	910210867	910210867	910210867	910210867	910212478	910212479	910212477
EC Motors	1	1	1	2*	2*	-	-	-
Poly Phase Motors	-	-	-	-	-	1	1	1
Motor 1/3 HP	X	X		X				
Motor 1/2 HP	X	X	X	X	X			
Motor 3/4 HP	X	X	X	X	X			
Motor 1 HP			X		X			
Motor 1½ HP**						X		
Motor 2 HP**						X	X	
Motor 3 HP**						X	X	
Motor 5 HP							X	X
Motor 7½ HP								X

* Motors are the same HP
 ** HP is limited by VFD size

Horizontal Filter Data

Table 14: Filter Data for Main Unit and Optional Mixing Box

Main Unit Filters										
Unit Size	006	008	010	012	016	018	020	030	040	050
Quantity	1	1	2	2	2	2	2	2	2	2
Height	17.69							25.38	29.75	28.00
Width	12.13	17.13	13.75		17.94	22.25		21.88	24.50	27.81
Nom. Face Velocity (FPM)	421	393	296	355	363	329	366	389	395	408
(Optional) Mixing Box Filters										
Quantity	1	1	2	2	2	2	2	2	2	2
Height	18.50							23.50	27.50	29.50
Width	12.50	17.50	12.75		17.00	21.25		23.25	25.75	29.25

Vertical Filter Data

Table 15: Filter Data for Main Unit and Optional Mixing Box

Main Unit Filters									
External									
Unit Size	006	008	012	016	020	030	040		050
Quantity	1	1	1	2	2	2	2	2	4
Height	12	12	18	16	20	25	12	20	20
Width	24	24	24	20	20	20	24	24	24
Nom. Face Velocity (FPM)	300	400	300	360	450	432	375		375
Internal Filter Rack									
Quantity	1	1	1	2	2	-	-	-	-
Height	12	18	20	16	16	-	-	-	-
Width	20	24	24	20	20	-	-	-	-
(Optional) Mixing Box Filters									
Quantity	-	-	-	-	-	2	4		4
Height	-	-	-	-	-	24	16		20
Width	-	-	-	-	-	20	20		20

Table 16: Filter Pressure Drop

Clean Pressure Drop	Face Velocity (Feet per minute)				
	100	200	300	400	500
2" Filter					
Merv 4	0.02	0.04	0.08	0.11	0.16
Merv 8	0.02	0.07	0.12	0.19	0.27
Merv 13	0.08	0.17	0.27	0.37	0.48
4" Filter					
Merv 8	0.01	0.03	0.06	0.1	0.14
Merv 13	0.02	0.07	0.12	0.19	0.27

Unit Selection

A mechanical heating, ventilation, and cooling system realizes thermal comfort and high efficiency through accurate space design and thoughtful equipment selection. Variations and limitations of centralized air handler systems and de-centralized fan coil systems are not outlined in this manual but must be fully understood. Design conditions and load calculations are not discussed in detail in this catalog but can be further explored and studied in the ASHRAE Guide. This catalog includes AHRI-certified ratings which a design engineer may make use of in initial system design and equipment specification.

A mechanical system designer must select the unit types best suited to the overall system before the actual unit sizes can be determined. The factors that generally influence this decision are: intended building usage, building layout, architectural and aesthetic values, economics, geographical location, and type of maintenance service available. The general results may be a mixture of unit types within a given system. Daikin Applied manufactures fan coil units to meet many needs including ThinLine, OptiLine, and Economy models. For Daikin product information, please go to www.DaikinApplied.com.

Basic Design Data

Prior to selecting individual unit sizes, a design engineer must fix or determine the following factors:

- Inside and outside wet and dry bulb design temperatures
- Total and sensible heat gains and losses of the area to be served
- Ventilation air
- Properties of the heating and cooling medium
- Available electric power service
- Any special design requirements of the building or system

Unit Size

The capacity ratings presented in this catalog are provided for initial unit selection only. Water cooling and heating capacities, unit air flow, static pressure and glycol solutions are all incorporated into Daikin Select Tools to provide the best possible selection. Consult your Daikin representative for a selection tailored to specific applications. Unit sizes for the ideal system should be selected by calculating peak load requirements due to unusually high occupancy or severe climatic conditions and with fans operating at high speed. Ordinary day-to-day cooling and heating requirements are then achieved at low and medium speeds. The initial unit selection should be checked for air volume in the design system and the

cooling capacities checked against actual operating conditions. While units selected on the basis of sensible load will generally meet the total cooling load, total load should be checked in all cases. The unit size is generally selected on the basis of matching the sensible cooling capacity of the unit with the calculated requirements when operating at high speed.

Coil Types

Standard coils are designed to meet both cooling and heating requirements in a typical system. Multiple primary coil options are available to meet the total and sensible requirements of any application. Heating requirements for systems are generally met by specifying entering water temperature and leaving water temperature, allowing a water flow rate to be calculated.

Four-pipe and Two-pipe systems are available. Daikin offers two coil options for preheat or reheat.

Four-Pipe Systems

Four-Pipe systems refer to a piece of air handling equipment that utilizes two distinct coils. One of the coils only operates in a cooling mode, and the other coil only operates in a heating mode. The advantage to this system setup is the ability to let the unit choose whether to employ cooling or heating mode at any one instant. During the shoulder seasons when space loads change based on sun exposure, occupant activity, plug loads, and other factors, some thermal spaces may require cooling while others require heating. Because the unit has two distinct coils piped to the chiller and boiler systems individually, the unit can choose which system to use.

Two-Pipe Systems

Two-Pipe systems refer to a piece of air handling equipment that utilizes a single coil. This coil can operate as a cooling only coil, a cooling and heating coil, or a heating coil. The "two-pipe" designation comes from how typically only two fluid pipes, one supply and one return, are run to each unit. The advantage to this system is first cost. Only one set of pipes (one return, one supply) to the unit is necessary. This effectively cuts the piping material cost in half.

Four and Two-Pipe Performance Measurements

All performance data is given assuming nominal cabinet airflow, which is achievable with up to 1.5" of external static pressure.

Cooling performance is based on 80/67°F (27/19°C) entering air temperature, 45°F (7°C) entering chilled water temperature with a 10°F (5.5°C) temperature rise.

Heating performance is based on 70°F (21°C) entering air temperature, 180°F (82°C) entering hot water temperature with a 30°F (17°C) temperature drop.

For other conditions and/or unit configurations, refer to DaikinTools™ selection program or talk to your local Daikin representative

Electrical Data

Calculations to realize MCA (Maximum Circuit Ampacity) and MROPD (Maximum Rated Overcurrent Protection Device) are explained in this section. MROPD (Maximum Rated Overcurrent Protection Device), MOP (Maximum Overcurrent Protection), MFS (Maximum Fuse Size) are synonymous in this section.

The minimum circuit ampacity (MCA) is the minimum conductor size required for a field-wired product. The MROPD (Maximum Rated Overcurrent Protection Device), MOP (Maximum Overcurrent Protection), or MFS (Maximum Fuse Size) is the maximum fuse or circuit breaker size required to properly protect the equipment. The MROPD will always be greater than the MCA for any given supply circuit.

The circuit's required fusing or HACR (Heating, Air-Conditioning and Refrigeration) type circuit breaker size is determined from the circuit's MCA and calculated MROPD.

$$\text{Heater Amps} = \left(\frac{\text{Heater kW} \times 1000}{\text{Heater Voltage}} \right)$$

NOTE: Use 120V heater voltage for 115V units. Use 240V heater voltage for 230V units.

$$\text{MCA} = 1.25 \times (\text{Heater Amps} + \text{all motor FLAs})$$

$$\text{Calculated MROPD} = 2.25 \times (\text{Largest Motor FLA's} + \text{Other Motor FLA's} + \text{Electric Heater Amps})$$

The circuit's MROPD is the next standard size fuse smaller than the calculated MROPD if that standard fuse sizes is greater than the MCA.

If the MCA is greater than the next standard size fuse smaller than the calculated MROPD, the circuit's MROPD is the next standard size fuse larger than the MCA.

If the circuit's MROPD is smaller than 15A, it shall be rounded up to 15A.

The temperature of the air leaving the unit (LAT) which is dependent on the entering air temperature (EAT), electric heat capacity (kW), and the air volume (CFM), must not exceed 125°F. The minimum allowable air volume for various combinations of EAT and kW are provided in [Table 24 on page 36](#) or may be calculated using the equation below.

$$\text{LAT} = (\text{kW} \times 3145.622 \div \text{CFM}) + \text{EAT}$$

Electric Heat Safety

Overcurrent Protection

Optional factory provided over current protection is available on all units with a maximum operating current less than or equal to 48 amps. This protection is provided with fuses located on the unit main power circuit. Units with a maximum operating current greater than 48 amps will come with factory installed fusing on the electric heat circuit.

Thermal (Over Temperature) Protection

All units with electric heat are provided with at least two thermal protection devices. The primary thermal protection device is an automatic limit switch which opens when it reaches a temperature of 150°F. The switch will reset itself when the temperature drops below 110°F. The secondary thermal protection device is a manual reset thermal cutout. This switch opens when it reaches 180°F for horizontal units and 210°F for vertical units, but must be reset manually after the over temperature issue has been resolved. Units provided with the SCR type electric heat control have an additional automatic thermal protection built into the SCR controller. This switch opens the circuit when the temperature reaches 170°F.

Valve Package Selections

All factory-installed valve packages are configurable through Daikin Select Tools for GPM, Cv, and control type. Factory installed valve packages ship with foam inserts for added support. Factory installed valve packages include unions for easy removal of cooling and heating coils.

The optional factory installed deluxe valve package includes a temperature control valve, a ball shut off valve with supply strainer, P/T port and clean out, and an automatic flow control valve with ball shut off and P/T ports. The temperature control valve is the Belimo B series characterized flow ball valve with SS ball and stem and is selectable as 2-way or 3-way. The valve flow coefficient and connection ports are appropriately sized for the selected flow rate. The control actuator can be configured for spring return on-off normally closed to the coil, spring return on-off normally open to the coil or non-spring return 0-10VDC modulating control. The strainer and ball shut off valve assembly is the Nexus UltraY and the automatic flow control valve and shut off assembly is the Nexus UltraMatic model UM. The piping schematic examples are shown in Figure 26 through Figure 31.

On vertical units Size 06 and 08, the control valve is a Belimo Zonetight. These valves can be selected as either 2-way or 3-way, N.O. or N.C, and have a manually adjustable Cv ranging from 0.5 to 5.9. **These valves are located on the supply side, adjacent to the coil, in contrast with other configurations being located on the return side.**

Figure 26: Basic 2-Way Valve Package

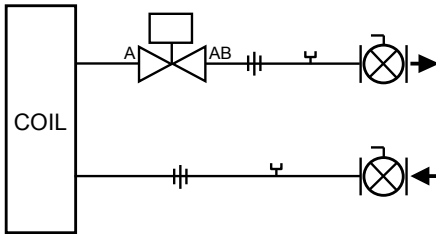


Figure 27: Basic 3-Way Valve Package

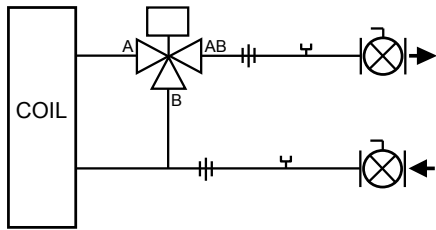


Figure 28: Deluxe 2-Way Valve Package (Auto CS)

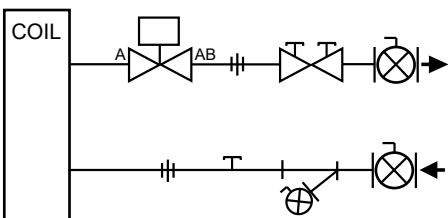


Figure 29: Deluxe 3-Way Valve Package (Auto CS)

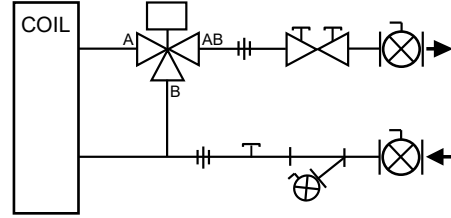


Figure 30: Deluxe 2-Way Valve Package (Manual CS)

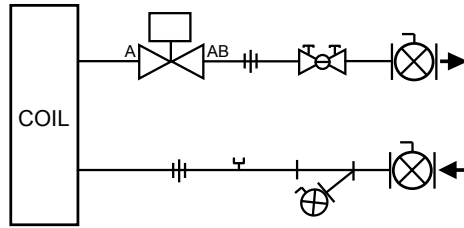


Figure 31: Deluxe 3-Way Valve Package (Manual CS)

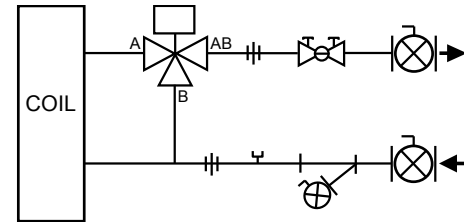


Figure 32: Components Key for Schematics

	Manual Shutoff Ball Valve with Memory Stop: Used on return line for limiting water flow.
	2-Way, ON/OFF Valve: Turn ON or OFF water flow to the coil in response to 24V or line voltage signal
	3-Way, ON/OFF Valve: Bypass water flow away from coil in response to 24V or line voltage signal. Includes fixed orifice for balancing.
	PT Port: For connecting a pressure or temperature gauge.
	Y-Strainer: Removable screen filters out small particles from supply line during normal system operation.
	Auto Circuit Setter: Pressure-compensated, automatic flow control.
	Manual Circuit Setter: Pressure-compensated, manual flow control.
	Union: For easy removal of piping from coil.

Note: Daikin 3-way valves are equipped with a fixed balance orifice in the bypass line, eliminating the need for a separate balancing valve

Horizontal Performance Data – Primary Coil

Table 17: Primary Coil Performance Data

Unit Size	Nominal Air Flow SCFM	Number of Rows	Fins per Inch	Cooling Performance				Heating Performance		
				Total MBH	Sensible MBH	GPM	Pressure Drop	Total MBH	GPM	Pressure Drop
006	600	2	12	8092.8	8092.8	1.6	1.1	39386	3.9	4.3
	600	4	12	18959.5	14689.3	3.8	6.4	59530	6.0	15.5
	600	6	12	25447.5	17503.9	5.1	18.9	67640	6.8	28.6
	600	6	16	27856.2	18512.5	5.6	22	70441	7.1	30.9
008	800	2	12	12436.8	12436.8	2.5	2.7	53462	5.3	8.2
	800	4	12	27424.5	20464.0	5.5	14.4	79931	8.0	29.1
	800	6	12	31454.0	22337.4	6.3	5.9	89240	9	7.9
	800	6	16	34661.6	23644.9	6.9	6.9	93367	9.4	8.6
010	1000	2	12	20626	18718	4.1	8.2	67066	7.1	16
	1000	4	12	35199	26129	7	5.9	98423	10	8
	1000	6	12	45344	30397	9.1	13.7	11375	11.2	14.1
	1000	6	16	49111	32003	9.8	15.9	116125	11.5	15
012	1200	2	12	22659.5	21062.4	4.5	9.7	81659	8.2	20.7
	1200	4	12	39722.8	30127.4	7.9	7.3	118469	11.9	10.9
	1200	6	12	52013	35475.9	10.3	17.3	133929	13.5	19.8
	1200	6	16	56823	37497.3	11.4	20.5	139764	14.1	21.4
016	1600	2	12	25487.6	25487.6	5.1	3	107859	10.8	8
	1600	4	12	56382.3	41576.5	11.3	15.9	160469	16.1	21.6
	1600	6	12	67200.3	46402.4	13.6	12	179487	18	13.1
	1600	6	16	73446.9	49013.1	14.7	13.8	187550	18.9	14.2
018	1800	2	12	34788.2	32286.2	7	5.8	117775	7.8	4.9
	1800	4	12	62438	45628	12.5	8.2	175937	11.7	32.4
	1800	6	12	76975	52782	15.4	6.6	199023	13.2	19.1
	1800	6	16	84217	55812	16.8	7.8	208595	13.8	20.4
020	2000	2	12	36784.2	34580.5	7.4	6.4	136875.0	13.7	13.7
	2000	4	12	66890.0	50480.6	13.4	9.3	199568.0	20.0	12.5
	2000	6	12	83865.0	57964.2	17.0	7.9	224497.0	22.6	8.7
	2000	6	16	91627.4	61189.9	18.3	9.0	234524.0	23.6	9.4
030	3000	2	12	54274.4	51385.1	10.9	3.3	196540.0	19.7	10.0
	3000	4	12	99303.1	75277.7	19.9	6.8	287096.0	28.8	12.4
	3000	6	12	130504.2	88343.7	25.9	16.3	324688.0	32.7	21.3
	3000	6	16	142573.9	93834.1	28.5	19.4	338921.0	34.1	23.0
	3000	8	12	147082.0	93552.0	29.4	11.6	340102.0	23.1	6.7
	3000	8	16	157045.0	97930.0	31.4	13.0	350496.0	23.8	7.1
040	4000	2	12	75962.8	70334.0	15.2	4.9	263448.0	26.3	14.8
	4000	4	12	136953.6	102271.6	27.4	9.9	184168.0	38.6	18.1
	4000	6	12	169529.4	116666.4	34.1	8.9	431730.0	43.5	9.7
	4000	6	16	185685.0	123407.1	37.1	10.4	450963.0	45.4	10.5
	4000	8	12	198947.0	125956.0	39.8	15.9	454523.0	30.9	9.5
	4000	8	16	212030.0	131736.0	42.4	17.8	468126.0	31.8	10.0
050	5000	2	12	99445.6	90217.4	19.9	7.7	341374.0	34.3	23.5
	5000	4	12	165360.8	125328.1	33.1	5.3	492729.0	49.5	7.7
	5000	6	12	217259.6	147994.7	43.2	13.1	557439.0	56.1	14.8
	5000	6	16	237387.4	156505.5	47.5	15.6	581988.0	58.6	16.0
	5000	8	12	252235.0	158982.0	50.4	23.5	569496.0	38.7	13.2
	5000	8	16	268443.0	166181.0	53.7	26.3	586217.0	39.9	13.9

Cooling Conditions: EAT = 80/67, EWT = 45, LWT = 55

Heating Conditions: EAT = 70, EWT = 180, LWT = 160

Horizontal Performance Data – Secondary Coil

Table 19: Secondary Coil Performance Data

Unit Size	Nominal Air Flow SCFM	Number of Rows	Fins per Inch	Heating Performance		
				Total MBH	GPM	Pressure Drop
006	600	1	12		1.6	10.5
	600	1	16	27578	1.9	14.6
	600	2	12	34519	2.3	1.7
	600	2	16	39847	2.7	2.2
008	800	1	12	30672	2.1	20.0
	800	1	16	37303	2.5	27.8
	800	2	12	47478	3.2	3.3
	800	2	16	54774	3.7	4.3
010	1000	1	12	39018	2.7	2.1
	1000	1	16	47136	3.2	3
	1000	2	12	66402	4.5	7.2
	1000	2	16	75858	5.2	9.2
012	1200	1	12	41985	2.9	2.4
	1200	1	16	50922	3.5	3.5
	1200	2	12	74248	5.1	8.8
	1200	2	16	85559	5.8	11.4
016	1600	1	12	57760	3.9	4.9
	1600	1	16	70132	4.8	6.9
	1600	2	12	96272	6.5	3.2
	1600	2	16	111039	7.5	4.2
018	1800	1	12	71269	4.9	7.8
	1800	1	16	86293	5.9	11.1
	1800	2	12	115465	7.9	4.9
	1800	2	16	132447	9	6.4
020	2000	1	12	74254	5.1	8.5
	2000	1	16	90195	6.1	12
	2000	2	12	123055	8.4	5.6
	2000	2	16	141838	9.6	7.2
030	3000	1	12	111153	7.6	6.2
	3000	1	16	135030	9.2	8.7
	3000	2	12	183646	12.5	4.4
	3000	2	16	211721	14.4	5.7
040	4000	1	12	149837	10.2	9.1
	4000	1	16	182091	12.3	12.9
	4000	2	12	246798	16.8	6.5
	4000	2	16	284689	19.4	8.5
050	5000	1	12	190121	13	13.8
	5000	1	16	231187	15.7	19.5
050	5000	2	12	311221	21.1	9.7
	5000	2	16	358951	24.4	12.7

Vertical Performance Data – Primary Coil

Table 20: Primary Coil Performance Data

Unit Size	Nominal Air Flow SCFM	Number of Rows	Fins per Inch	Cooling Performance				Heating Performance		
				Total MBH	Sensible MBH	GPM	Pressure Drop	Total MBH	GPM	Pressure Drop
006	600	2	12	12218.1	11138.8	2.4	2.4	38675.1	4.0	4.4
	600	4	12	20284.8	14289.9	4.1	9.9	58370.9	6.0	15.6
	600	6	12	22744.1	15469.0	4.5	3.0	65177.2	6.7	4.3
	600	6	16	25306.7	16511.6	5.1	3.6	68274.6	7.0	4.6
008	800	2	12	17965.5	15311.8	3.6	4.8	52594.4	5.4	7.0
	800	4	12	21406.7	16854.8	4.3	1.4	76228.1	7.8	3.4
	800	6	12	32031.3	21278.9	6.4	4.3	87237.5	9.0	6.0
	800	6	16	35578.4	22732.4	7.1	5.2	91320.1	9.4	6.5
012	1200	2	12	28746.1	23703.2	5.7	6.5	78160.4	8.0	8.7
	1200	4	12	36936.8	27128.2	7.4	3.5	114460.1	11.8	6.2
	1200	6	12	51208.8	33133.3	10.2	9.0	130834.0	13.4	11.0
	1200	6	16	56416.9	35307.1	11.3	10.6	137073.2	14.1	11.9
016	1600	2	12	35217.1	32840.1	7.0	1.6	104073.3	10.7	2.9
	1600	4	12	55340.1	38595.6	11.1	6.6	156346.0	16.1	9.9
	1600	6	12	65357.2	43063.1	12.9	4.4	175188.9	18.0	6.5
	1600	6	16	72808.8	46119.1	14.6	5.4	183183.9	18.8	7.0
020	2000	2	12	47583.1	40611.5	9.5	3.0	131486.0	13.5	4.7
	2000	4	12	63243.7	48872.5	12.7	3.3	193314.1	19.9	6.2
	2000	6	12	87147.8	59524.4	17.4	8.1	219711.7	22.6	10.7
	2000	6	16	95766.3	63351.4	19.2	9.6	229621.0	23.6	11.6
030	3000	2	12	73412.3	59896.8	14.7	3.9	201869.3	20.8	8.6
	3000	4	12	102384.0	76467.5	20.5	5.1	293920.6	30.2	10.3
	3000	6	12	135873.9	91481.4	27.2	12.4	331999.1	34.1	17.1
	3000	6	16	148406.8	97087.4	29.7	14.6	346190.8	35.6	18.5
	3000	8	16	159472.0	101996.1	31.9	9.1	354989.2	36.5	8.2
040	4000	2	12	90473.4	77833.3	18.1	5.7	266962.0	27.4	9.8
	4000	4	12	140219.2	103353.6	28.0	8.0	390108.7	40.1	12.0
	4000	6	12	173792.7	118833.5	34.8	6.6	439105.8	45.1	7.3
	4000	6	16	191128.9	126528.3	38.2	7.8	459020.8	47.2	7.9
	4000	8	16	215129.1	137112.6	43.0	15.9	473027.1	48.7	11.4
050	5000	2	12	121166.2	98648.6	24.2	6.5	335583.1	34.5	10.3
	5000	4	12	176335.0	129684.6	35.3	8.6	489312.9	50.3	13.3
	5000	6	12	217967.8	148864.1	43.6	9.6	549931.2	56.5	7.2
	5000	6	16	239565.4	158445.4	47.9	11.5	574488.1	59.0	7.7
	5000	8	16	269466.3	171640.4	53.9	17.1	591625.6	60.9	11.1

Vertical Performance Data – Secondary Coil

Table 21: Secondary Coil Performance Data

Unit Size	Nominal Air Flow SCFM	Number of Rows	Fins per Inch	Heating Performance		
				Total MBH	GPM	Pressure Drop
006	600	1	12	20953.0	1.4	1.3
	600	2	12	34614.7	2.4	1.7
	600	2	16	39965.9	2.7	2.2
008	800	1	12	28923.6	2.0	2.8
	800	2	12	47697.1	3.3	2.8
	800	2	16	55043.6	3.8	3.7
012	1200	1	12	38684.3	2.6	0.7
	1200	2	12	71237.6	4.9	3.7
	1200	2	16	82340.3	5.6	4.8
016	1600	1	12	56728.8	3.9	1.6
	1600	2	12	93375.8	6.4	1.1
	1600	2	16	107907.6	7.4	1.5
020	2000	1	12	72308.9	4.9	2.7
	2000	2	12	119242.8	8.2	1.9
	2000	2	16	137608.9	9.4	2.5
030	3000	1	12	102064.8	6.9	0.6
	3000	2	12	184150.3	12.6	3.4
	3000	2	16	212127.5	14.5	4.5
040	4000	1	12	135901.3	9.2	0.9
	4000	2	12	244387.7	16.7	4.0
	4000	2	16	281885.6	19.3	5.2
050	5000	1	12	171294.3	11.6	1.0
	5000	2	12	307145.5	21.0	4.2
	5000	2	16	354060.7	24.2	5.4

Heating Conditions: EAT = 70, EWT = 180, LWT = 150

Direct Expansion (DX) Coil

Table 22: Horizontal DX Coil Performance Data

Unit Size	Circuits		Fin Height	Finned Length	CFM	EAT		Suction Temp	FPI	Total	Sensible	LAT		APD	Connection Size	
	Number	Type				DB	WB					DB	WB		Liquid	Suction
006	1	Normal	14	12.5	600	80	67	45	12	20455	14797	57.5	56.2	0.379	0.500	0.750
									16	23060	16253	55.2	54.6	0.518	0.500	0.750
008	1	Normal	14	16.5	800	80	67	45	12	27983	20000	57.1	55.8	0.385	0.500	0.750
									16	31279	21882	55.0	54.4	0.525	0.500	0.750
010	1	Normal	14	25	1000	80	67	45	12	35464	25461	56.7	55.7	0.290	0.500	0.875
									16	40060	27887	54.5	54.0	0.400	0.500	0.875
012	1	Normal	14	25	1200	80	67	45	12	39519	29041	57.9	56.6	0.379	0.500	0.875
									16	44926	32018	55.6	55.0	0.518	0.500	0.875
016	1	Normal	14	33	1600	80	67	45	12	55588	39849	57.2	55.9	0.385	0.500	1.125
									16	62680	43813	55.0	54.3	0.525	0.625	1.125
018	1	Normal	14	41.5	1800	80	67	45	12	67101	46958	56.1	55.0	0.327	0.625	1.125
									16	74718	51177	54.0	53.5	0.449	0.625	1.125
020	1	Normal	22	41.5	2000	80	67	45	12	71003	50440	56.9	55.7	0.382	0.625	1.125
									16	79274	55156	54.8	54.2	0.521	0.625	1.125
030	1	Normal	22	39.5	3000	80	67	45	12	106172	75513	57.0	55.7	0.383	0.875	1.375
									16	118817	82688	54.8	54.2	0.523	0.875	1.375
	2	Interlaced	22	39.5	3000	80	67	45	12	106172	75513	57.0	55.7	0.383	0.500	0.875
									16	118817	82688	54.8	54.2	0.523	0.500	0.875
040	1	Normal	26	44.5	4000	80	67	45	12	141746	100750	57.0	55.7	0.384	0.875	1.375
									16	157734	109963	54.9	54.2	0.524	0.875	1.375
	2	Interlaced	26	44.5	4000	80	67	45	12	150755	105289	54.9	54.9	0.384	0.625	1.125
									16	157734	109963	54.9	54.2	0.524	0.625	1.125
050	1	Normal	28	51.5	5000	80	67	45	12	175437	125212	57.1	55.8	0.386	0.875	1.625
									16	196935	137345	54.9	54.2	0.526	0.875	1.625
	2	Interlaced	28	51.5	5000	80	67	45	12	175437	125212	57.1	55.8	0.386	0.625	1.375
									16	196935	137345	54.9	54.2	0.526	0.625	1.375

Table 23: Vertical DX Coil Performance Data

Unit Size	Rows	Circuits		Fin Height	Fin Length	CFM	EAT		Suction Temp	FPI	Total	Sensible	LAT		APD	Connection Size	
		Number	Type				DB	WB					DB	WB		Liquid	Suction
006	3	1	Normal	14	12.5	600	80	67	45	12	20872.0	15099.0	57.0	55.9	0.379	0.5	0.75
										16	23530.5	16584.7	54.7	54.3	0.518	0.5	0.75
006	6	1	Normal	14	12.5	600	80	67	45	12	29309.7	19134.1	50.7	50.6	0.759	0.5	0.75
										16	30804.0	19785.5	49.7	49.6	1.036	0.5	0.75
008	3	1	Normal	16	14.5	800	80	67	45	12	27761.6	20098.1	57.0	55.9	0.383	0.5	0.875
										16	31321.4	22087.5	54.8	54.3	0.522	0.5	0.875
008	6	1	Normal	16	14.5	800	80	67	45	12	39577.5	25727.7	50.5	50.4	0.765	0.5	0.875
										16	42128.9	26848.2	49.1	49.1	1.044	0.5	0.875
012	3	1	Normal	18	18.5	1200	80	67	45	12	40690.8	29684.9	57.4	56.2	0.408	0.5	1.125
										16	44497.9	32084.5	55.5	55.1	0.556	0.5	1.125
012	6	1	Normal	18	18.5	1200	80	67	45	12	58628.8	38272.4	50.7	50.6	0.816	0.625	1.125
										16	61932.8	39714.1	49.6	49.5	1.111	0.625	1.125
016	3	1	Normal	20	23.5	1600	80	67	45	12	57671.9	41085.1	56.5	55.5	0.375	0.625	1.125
										16	63835.7	44680.7	54.5	54.1	0.513	0.625	1.125
016	6	1	Normal	20	23.5	1600	80	67	45	12	80324.8	51964.2	50.2	50.1	0.751	0.875	1.125
										16	85191.4	54112.6	48.9	48.9	1.025	0.875	1.125
020	3	1	Normal	20	29	2000	80	67	45	12	69672.3	50352.4	57.0	55.9	0.383	0.875	1.375
										16	78698.3	55379.4	54.7	54.3	0.522	0.875	1.375
020	6	1	Normal	20	29	2000	80	67	45	12	99493.2	64557.7	50.4	50.3	0.765	0.875	1.375
										16	104892.3	66929.6	49.2	49.2	1.044	0.875	1.375
030	3	1	Normal	26	34.5	3000	80	67	45	12	108667.6	77327.5	56.4	55.4	0.366	0.875	1.625
										16	122196.0	84846.8	54.1	53.7	0.500	0.875	1.625
		2	Interlaced	26	34.5	3000	80	67	45	12	108667.6	77327.5	56.4	55.4	0.366	0.625	0.875
										16	122196.0	84846.8	54.1	53.7	0.500	0.625	0.875
030	6	1	Normal	26	34.5	3000	80	67	45	12	—	—	—	—	—	—	—
										16	—	—	—	—	—	—	—
		2	Interlaced	26	34.5	3000	80	67	45	12	147704.9	96170.7	50.6	50.5	0.731	0.875	0.875
										16	154645.7	99203.1	49.6	49.6	1.000	0.875	0.875
040	3	1	Normal	30	38.5	4000	80	67	45	12	144032.4	102551.0	56.6	55.5	0.385	0.875	1.625
										16	161384.1	112377.9	54.3	53.9	0.525	0.875	1.625
		2	Interlaced	30	38.5	4000	80	67	45	12	144032.4	102551.0	56.6	55.5	0.385	0.875	1.125
										16	161384.1	112377.9	54.3	53.9	0.525	0.875	1.125
040	6	1	Normal	30	38.5	4000	80	67	45	12	—	—	—	—	—	—	—
										16	—	—	—	—	—	—	—
		2	Interlaced	30	38.5	4000	80	67	45	12	198736.5	129006.9	50.4	50.3	0.770	0.875	1.375
										16	211839.4	134773.2	49.0	49.0	1.050	0.875	1.375
050	3	1	Normal	38	38.5	5000	80	67	45	12	181160.0	128739.0	56.5	55.4	0.378	0.875	1.625
										16	202916.3	141015.6	54.2	53.8	0.515	0.875	1.625
		2	Interlaced	38	38.5	5000	80	67	45	12	181160.0	128739.0	56.5	55.4	0.378	0.875	1.375
										16	202916.3	141015.6	54.2	53.8	0.515	0.875	1.375
050	6	1	Normal	38	38.5	5000	80	67	45	12	—	—	—	—	—	—	—
										16	—	—	—	—	—	—	—
		2	Interlaced	38	38.5	5000	80	67	45	12	249252.6	161620.3	50.3	50.2	0.755	0.875	1.625
										16	265538.3	168796.1	48.9	48.9	1.031	0.875	1.625

Table 24: VRV Coil Performance Data

Unit Size	Rows	Fin Height	Fin Length	CFM	EAT		Suction Temp	FPI	Total	Sensible	LAT		APD	Connection Size	
					DB	WB					DB	WB		Liquid	Suction
006	3	14	12.5	600	81	66	43	12	20689.0	16392.0	56.0	54.7	0.379	0.375	0.75
008	3	14	16.5	800	81	66	43	12	29014.0	22449.0	55.3	54.1	0.385	0.375	0.75
012	3	14	25	1200	81	66	43	12	45172.0	35301.0	54.1	53.6	0.497	0.375	0.875
016	3	14	33	1600	81	66	43	12	56835.0	44391.0	55.6	54.3	0.385	0.375	1.125
020	3	14	41.5	2000	81	66	43	12	73814.0	56681.0	55.1	53.8	0.382	0.375	1.125
030	3	22	39.5	3000	81	66	43	10	101005.0	78767.0	57.0	55.0	0.328	0.500	1.375
040	3	26	44.5	4000	81	66	43	12	148164.0	113561.0	55.0	53.8	0.384	0.625	1.375
050	3	28	51.5	5000	81	66	43	12	185585.0	142089.0	55.0	53.8	0.386	0.625	1.375

Table 25: Vertical Steam Coil Performance Data

Unit Size	Nominal Air Flow SCFM	Number of Rows	Fins per Inch	EAT	PSI	Heating Performance	
				DB		Total MBH	Pressure Drop
006	600	1	10	55	5	30049.0	0.18
008	800	1	10	55	5	41468.0	0.16
012	1200	1	10	55	5	61975.0	0.16
016	1600	1	10	55	5	87533.0	0.14
020	2000	1	10	55	5	106985.0	0.15
030	3000	1	10	55	5	151774.0	0.15
040	4000	1	10	55	5	202671.0	0.15
050	5000	1	10	55	5	258119.0	0.15

Table 26: Horizontal Steam Coil Performance Data

Unit Size	Nominal Air Flow SCFM	Number of Rows	Fins per Inch	EAT	PSI	Heating Performance	
				DB		Total MBH	Pressure Drop
006	600	1	10	55	5	22229.0	0.36
008	800	1	10	55	5	33948.0	0.26
010	1000	1	10	55	5	54590.0	0.14
012	1200	1	10	55	5	57961.0	0.19
016	1600	1	10	55	5	80691.0	0.17
018	1800	1	10	55	5	97625.0	0.14
020	2000	1	10	55	5	101153.0	0.16
030	3000	1	10	55	5	153469.0	0.16
040	4000	1	10	55	5	207617.0	0.15
050	5000	1	10	55	5	264380.0	0.14

Minimum Allowable Air Volume For Units With Electric Heat

Table 27: Horizontal Minimum Allowable Air Volume With Electric Heat

kW	Unit Size						
	006	008	010	012	016	018	020
	Air Volume - CFM						
0.41	300	400	600	600	800	1000	1000
0.5	300	400	600	600	800	1000	1000
0.82	300	400	600	600	800	1000	1000
1	300	400	600	600	800	1000	1000
1.64	300	400	600	600	800	1000	1000
2	300	400	600	600	800	1000	1000
2.45	300	400	600	600	800	1000	1000
3	300	400	600	600	800	1000	1000
3.27	300	400	600	600	800	1000	1000
4	300	400	600	600	800	1000	1000
4.09	300	400	600	600	800	1000	1000
4.91	300	400	600	600	800	1000	1000
5	300	400	600	600	800	1000	1000
6	–	400	600	600	800	1000	1000
6.54	–	400	600	600	800	1000	1000
7.36	–	425	600	600	800	1000	1000
8	–	460	600	600	800	1000	1000
8.18	–	470	600	600	800	1000	1000
9	–	515	600	600	800	1000	1000
9	–	515	600	600	800	1000	1000
9.81	–	570	600	600	800	1000	1000
10	–	575	600	600	800	1000	1000
10.6	–	–	–	–	800	1000	1000
11	–	–	–	–	800	1000	1000
11.3	–	–	–	–	800	1000	1000
12	–	–	–	–	800	1000	1000
13	–	–	–	–	800	1000	1000

kW	Unit Size		
	030	040	050
	Air Volume - CFM		
7.36	1500	2000	2500
9	1500	2000	2500
15	1500	2000	2500
18	1500	2000	2500
21	1500	2000	2500
24	1500	2000	2500
30	–	2000	2500
36	–	2060	2500
39	–	2250	2500

Notes: Limits are based on greater value of either:
 1. 250 FPM face velocity across the electric heating coil
 2. Entering Air of 70°F and a maximum of 125°F LAT

Table 28: Vertical Minimum Allowable Air Volume With Electric Heat

kW	Entering air Temperature (°F)				
	60	65	70	75	80
	Air Volume - CFM				
0.82	40	43	47	52	57
1	48	52	57	63	70
1.64	79	86	94	103	115
2	97	105	114	126	140
2.45	119	128	140	154	171
3	145	157	172	189	210
3.27	158	171	187	206	229
4	194	210	229	252	280
4.09	196	214	234	257	286
4.8	234	252	275	302	336
4.91	236	257	281	309	343
5	242	262	286	315	350
6	290	315	343	377	419
6.54	316	343	374	411	457
6.8	330	357	389	428	476
8	387	419	458	503	559
8.18	396	429	468	515	572
9	436	472	515	566	629
9.6	465	504	550	604	672
10	484	524	572	629	699
11.3	547	592	646	711	790
12	581	629	686	755	839
13.5	653	708	772	849	944
15	726	786	858	944	1049
18	871	944	1029	1132	1258
19.2	930	1007	1099	1208	1343
21	1016	1101	1201	1321	1468
24	1161	1258	1373	1510	1678
39	1887	2045	2231	2454	2726

Table 29: Vertical Minimum Allowable Air Volume With Electric Heat (Continued)

kW	Unit Size				
	006	008	012	016	020
	Air Volume - CFM				
0.82	300	-	-	-	-
1	300	400	-	-	-
1.64	-	400	600	-	-
2	300	400	600	800	1000
2.45	300	-	-	-	-
3	300	-	-	-	-
3.27	-	400	600	800	1000
4	300	400	600	800	1000
4.8	-	400	600	-	-
4.91	300	-	-	-	-
6	345	-	-	-	-
6.54	-	400	600	800	1000
8	-	460	600	800	1000
8.18	-	470	600	800	1000
9.6	-	550	600	800	1000
10	-	575	600	800	1000
12	-	-	-	800	1000
19.2	-	-	-	-	1100

kW	Unit Size		
	030	040	050
	Air Volume - CFM		
6.8	1500	2000	2500
9	1500	2000	2500
11.3	1500	2000	2500
13.5	1500	2000	2500
15	1500	2000	2500
18	1500	2000	2500
21	1500	2000	2500
24	1500	2000	2500
39	2235	2235	2500

Notes: Limits are based on greater value of either:
 1. 250 FPM face velocity across the electric heating coil
 2. Entering Air of 70°F and a maximum of 125°F LAT

Electric Heat kW Options

Table 30: Electric Heat kW Options by Unit Size

Unit Size	Voltage	Horizontal kW												
006	120/60/1	0.5	1.0	2.0	3.0	4.0	–	–	–	–	–	–	–	–
	208/60/1	0.4	0.8	1.6	2.5	3.3	4.1	4.9	–	–	–	–	–	–
	230/60/1	0.5	1.0	2.0	3.0	4.0	5.0	6.0	–	–	–	–	–	–
	277/60/1	–	1.0	2.0	3.0	4.0	5.0	6.0	–	–	–	–	–	–
	460/60/1	–	1.0	–	3.0	–	–	6.0	–	–	–	–	–	–
008	120/60/1	0.5	1.0	2.0	3.0	4.0	5.0	–	–	–	–	–	–	–
	208/60/1	0.4	0.8	1.6	2.5	3.3	4.1	4.9	6.5	8.2	–	–	–	–
	230/60/1	0.5	1.0	2.0	3.0	4.0	5.0	6.0	8.0	–	10.0	–	–	–
	277/60/1	0.5	1.0	2.0	3.0	4.0	5.0	6.0	8.0	–	10.0	–	–	–
	460/60/1	–	–	2.0	–	4.0	5.0	–	8.0	–	10.0	–	–	–
010	120/60/1	0.5	1.0	2.0	3.0	4.0	5.0	–	–	–	–	–	–	–
	208/60/1	0.4	0.8	1.6	2.5	3.3	4.1	4.9	6.5	8.2	–	–	–	–
	230/60/1	0.5	1.0	2.0	3.0	4.0	5.0	6.0	8.0	–	10.0	–	–	–
	277/60/1	0.5	1.0	2.0	3.0	4.0	5.0	6.0	8.0	–	10.0	–	–	–
	460/60/1	–	–	2.0	–	4.0	5.0	–	8.0	–	10.0	–	–	–
012	120/60/1	0.5	1.0	2.0	3.0	4.0	5.0	–	–	–	–	–	–	–
	208/60/1	0.4	0.8	1.6	2.5	3.3	4.1	4.9	6.5	8.2	–	–	–	–
	230/60/1	0.5	1.0	2.0	3.0	4.0	5.0	6.0	8.0	–	10.0	–	–	–
	277/60/1	0.5	1.0	2.0	3.0	4.0	5.0	6.0	8.0	–	10.0	–	–	–
	460/60/1	–	–	2.0	–	4.0	5.0	–	8.0	–	10.0	–	–	–
016	120/60/1	–	1.0	2.0	–	4.0	5.0	–	–	–	–	–	–	–
	208/60/1	–	0.8	1.6	–	3.3	–	4.9	6.5	8.2	–	–	–	–
	230/60/1	–	1.0	2.0	–	4.0	–	6.0	8.0	–	10.0	–	–	–
	277/60/1	–	1.0	2.0	–	4.0	–	6.0	8.0	–	10.0	–	12.0	13.0
	460/60/1	–	–	–	–	4.0	–	–	8.0	–	10.0	12.0	16.0	20.0
018	120/60/1	–	1.0	2.0	–	4.0	5.0	–	–	–	–	–	–	–
	208/60/1	–	0.8	1.6	–	3.3	–	4.9	6.5	8.2	9.0	–	–	–
	230/60/1	–	1.0	2.0	–	4.0	–	6.0	8.0	–	10.0	11.0	–	–
	277/60/1	–	1.0	2.0	–	4.0	–	6.0	8.0	–	10.0	–	12.0	13.0
	460/60/1	–	–	–	–	4.0	–	–	8.0	–	10.0	12.0	17.0	20.0
020	120/60/1	–	1.0	2.0	–	4.0	5.0	–	–	–	–	–	–	–
	208/60/1	–	0.8	1.6	–	3.3	–	4.9	6.5	8.2	9.0	–	–	–
	230/60/1	–	1.0	2.0	–	4.0	–	6.0	8.0	–	10.0	11.0	–	–
	277/60/1	–	1.0	2.0	–	4.0	–	6.0	8.0	–	10.0	–	12.0	13.0
	460/60/1	–	–	–	–	4.0	–	–	8.0	–	10.0	12.0	–	20.0
030	208/60/3	6.8	11.3	13.5	–	–	–	–	–	–	–	–	–	–
	240/60/3	9.0	15.0	18.0	–	–	–	–	–	–	–	–	–	–
	460/60/3	9.0	15.0	18.0	21.0	24.0	–	–	–	–	–	–	–	–
	575/60/3	9.0	15.0	18.0	21.0	24.0	–	–	–	–	–	–	–	–
040	208/60/3	6.8	11.3	13.5	–	–	–	–	–	–	–	–	–	–
	240/60/3	9.0	15.0	18.0	–	–	–	–	–	–	–	–	–	–
	460/60/3	9.0	15.0	18.0	21.0	24.0	30.0	36.0	39.0	–	–	–	–	–
	575/60/3	9.0	15.0	18.0	21.0	24.0	30.0	36.0	39.0	–	–	–	–	–
050	208/60/3	6.8	11.3	13.5	–	–	–	–	–	–	–	–	–	–
	240/60/3	9.0	15.0	18.0	–	–	–	–	–	–	–	–	–	–
	460/60/3	9.0	15.0	18.0	21.0	24.0	30.0	36.0	39.0	–	–	–	–	–
	575/60/3	9.0	15.0	18.0	21.0	24.0	30.0	36.0	39.0	–	–	–	–	–

Electric Heat kW Options

Table 31: Electric Heat kW Options by Unit Size

Unit Size	Voltage	Vertical kW												
006	120/60/1	-	1	2	-	4	-	-	-	-	-	-	-	-
	208/60/1	-	0.8	-	2.5	3.3	-	4.9	-	-	-	-	-	-
	230/60/1	-	1.0	-	3.0	4.0	-	6.0	-	-	-	-	-	-
	277/60/1	-	1.0	-	3.0	4.0	-	6.0	-	-	-	-	-	-
	460/60/1	-	1.0	-	3.0	-	-	6.0	-	-	-	-	-	-
008	120/60/1	-	1.0	2.0	-	4.0	-	-	-	-	-	-	-	-
	208/60/1	-	-	1.6	-	3.3	-	-	6.5	8.2	-	-	-	-
	230/60/1	-	-	2.0	-	4.0	-	-	8.0	-	10.0	-	-	-
	277/60/1	-	-	2.0	-	4.0	-	-	8.0	-	10.0	-	-	-
	460/60/1	-	-	2.0	-	4.0	5.0	-	8.0	-	10.0	-	-	-
012	120/60/1	-	-	2.0	-	4.0	-	-	-	-	-	-	-	-
	208/60/1	-	-	1.6	-	3.3	-	-	6.5	8.2	-	-	-	-
	230/60/1	-	-	2.0	-	4.0	-	-	8.0	-	10.0	-	-	-
	277/60/1	-	-	2.0	-	4.0	-	-	8.0	-	10.0	-	-	-
	460/60/1	-	-	2.0	-	4.0	5.0	-	8.0	-	10.0	-	-	-
016	120/60/1	-	-	2.0	-	4.0	-	-	-	-	-	-	-	-
	208/60/1	-	-	-	-	3.3	-	-	6.5	8.2	-	-	-	-
	230/60/1	-	-	-	-	4.0	-	-	8.0	-	10.0	-	-	-
	277/60/1	-	-	-	-	4.0	-	-	8.0	-	10.0	12.0	-	-
	460/60/1	-	-	-	-	4.0	-	-	8.0	-	10.0	12.0	-	-
020	120/60/1	-	-	2.0	-	4.0	-	-	-	-	-	-	-	-
	208/60/1	-	-	-	-	3.3	-	-	6.5	8.2	-	-	-	-
	230/60/1	-	-	-	-	4.0	-	-	8.0	-	10.0	-	-	-
	277/60/1	-	-	-	-	4.0	-	-	8.0	-	10.0	12.0	-	-
	460/60/1	-	-	-	-	4.0	-	-	8.0	-	10.0	12.0	-	20.0
030	208/60/3	6.8	11.3	13.5	-	-	-	-	-	-	-	-	-	-
	240/60/3	9.0	15.0	18.0	-	-	-	-	-	-	-	-	-	-
	460/60/3	9.0	15.0	-	21.0	24.0	-	-	-	-	-	-	-	-
	575/60/3	9.0	15.0	-	21.0	24.0	-	-	-	-	-	-	-	-
040	208/60/3	6.8	11.3	13.5	-	-	-	-	-	-	-	-	-	-
	240/60/3	9.0	15.0	18.0	-	-	-	-	-	-	-	-	-	-
	460/60/3	9.0	15.0	-	21.0	24.0	-	-	39.0	-	-	-	-	-
	575/60/3	9.0	15.0	-	21.0	24.0	-	-	39.0	-	-	-	-	-
050	208/60/3	6.8	11.3	13.5	-	-	-	-	-	-	-	-	-	-
	240/60/3	9.0	15.0	18.0	-	-	-	-	-	-	-	-	-	-
	460/60/3	9.0	15.0	-	21.0	24.0	-	-	39.0	-	-	-	-	-
	575/60/3	9.0	15.0	18.0	21.0	24.0	-	-	39.0	-	-	-	-	-

Electric Heat Heater Amps

Table 32: Horizontal Unit - Heater Amps

Horizontal Heater Amps											
kW	120V / 1Ø	230V / 1Ø	277V / 1Ø	460V / 1Ø	kW	240V / 3Ø	460V / 3Ø	575V / 3Ø	kW	208V/1Ø†	208V/3Ø†
0.5	4.17	2.17	1.81	–	0.5	1.20	0.63	0.50	0.41	1.97	–
1	8.33	4.35	3.61	2.17	1	2.41	1.26	1.00	0.82	3.94	–
2	16.67	8.70	7.22	4.35	2	4.81	2.51	2.01	1.64	7.88	–
3	25.00	13.04	10.83	6.52	3	7.22	3.77	3.01	2.45	11.78	–
4	33.33	17.39	14.44	8.70	4	9.62	5.02	4.02	3.27	15.72	–
5	41.67	21.74	18.05	10.87	5	12.03	6.28	5.02	4.09	19.66	–
6	–	26.09	21.66	13.04	6	14.43	7.53	6.02	4.91	23.61	–
8	–	34.78	28.88	17.39	8	19.25	10.04	8.03	6.54	31.44	–
9	–	–	–	–	9	21.65	11.30	9.04	6.80	–	35.38
10	–	43.48	–	21.74	10	24.06	12.55	10.04	8.18	39.33	–
11	–	47.83	39.71	–	11	26.46	13.81	11.04	9.00	43.27	–
12	–	–	43.32	26.09	12	28.87	15.06	12.05	9.81	47.16	–
13	–	–	46.93	–	13	31.27	16.32	13.05	10.63	51.11	–
15	–	–	–	–	15	36.08	18.83	15.06	11.30	–	54.33
18	–	–	–	39.13	18	43.30	22.59	18.07	13.50	–	64.90
21	–	–	–	45.65	21	–	26.36	21.09	–	–	–
24	–	–	–	–	24	–	30.12	24.10	–	–	–
30	–	–	–	–	30	–	37.65	30.12	–	–	–
36	–	–	–	–	36	–	45.18	36.15	–	–	–
39	–	–	–	–	39	–	48.95	39.16	–	–	–

Note: † Indicates that 208V single and three phase applications make use of a de-rated 230/240V heater.

Table 33: Vertical Unit - Heater Amps

Vertical Heater Amps											
kW	115V / 1Ø	230V / 1Ø	277V / 1Ø	480V / 1Ø	kW	240V / 3Ø	480V / 3Ø	600V / 3Ø	kW	208V / 1Ø†	208V / 3Ø†
1	8.7	4.3	3.6	2.1	1	-	-	-	0.82	3.9	-
2	17.4	8.7	7.2	4.2	2	-	-	-	1.64	7.9	-
3	-	13.0	10.8	6.3	3	-	-	-	2.45	11.8	-
4	34.8	17.4	14.4	8.3	4	-	-	-	3.27	15.7	-
5	-	-	-	10.87	5	-	-	-	4.09	19.7	-
6	-	26.1	21.7	12.5	6	-	-	-	4.91	23.6	-
8	-	34.8	28.9	16.7	8	-	-	-	6.54	31.5	-
9	-	-	-	-	9	21.7	10.8	8.7	6.80	-	18.8
10	-	43.5	36.1	20.83	10	-	-	-	8.18	39.3	-
12	-	-	43.3	25.0	12	-	-	-	-	-	-
15	-	-	-	-	15	36.1	18.0	14.4	11.3	-	31.3
18	-	-	-	-	18	43.3	-	-	13.5	-	37.5
19.2	-	-	-	40.0	19.2	-	-	-	-	-	-
21	-	-	-	-	21	-	25.3	20.2	-	-	-
24	-	-	-	-	24	-	28.9	23.1	-	-	-
39	-	-	-	-	39	-	46.9	37.5	-	-	-

Fan Curves

Figure 33: Fan Curve for Unit Size[s] 006-012

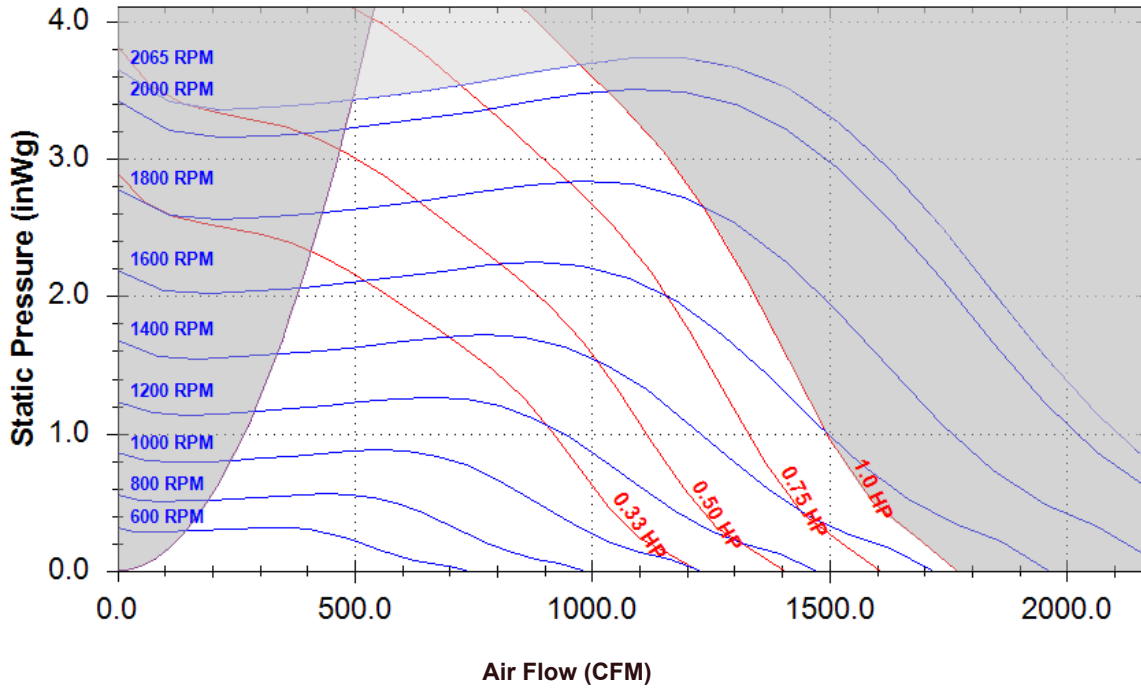


Figure 34: Fan Curve for Unit Size[s] 016-020

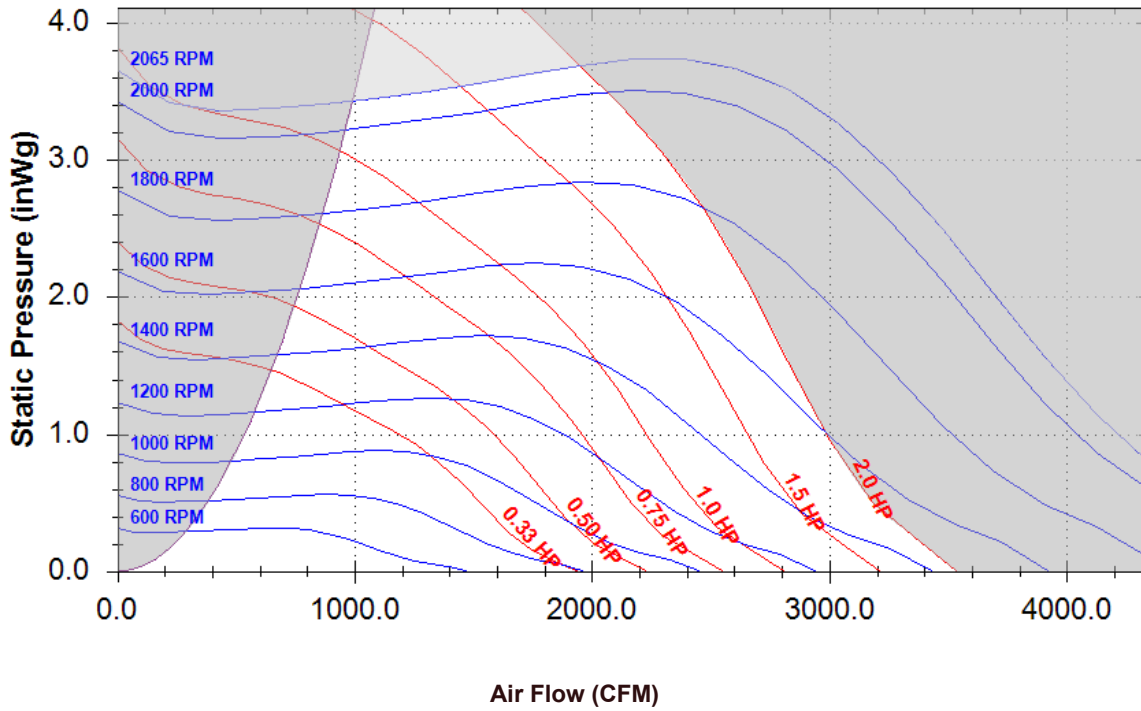


Figure 35: Fan Curve for Unit Size[s] 030



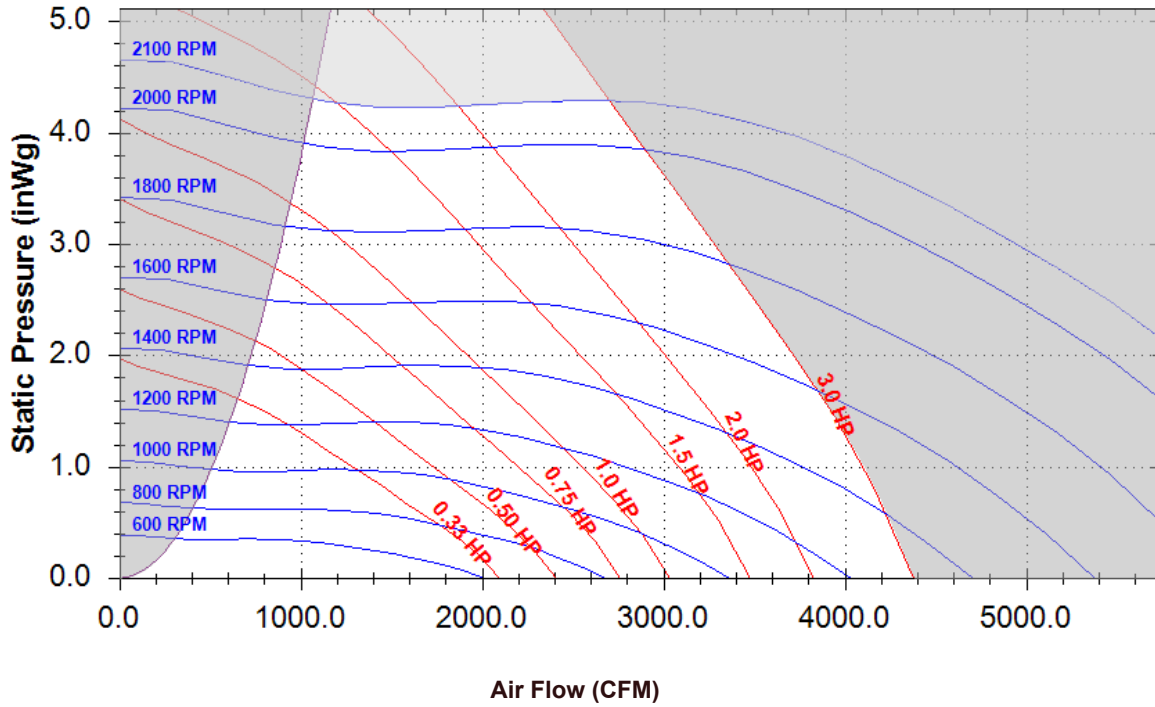


Figure 36: Fan Curve for Unit Size[s] 040-050

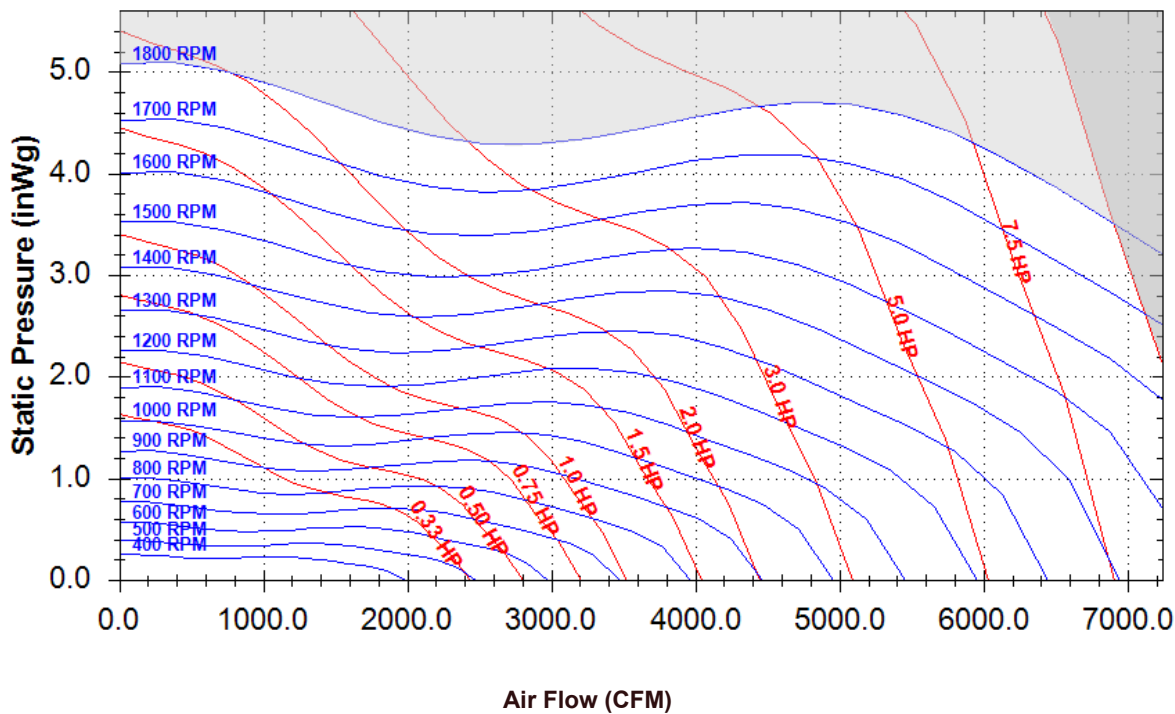

Unit Dimensions – Horizontal Unit Sizes 006-020

Figure 37: Left-Hand – Single and Dual Fan

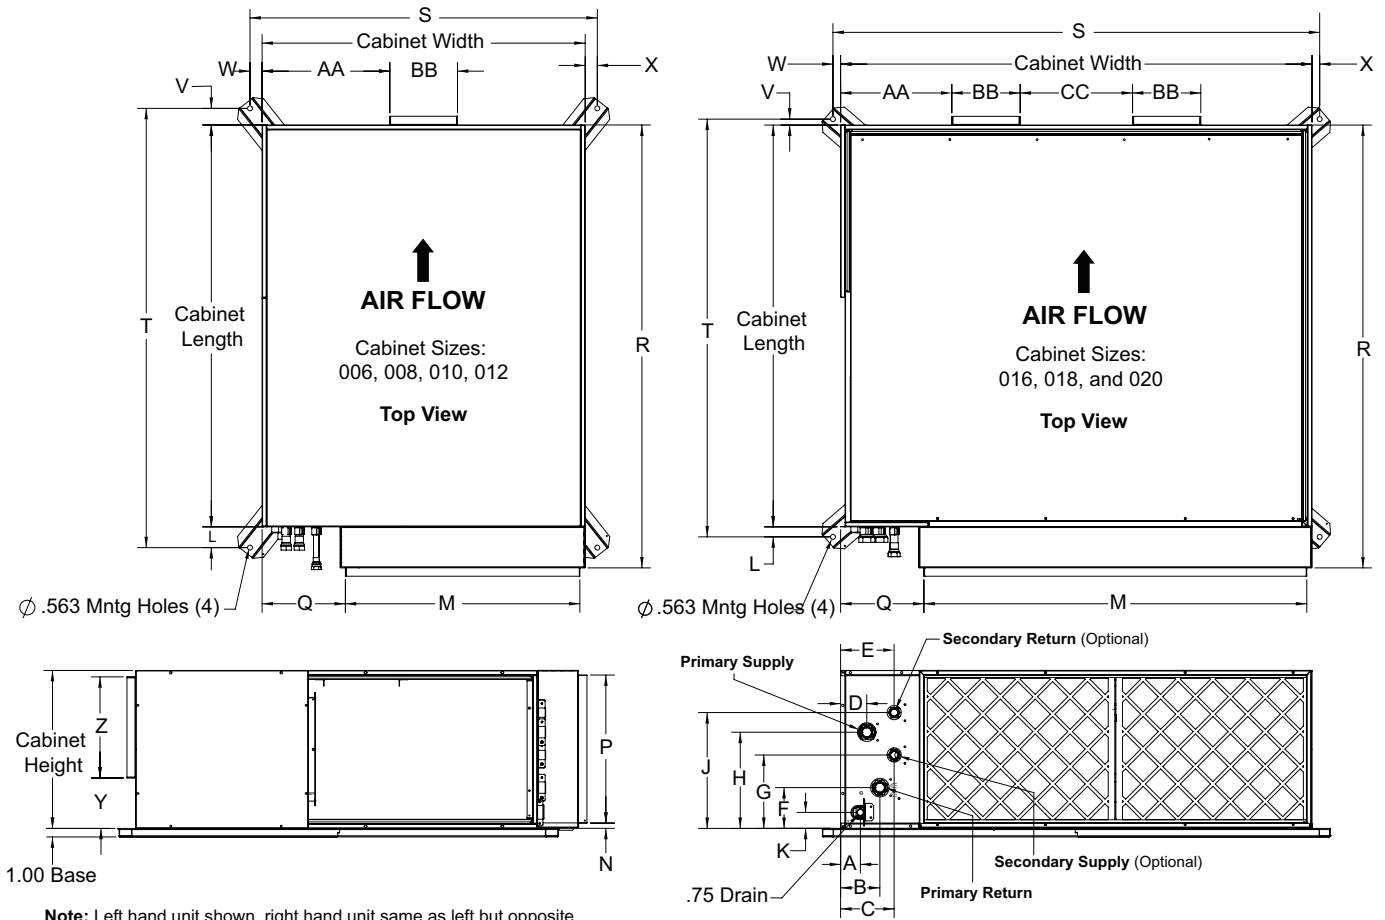

Note: Left hand unit shown, right hand unit same as left but opposite.

Overall Cabinet Dimensions


- 006 = 43L x 24W x 18H
- 008 = 43L x 29W x 18H
- 010 & 012 = 46L x 37W x 18H
- 016 = 46L x 45.5W x 18H
- 018 & 020 = 46L x 54W x 18H

Table 34: Dimension Letter Reference for Figure 37 on page 44

Dimension	006	008	010	012	016	018	020
A	2.26	2.28	2.18	2.18	2.60	2.25	2.25
B	4.01	4.51	4.26	4.26	4.52	4.50	4.50
C	5.75	6.45	6.24	6.24	6.15	6.19	6.19
D	2.51	3.00	2.76	2.76	3.02	3.00	3.00
E	5.75	6.42	6.24	6.24	6.15	6.15	6.15
F	5.45	5.42	4.67	4.67	4.67	4.67	4.67
G	7.42	7.40	8.13	8.13	8.38	8.38	8.38
H	11.03	10.77	11.15	11.15	11.03	11.03	11.03
J	13.85	13.32	13.26	13.26	13.27	13.27	13.27
K	1.83	1.80	1.83	1.83	1.83	1.83	1.83
L	1.70	1.38	2.42	2.42	1.79	1.18	1.18
M	11.61	16.61	26.87	26.87	35.27	43.87	43.87
N	0.67	0.59	0.60	0.60	0.60	0.60	0.60
P	16.97	16.97	16.97	16.97	16.97	16.97	16.97
Q	9.56	9.53	9.53	9.53	9.63	10.67	10.67
R Bottom Access	47.70	47.70	50.70	50.70	50.70	50.70	50.70
R Side Access	49.50	49.50	53.90	53.90	52.50	52.50	52.50
S	24.79	29.77	39.80	39.80	47.89	55.80	55.80
T	45.90	45.25	50.34	50.34	48.97	47.87	47.87
V	1.19	0.87	1.90	1.90	1.23	0.67	0.67
W	0.38	0.38	1.39	1.39	1.19	0.87	0.87
X	0.38	0.38	1.39	1.39	1.19	0.87	0.87
Y	5.77	5.77	5.77	5.77	5.77	5.77	5.77
Z	11.59	11.59	11.59	11.59	11.59	11.59	11.59
AA	8.13	10.63	14.63	14.63	9.24	12.74	12.74
BB	7.73	7.75	7.75	7.75	7.75	7.82	7.82
CC	0.00	0.00	0.00	0.00	11.53	12.88	12.88

Unit Dimensions – Vertical Unit Sizes 006-020

Figure 38: Left-Hand – Single and Dual Fan

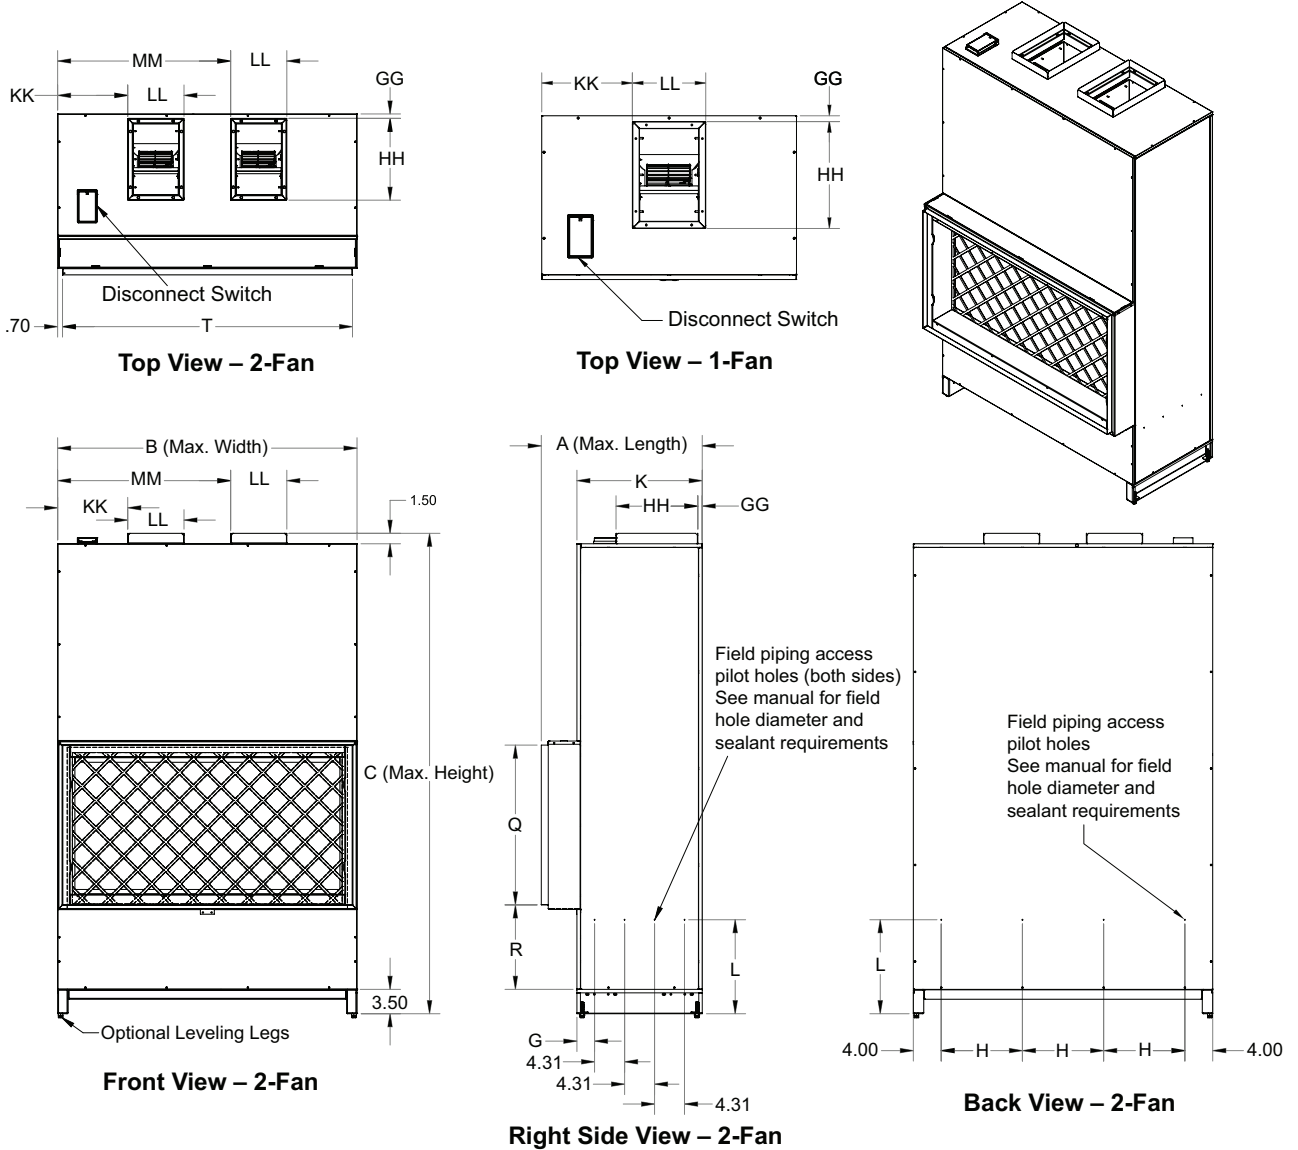

Note: Sizes 006 - 012 have 1 outlet while sizes 016-020 have 2

Table 35: Dimension Letter Reference

Internal Filter																				
Size	A	B	C	G	H	K	L	Q	R	S	U	V	W	X	MM	KK	LL	GG	HH	
006	18.00	25.00	60.00	2.54	5.65	N/A	13.50	15.88	11.50	3.50	10.86	4.76	2.81	2.85	N/A	8.47	8.06	0.63	11.75	
008	18.00	28.00	65.00	2.54	6.65	N/A	13.50	19.04	11.50	3.50	10.86	4.76	2.81	2.85	N/A	9.97	8.06	0.63	11.75	
012	18.00	31.50	67.00	2.54	7.83	N/A	13.50	21.75	11.50	3.50	10.86	4.76	2.81	2.85	N/A	11.72	8.06	0.63	11.75	
016	18.00	38.00	68.5	2.54	10.00	N/A	13.50	24.19	11.50	3.50	10.86	4.76	2.81	2.85	24.86	9.45	8.06	0.63	11.75	
020	18.00	43.00	69.00	2.54	11.65	N/A	13.50	24.19	11.50	3.50	10.86	4.76	2.81	2.85	24.86	10.08	8.06	0.63	11.75	
External Filter																				
Size	A	B	C	G	H	K	L	Q	R	S	T	U	V	W	X	MM	KK	LL	GG	HH
006	23.07	25.00	60.00	2.54	5.65	18.00	13.50	14.78	12.09	3.50	23.63	10.86	4.76	2.81	2.85	N/A	8.47	8.06	0.63	11.75
008	23.07	28.00	65.00	2.54	6.65	18.00	13.50	17.85	12.09	3.50	26.63	10.86	4.76	2.81	2.85	N/A	9.97	8.06	0.63	11.75
012	23.07	31.50	67.00	2.54	7.83	18.00	13.50	20.63	12.09	3.50	30.18	10.86	4.76	2.81	2.85	N/A	11.72	8.06	0.63	11.75
016	23.07	38.00	68.5	2.54	10.00	18.00	13.50	23.00	12.09	3.50	36.63	10.86	4.76	2.81	2.85	24.86	9.45	8.06	0.63	11.75
020	23.07	43.00	69.00	2.54	11.65	18.00	13.50	23.00	12.09	3.50	41.63	10.86	4.76	2.81	2.85	24.86	10.08	8.06	0.63	11.75

Unit Dimensions – Horizontal Unit Sizes 030-050

Figure 39: Left-Hand – Sizes 030, 040 and 050, Single Fan

Notes:

1. Refer to submittal drawings in Daikin SelectTools for piping connection dimensions.
2. Left hand unit shown, right hand unit values same as left but opposite.
3. Preheat option shown, reheat option viable.

Overall Cabinet Dimensions

- 030 = 38L x 49W x 26H
- 040 = 41L x 54W x 30H
- 050 = 41L x 61W x 32H

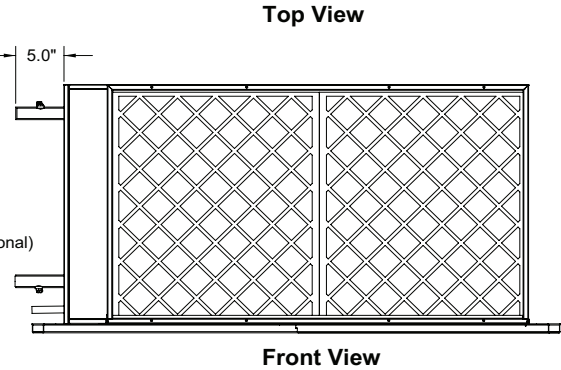
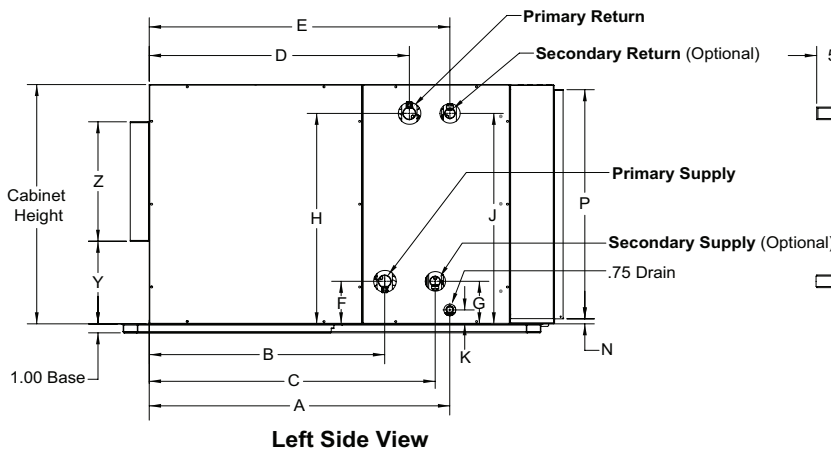
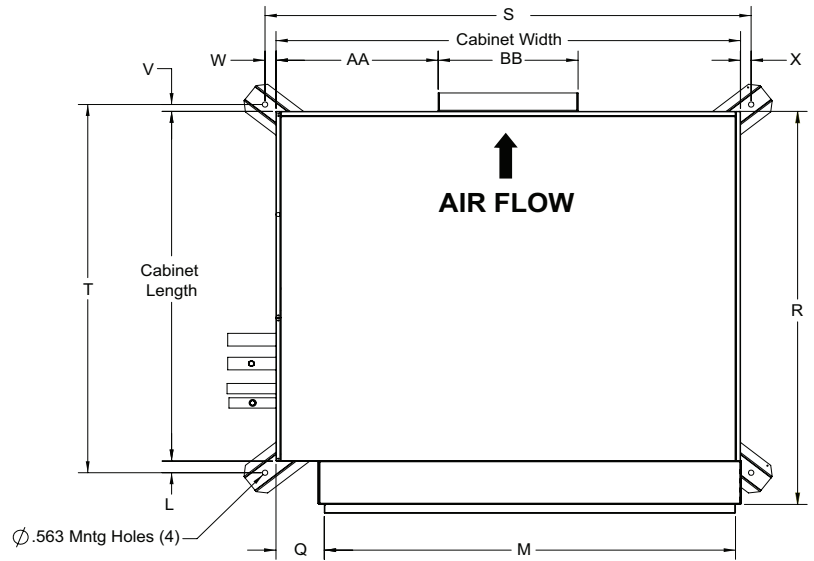


Table 36: Dimension Letter Reference for Hanger Brackets

Dimension	030	040	050
R Bottom Access	42.65	45.72	45.66
R Side Access	44.40	47.40	47.40
L	1.26	1.16	0.87
S	51.23	56.02	62.59
T	40.01	42.80	42.22
V	0.74	0.63	0.35
W	1.15	1.01	0.80
X	1.12	1.01	0.80

Table 37: Unit Dimensions

Unit Size	A	B	C	D	E	F	G	H	J	K	M	N	P	Q	Y	Z	AA	BB
2-Row Primary - Hydronic Connections																		
030	32.12	24.00	-	25.50	-	4.62	-	22.86	-	1.61	43.34	0.57	24.90	5.08	9.73	11.47	23.35	13.21
040	35.12	27.00	-	28.50	-	4.62	-	26.87	-	1.61	48.45	0.55	28.92	5.01	9.51	13.53	22.64	15.62
050	35.12	27.00	-	28.86	-	4.62	-	28.87	-	1.61	54.96	0.55	30.94	5.50	10.25	13.53	22.64	15.62
4-Row Primary - Hydronic Connections																		
030	32.12	24.00	-	26.50	-	4.62	-	22.86	-	1.61	43.34	0.57	24.90	5.08	9.73	11.47	23.35	13.21
040	35.12	27.87	-	30.43	-	4.62	-	26.87	-	1.61	48.45	0.55	28.92	5.01	9.51	13.53	22.64	15.62
050	35.12	27.12	-	29.68	-	4.62	-	28.87	-	1.61	54.96	0.55	30.94	5.50	10.25	13.53	22.64	15.62
6-Row Primary - Hydronic Connections																		
030	32.12	24.81	30.13	27.43	-	4.62	4.62	22.86	-	1.61	43.34	0.57	24.90	5.08	9.73	11.47	23.35	13.21
040	35.12	27.83	33.15	30.43	-	4.62	4.62	26.87	-	1.61	48.45	0.55	28.92	5.01	9.51	13.53	22.64	15.62
050	35.12	27.81	33.10	30.41	-	4.62	4.74	28.87	-	1.61	54.96	0.55	30.94	5.50	10.25	13.53	22.64	15.62
8-Row Primary - Hydronic Connections																		
030	32.1	24.81	-	29.16	-	4.61	-	22.86	-	1.61	43.34	0.57	24.90	5.08	9.73	11.47	23.35	13.21
040	35.1	27.83	-	32.16	-	4.62	-	26.87	-	1.61	48.45	0.55	28.92	5.01	9.51	13.53	22.64	15.62
050	35.1	27.79	-	32.12	-	4.62	-	28.87	-	1.61	54.96	0.55	30.94	5.50	10.25	13.53	22.64	15.62
2-Row Cooling with 1-Row Preheat - Hydronic Connections																		
030	32.00	24.00	30.13	25.50	31.50	4.62	4.62	22.86	22.86	1.61	43.34	0.57	24.90	5.08	9.73	11.47	23.35	13.21
040	35.12	27.00	33.12	28.50	34.50	4.62	4.62	26.87	26.87	1.61	48.45	0.55	28.92	5.01	9.51	13.53	22.64	15.62
050	35.12	27.00	33.87	29.00	35.44	4.62	4.62	28.87	28.87	1.61	54.96	0.55	30.94	5.50	10.25	13.53	22.64	15.62
4-Row Cooling with 1-Row Preheat - Hydronic Connections																		
030	32.00	24.00	30.13	26.56	31.50	4.62	4.62	22.86	22.86	1.61	43.34	0.57	24.90	5.08	9.73	11.47	23.35	13.21
040	35.12	27.87	33.12	30.50	34.50	4.62	4.62	26.87	26.87	1.61	48.45	0.55	28.92	5.01	9.51	13.53	22.64	15.62
050	35.12	27.00	33.87	29.68	35.31	4.62	4.62	28.87	28.87	1.61	54.96	0.55	30.94	5.50	10.25	13.53	22.64	15.62
6-Row Cooling with 1-Row Preheat - Hydronic Connections																		
030	32.00	24.81	30.13	27.41	31.50	4.62	4.62	22.86	22.86	1.61	43.34	0.57	24.90	5.08	9.73	11.47	23.35	13.21
040	35.12	27.87	33.12	30.50	34.50	4.62	4.62	26.87	26.87	1.61	48.45	0.55	28.92	5.01	9.51	13.53	22.64	15.62
050	35.12	27.87	33.82	30.37	35.25	4.62	4.62	28.87	28.87	1.61	54.96	0.55	30.94	5.50	10.25	13.53	22.64	15.62
2-Row Cooling with 2-Row Preheat - Hydronic Connections																		
030	32.00	24.00	30.13	25.50	31.50	4.62	4.62	22.86	22.86	1.61	43.34	0.57	24.90	5.08	9.73	11.47	23.35	13.21
040	35.12	27.00	33.12	28.50	34.50	4.62	4.62	26.87	26.87	1.61	48.45	0.55	28.92	5.01	9.51	13.53	22.64	15.62
050	35.12	27.00	33.87	29.00	35.44	4.62	4.62	28.87	28.87	1.61	54.96	0.55	30.94	5.50	10.25	13.53	22.64	15.62
4-Row Cooling with 2-Row Preheat - Hydronic Connections																		
030	32.00	24.00	30.13	26.56	31.50	4.62	4.62	22.86	22.86	1.61	43.34	0.57	24.90	5.08	9.73	11.47	23.35	13.21
040	35.12	27.87	33.12	30.50	34.50	4.62	4.62	26.87	26.87	1.61	48.45	0.55	28.92	5.01	9.51	13.53	22.64	15.62
050	35.12	27.00	33.87	29.68	35.31	4.62	4.62	28.87	28.87	1.61	54.96	0.55	30.94	5.50	10.25	13.53	22.64	15.62
6-Row Cooling with 2-Row Preheat - Hydronic Connections																		
030	32.00	24.81	30.13	27.41	31.50	4.62	4.62	22.86	22.86	1.61	43.34	0.57	24.90	5.08	9.73	11.47	23.35	13.21
040	35.12	27.87	33.12	30.50	34.50	4.62	4.62	26.87	26.87	1.61	48.45	0.55	28.92	5.01	9.51	13.53	22.64	15.62
050	35.12	27.87	33.82	30.37	35.25	4.62	4.62	28.87	28.87	1.61	54.96	0.55	30.94	5.50	10.25	13.53	22.64	15.62
2-Row Cooling with 1-Row Reheat - Hydronic Connections																		
030	32.00	24.00	28.12	25.12	29.62	4.62	4.62	22.86	22.86	1.61	43.34	0.57	24.90	5.08	9.73	11.47	23.35	13.21
040	35.12	27.00	31.12	28.50	32.67	4.62	4.62	26.87	26.87	1.61	48.45	0.55	28.92	5.01	9.51	13.53	22.64	15.62
050	35.12	27.68	31.12	29.12	33.00	4.62	4.62	28.87	28.87	1.61	54.96	0.55	30.94	5.50	10.25	13.53	22.64	15.62
4-Row Cooling with 1-Row Reheat - Hydronic Connections																		
030	32.00	24.00	28.12	25.12	30.69	4.62	4.62	22.86	22.86	1.61	43.34	0.57	24.90	5.08	9.73	11.47	23.35	13.21
040	35.12	27.00	32.00	28.50	34.62	4.62	4.62	26.87	26.87	1.61	48.45	0.55	28.92	5.01	9.51	13.53	22.64	15.62
050	35.12	27.68	31.25	29.12	33.82	4.62	4.62	28.87	28.87	1.61	54.96	0.55	30.94	5.50	10.25	13.53	22.64	15.62
6-Row Cooling with 1-Row Preheat - Hydronic Connections																		
030	32.00	24.00	29.00	25.12	31.50	4.62	4.62	22.86	22.86	1.61	43.34	0.57	24.90	5.08	9.73	11.47	23.35	13.21
040	35.12	27.00	32.00	28.25	34.62	4.62	4.62	26.87	26.87	1.61	48.45	0.55	28.92	5.01	9.51	13.53	22.64	15.62
050	35.12	27.75	33.87	30.43	35.31	4.62	4.62	28.87	28.87	1.61	54.96	0.55	30.94	5.50	10.25	13.53	22.64	15.62
2-Row Cooling with 2-Row Reheat - Hydronic Connections																		
030	32.00	24.00	28.12	25.12	29.62	4.62	4.62	22.86	22.86	1.61	43.34	0.57	24.90	5.08	9.73	11.47	23.35	13.21
040	35.12	27.00	33.12	28.50	34.50	4.62	4.62	26.87	26.87	1.61	48.45	0.55	28.92	5.01	9.51	13.53	22.64	15.62
050	35.12	27.68	31.12	29.12	33.00	4.62	4.62	28.87	28.87	1.61	54.96	0.55	30.94	5.50	10.25	13.53	22.64	15.62
4-Row Cooling with 2-Row Reheat - Hydronic Connections																		
030	32.00	24.00	28.12	25.12	30.69	4.62	4.62	22.86	22.86	1.61	43.34	0.57	24.90	5.08	9.73	11.47	23.35	13.21
040	35.12	27.00	31.12	28.50	32.62	4.62	4.62	26.87	26.87	1.61	48.45	0.55	28.92	5.01	9.51	13.53	22.64	15.62
050	35.12	27.68	31.25	29.12	33.82	4.62	4.62	28.87	28.87	1.61	54.96	0.55	30.94	5.50	10.25	13.53	22.64	15.62






6-Row Cooling with 2-Row Reheat - Hydronic Connections																		
030	32.00	24.00	29.00	25.12	31.50	4.62	4.62	22.86	22.86	1.61	43.34	0.57	24.90	5.08	9.73	11.47	23.35	13.21
040	35.12	27.00	32.00	28.25	34.62	4.62	4.62	26.87	26.87	1.61	48.45	0.55	28.92	5.01	9.51	13.53	22.64	15.62
050	35.12	27.75	33.87	30.43	35.31	4.62	4.62	28.87	28.87	1.61	54.96	0.55	30.94	5.50	10.25	13.53	22.64	15.62

Table 38: DX Connections – Sizes 030, 040 and 050, Dimension Letter Reference for Figure 39 on page 47

Unit Size	A	B	C	D	E	F	G	H	J	K	M	N	P	Q	Y	Z	AA	BB
Single Circuit DX Primary Only																		
030	32.10	25.69	-	-	-	4.35	-	-	-	1.61	43.34	0.57	24.90	5.08	9.73	11.47	23.35	13.21
040	35.10	28.71	-	-	-	4.35	-	-	-	1.61	48.45	0.55	28.92	5.01	9.51	13.53	22.64	15.62
050	35.10	28.69	-	-	-	4.35	-	-	-	1.61	54.96	0.55	30.94	5.50	10.25	13.53	22.64	15.62
Interlaced DX Primary Only																		
030	32.10	24.38	25.70	-	-	5.35	9.35	-	-	1.61	43.34	0.57	24.90	5.08	9.73	11.47	23.35	13.21
040	35.10	27.27	28.70	-	-	5.35	9.35	-	-	1.61	48.45	0.55	28.92	5.01	9.51	13.53	22.64	15.62
050	35.10	27.13	30.25	-	-	5.35	7.35	-	-	1.61	54.96	0.55	30.94	5.50	10.25	13.53	22.64	15.62
Single Circuit DX Primary with 1-Row Hydronic Reheat																		
030	32.10	23.95	29.83	25.04	-	4.61	4.35	22.86	-	1.61	43.34	0.57	24.90	5.08	9.73	11.47	23.35	13.21
040	35.10	26.97	32.85	28.29	-	5.65	4.39	25.38	-	1.61	48.45	0.55	28.92	5.01	9.51	13.53	22.64	15.62
050	35.10	27.68	32.84	29.13	-	4.62	4.35	28.87	-	1.61	54.96	0.55	30.94	5.50	10.25	13.53	22.64	15.62
Interlaced DX Primary with 1-Row Hydronic Reheat																		
030	32.10	23.88	28.45	25.09	29.76	4.61	5.35	22.86	9.35	1.61	43.34	0.57	24.90	5.08	9.73	11.47	23.35	13.21
040	35.10	26.97	31.41	28.29	32.85	5.62	5.35	25.37	9.35	1.61	48.45	0.55	28.92	5.01	9.51	13.53	22.64	15.62
050	35.10	27.68	31.27	29.13	34.40	4.62	5.35	28.87	7.35	1.61	54.96	0.55	30.94	5.50	10.25	13.53	22.64	15.62
Single Circuit DX Primary with 2-Row Hydronic Reheat																		
030	32.10	23.88	29.76	25.42	-	4.62	4.35	22.87	-	1.61	43.34	0.57	24.90	5.08	9.73	11.47	23.35	13.21
040	35.10	26.97	32.85	28.52	-	4.62	4.35	26.87	-	1.61	48.45	0.55	28.92	5.01	9.51	13.53	22.64	15.62
050	35.10	26.90	32.83	29.24	-	4.62	4.35	28.87	-	1.61	54.96	0.55	30.94	5.50	10.25	13.53	22.64	15.62
Interlaced DX Primary with 2-Row Hydronic Reheat																		
030	32.10	23.88	28.45	25.43	29.76	4.62	5.35	22.87	9.35	1.61	43.34	0.57	24.90	5.08	9.73	11.47	23.35	13.21
040	35.10	26.97	31.41	28.52	32.85	4.62	5.35	26.87	9.35	1.61	48.45	0.55	28.92	5.01	9.51	13.53	22.64	15.62
050	35.10	26.90	31.26	29.24	34.39	4.62	5.35	28.87	7.35	1.61	54.96	0.55	30.94	5.50	10.25	13.53	22.64	15.62
Single Circuit Dx Primary with 1 Row Hydronic Preheat																		
030	32.10	25.69	30.16	-	31.24	4.35	4.62	-	22.87	1.61	43.34	0.57	24.90	5.08	9.73	11.47	23.35	13.21
040	35.10	28.69	33.16	-	34.48	4.35	5.62	-	25.37	1.61	48.45	0.55	28.92	5.01	9.51	13.53	22.64	15.62
050	35.10	28.69	33.87	-	35.32	4.35	4.62	-	28.87	1.61	54.96	0.55	30.94	5.50	10.25	13.53	22.64	15.62
Interlaced DX Primary with 1-Row Hydronic Preheat																		
030	32.10	24.30	30.07	25.62	31.28	5.35	4.62	9.35	22.87	1.61	43.34	0.57	24.90	5.08	9.73	11.47	23.35	13.21
040	35.10	27.26	33.16	28.70	34.48	5.35	5.62	9.35	25.37	1.61	48.45	0.55	28.92	5.01	9.51	13.53	22.64	15.62
050	35.10	27.13	33.87	30.25	35.32	5.35	4.62	7.35	28.87	1.61	54.96	0.55	30.94	5.50	10.25	13.53	22.64	15.62
Single Circuit DX Primary with 2-Row Hydronic Preheat																		
030	32.10	25.61	30.07	-	31.61	4.35	4.65	-	22.87	1.61	43.34	0.57	24.90	5.08	9.73	11.47	23.35	13.21
040	35.10	28.70	33.16	-	34.70	4.35	4.62	-	26.87	1.61	48.45	0.55	28.92	5.01	9.51	13.53	22.64	15.62
050	35.10	28.68	33.09	-	35.43	4.35	4.62	-	28.87	1.61	54.96	0.55	30.94	5.50	10.25	13.53	22.64	15.62
Interlaced DX Primary with 2-Row Hydronic Preheat																		
030	32.10	24.30	30.07	25.61	31.61	5.35	4.62	9.35	22.87	1.61	43.34	0.57	24.90	5.08	9.73	11.47	23.35	13.21
040	35.10	27.26	33.16	28.70	34.70	5.35	4.62	9.35	26.87	1.61	48.45	0.55	28.92	5.01	9.51	13.53	22.64	15.62
050	35.10	27.12	33.09	30.24	35.43	5.35	4.62	7.35	28.87	1.61	54.96	0.55	30.94	5.50	10.25	13.53	22.64	15.62

Unit Dimensions – Vertical Unit Sizes 030-050

Figure 40: Size 030-050 Vertical Drawing Dimensions

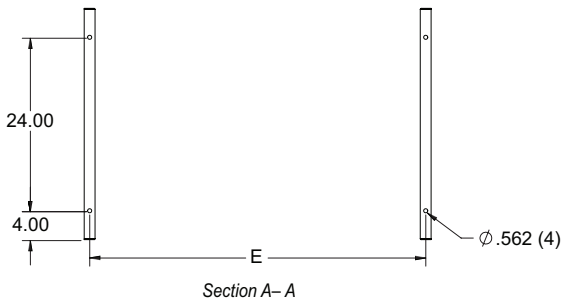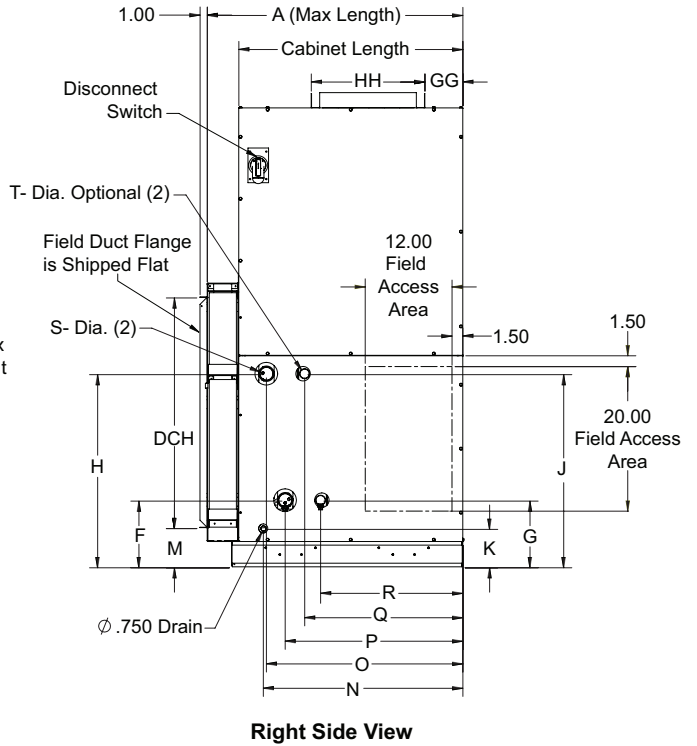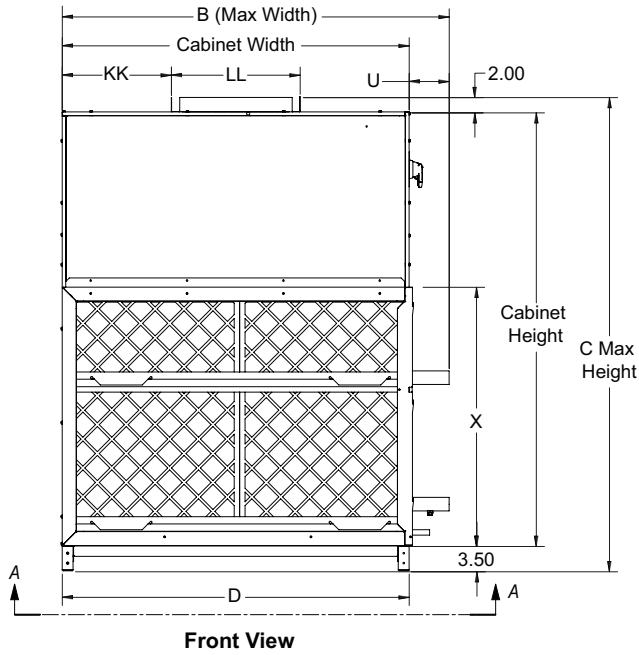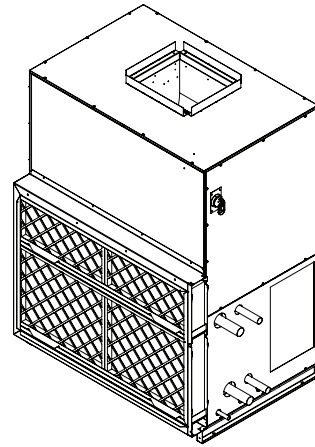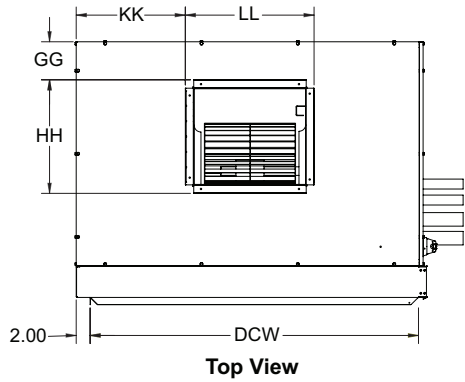

Cabinet Mounting Hole Locations

Note:
Right Hand Cabinet Shown, Left Hand Similar But Opposite

Table 39: General Vertical Unit Dimensions

	Length	width	height										
	A	B	C	D	E	U	X	KK	LL	GG	HH	DCH	DCW
SIZE 30	35.36	49.5	61.5	44	42.5	5.54	30.49	12.3	15.32	5.29	13.66	24.5	38
SIZE 40	35.36	53.5	65.5	48	46.5	6	34.49	15.09	17.82	5.25	15.72	31.88	45.44
SIZE 50	35.36	53.5	73.5	48	46.5	6	42.49	15.09	17.82	5.25	15.72	39.88	45.44

Table 40: Vertical Coil Dimensions

8 Row Coil RH (Cooling)													
	K	F	H	G	J	M	N	O	P	Q	R	S	T
SIZE 30	5.3	9.22	22.72	-	-	7.74	27.6	25.99	21.65	-	-	1.625	-
SIZE 40	5.3	9.22	26.72	-	-	5.42	27.59	25.98	21.65	-	-	1.875	-
SIZE 50	5.31	9.22	34.72	-	-	5.42	27.59	25.98	21.65	-	-	2.125	-
6 Row Coil RH (Cooling)													
	K	F	H	G	J	M	N	O	P	Q	R	S	T
SIZE 30	5.3	9.22	22.72	-	-	7.74	27.6	27.12	24.57	-	-	1.625	-
SIZE 40	5.3	9.22	26.72	-	-	5.42	27.59	27.17	24.57	-	-	1.625	-
SIZE 50	5.31	9.22	34.72	-	-	5.42	27.59	27.17	24.57	-	-	2.125	-
4 Row Coil RH (Cooling)													
	K	F	H	G	J	M	N	O	P	Q	R	S	T
SIZE 30	5.3	9.22	22.72	-	-	7.74	27.6	27.12	24.57	-	-	1.375	-
SIZE 40	5.3	9.22	26.72	-	-	5.42	27.59	27.17	24.57	-	-	1.625	-
SIZE 50	5.31	9.22	34.72	-	-	5.42	27.59	27.17	24.57	-	-	2.125	-
2 Row Coil RH (Cooling)													
	K	F	H	G	J	M	N	O	P	Q	R	S	T
SIZE 30	5.3	9.22	22.72	-	-	7.74	27.59	27.12	24.63	-	-	1.125	-
SIZE 40	5.3	9.22	26.72	-	-	5.42	27.59	27.17	24.57	-	-	1.375	-
SIZE 50	5.3	9.22	34.72	-	-	5.42	27.59	27.17	24.57	-	-	2.125	-
6 + 1 Rows Coil RH (Re-heat)													
	K	F	H	G	J	M	N	O	P	Q	R	S	T
SIZE 30	5.3	9.22	22.72	9.22	22.72	7.74	27.6	27.12	24.57	21.89	19.68	1.625	0.625
SIZE 40	5.3	9.22	26.72	9.22	26.72	5.42	27.59	27.17	24.57	21.89	19.68	1.625	0.875
SIZE 50	5.31	9.22	34.72	9.22	34.72	5.42	27.59	27.17	24.57	21.89	19.69	2.125	1.375
4 + 1 Rows Coil RH (Re-heat)													
	K	F	H	G	J	M	N	O	P	Q	R	S	T
SIZE 30	5.3	9.22	22.72	9.22	22.72	7.74	27.6	27.12	24.57	21.89	19.68	1.375	0.625
SIZE 40	5.3	9.22	26.72	9.22	26.72	5.42	27.59	27.17	24.57	21.89	19.68	1.625	0.875
SIZE 50	5.31	9.22	34.72	9.22	34.72	5.42	27.59	27.17	24.57	21.89	19.69	2.125	1.375
2 + 1 Rows Coil RH (Re-heat)													
	K	F	H	G	J	M	N	O	P	Q	R	S	T
SIZE 30	5.3	9.22	22.72	9.22	22.72	7.74	27.6	27.1	24.63	21.89	19.68	1.125	0.625
SIZE 40	5.3	9.22	26.72	9.22	26.72	5.42	27.59	27.17	24.57	21.89	19.68	1.375	0.875
SIZE 50	5.3	9.22	34.72	9.22	34.72	5.42	27.59	27.17	24.57	21.89	19.69	2.125	1.375
6 + 2 Rows Coil RH (Re-heat)													
	K	F	H	G	J	M	N	O	P	Q	R	S	T
SIZE 30	5.3	9.22	22.72	9.22	22.72	7.74	27.6	27.12	24.57	22.02	19.55	1.625	1.125
SIZE 40	5.3	9.22	26.72	9.22	26.72	5.42	27.59	27.17	24.57	22.09	19.49	1.625	1.375
SIZE 50	5.31	9.22	34.72	9.22	34.72	5.42	27.59	27.17	24.57	22.09	19.5	2.125	1.375
4 + 2 Rows Coil RH (Re-heat)													
	K	F	H	G	J	M	N	O	P	Q	R	S	T
SIZE 30	5.3	9.22	22.72	9.22	22.72	7.74	27.6	27.12	24.57	22.02	19.55	1.375	1.125
SIZE 40	5.3	9.22	26.72	9.22	26.72	5.42	27.59	27.17	24.57	22.09	19.49	1.625	1.375
SIZE 50	5.31	9.22	34.72	9.22	34.72	5.42	27.59	27.17	24.57	22.09	19.5	2.125	1.375
2 + 2 Rows Coil RH (Re-heat)													
	K	F	H	G	J	M	N	O	P	Q	R	S	T
SIZE 30	5.3	9.22	22.72	9.22	22.72	7.74	27.6	27.1	24.63	22.02	19.55	1.125	1.125
SIZE 40	5.3	9.22	26.72	9.22	26.72	5.42	27.59	27.17	24.57	22.09	19.49	1.375	1.375
SIZE 50	5.3	9.22	34.72	9.22	34.72	5.42	27.59	27.17	24.57	22.09	19.5	2.125	1.125
1 + 6 Rows Coil RH (Pre-heat)													
	K	F	H	G	J	M	N	O	P	Q	R	S	T
SIZE 30	5.3	9.22	22.72	9.22	22.72	7.74	27.6	27.95	25.75	23.07	20.47	1.625	0.625
SIZE 40	5.3	9.22	26.72	9.22	26.72	5.42	27.59	27.95	25.75	23.07	20.47	1.625	0.875
SIZE 50	5.3	9.22	34.72	9.22	34.72	5.42	27.95	27.59	25.75	23.07	20.47	2.125	1.375

1 + 4 Rows Coil RH (Pre-heat)													
	K	F	H	G	J	M	N	O	P	Q	R	S	T
SIZE 30	5.3	9.22	22.72	9.22	22.72	7.74	27.6	27.95	25.75	23.07	20.47	1.375	0.625
SIZE 40	5.3	9.22	26.72	9.22	26.72	5.42	27.59	27.95	25.75	23.07	20.47	1.625	0.875
SIZE 50	5.3	9.22	34.72	9.22	34.72	5.42	28.15	27.59	25.56	23.07	20.47	2.125	1.375
1 + 2 Rows Coil RH (Pre-heat)													
	K	F	H	G	J	M	N	O	P	Q	R	S	T
SIZE 30	5.3	9.22	22.72	9.22	22.72	7.74	27.6	27.95	25.75	23	20.53	1.125	0.625
SIZE 40	5.3	9.22	26.72	9.22	26.72	5.42	27.59	27.95	25.75	23.07	20.47	1.375	0.875
SIZE 50		9.22	34.72	9.22	34.72	5.42	28.15	27.59	25.56	23.07	20.47	2.125	1.375
2 + 6 Rows Coil RH (Pre-heat)													
	K	F	H	G	J	M	N	O	P	Q	R	S	T
SIZE 30	5.3	9.22	22.72	9.22	22.72	7.74	27.6	28.09	25.61	23.07	20.47	1.625	1.125
SIZE 40	5.3	9.22	26.72	9.22	26.72	5.42	27.59	28.15	25.55	23.07	20.47	1.625	1.375
SIZE 50	5.3	9.22	34.72	9.22	34.72	5.42	28.15	27.59	25.56	23.07	20.47	2.125	1.375
2 + 4 Rows Coil RH (Pre-heat)													
	K	F	H	G	J	M	N	O	P	Q	R	S	T
SIZE 30	5.3	9.22	22.72	9.22	22.72	7.74	27.6	28.09	25.61	23.07	20.47	1.375	1.125
SIZE 40	5.3	9.22	26.72	9.22	26.72	5.42	27.59	28.15	25.55	23.07	20.47	1.625	1.375
SIZE 50	5.3	9.22	34.72	9.22	34.72	5.42	28.15	27.59	25.56	23.07	20.47	2.125	1.375
2 + 2 Rows Coil RH (Pre-heat)													
	K	F	H	G	J	M	N	O	P	Q	R	S	T
SIZE 30	5.3	9.22	22.72	9.22	22.72	7.74	27.6	28.09	25.61	23	20.53	1.125	1.125
SIZE 40	5.3	9.22	26.72	9.22	26.72	5.42	27.59	28.15	25.55	23.07	20.47	1.375	1.375
SIZE 50	5.3	9.22	34.72	9.22	34.72	5.42	28.15	27.59	25.56	23.07	20.47	2.125	1.375
1 + DX SINGLE 3 ROWS COIL RH (RE-HEAT)													
	K	F	H	G	J	M	N	O	P	Q	R	S	T
SIZE 30	5.3	9.84	-	9.22	22.72	7.74	27.59	-	26.73	21.89	19.68	1.625	-
SIZE 40	5.3	9.84	-	9.22	26.72	5.42	27.59	-	26.73	21.89	19.68	1.625	-
SIZE 50	5.3	9.84	-	9.22	34.72	5.42	27.59	-	26.73	21.89	19.69	1.625	-
2 + DX SINGLE 3 ROWS COIL RH (RE-HEAT)													
	K	F	H	G	J	M	N	O	P	Q	R	S	T
SIZE 30	5.3	9.84	-	9.22	22.72	7.74	27.59	-	26.73	22.02	19.55	1.625	-
SIZE 40	5.3	9.84	-	9.22	26.72	5.42	27.59	-	26.73	22.09	19.49	1.625	-
SIZE 50	5.3	9.84	-	9.22	34.72	5.42	27.59	-	26.73	22.09	19.5	1.625	-
DX SINGLE 6 ROWS COIL RH (RE-HEAT)													
	K	F	H	G	J	M	N	O	P	Q	R	S	T
SIZE 30	-	-	-	-	-	7.74	-	-	-	-	-	-	-
SIZE 40	-	-	-	-	-	5.42	-	-	-	-	-	-	-
SIZE 50	-	-	-	-	-	5.42	-	-	-	-	-	-	-
1 + DX INTERLACE 3 ROWS COIL RH (RE-HEAT)													
	K	F	H	G	J	M	N	O	P	Q	R	S	T
SIZE 30	5.3	9.84	14.47	9.22	22.72	7.74	27.59	27.56	25.42	21.89	19.68	0.875	-
SIZE 40	5.3	10.47	11.84	9.22	26.72	5.42	27.59	27.69	25.14	21.89	19.68	1.375	-
SIZE 50	5.3	10.47	11.84	9.22	34.72	5.42	27.59	27.72	25.17	21.89	19.69	1.375	-
2 + DX INTERLACE 3 ROWS COIL RH (RE-HEAT)													
	K	F	H	G	J	M	N	O	P	Q	R	S	T
SIZE 30	5.3	9.84	14.47	9.22	22.72	7.74	27.59	27.56	25.42	22.02	19.55	0.875	-
SIZE 40	5.3	10.47	11.84	9.22	26.72	5.42	27.59	27.69	25.14	22.09	19.49	1.375	-
SIZE 50	5.3	10.47	11.84	9.22	34.72	5.42	27.59	27.72	25.17	22.09	19.5	1.375	-
1 + DX INTERLACE 6 ROWS COIL RH (RE-HEAT)													
	K	F	H	G	J	M	N	O	P	Q	R	S	T
SIZE 30	5.3	10.47	14.22	9.22	22.72	7.74	27.59	27.12	24.97	21.89	19.68	1.125	-
SIZE 40	5.3	8.84	10.47	9.22	26.72	5.42	27.59	27.03	24.85	21.89	19.68	1.325	-
SIZE 50	5.3	10.47	10.47	9.22	34.72	5.42	27.59	26.73	24.61	21.89	19.69	1.625	-
2 + DX INTERLACE 6 ROWS COIL RH (RE-HEAT))													
	K	F	H	G	J	M	N	O	P	Q	R	S	T
SIZE 30	5.3	10.47	14.22	9.22	22.72	7.74	27.59	27.12	24.97	22.02	19.55	1.125	-
SIZE 40	5.3	8.84	10.47	9.22	26.72	5.42	27.59	27.03	24.85	22.09	19.49	1.325	-
SIZE 50	5.3	10.47	10.47	9.22	34.72	5.42	27.59	26.73	24.61	22.09	19.5	1.625	-

1 + DX SINGLE 3 ROWS COIL RH (PRE-HEAT)													
	K	F	H	G	J	M	N	O	P	Q	R	S	T
SIZE 30	5.3	9.22	22.72	-	9.84	7.74	27.59	27.95	25.75	22.64	-	1.125	-
SIZE 40	5.3	9.22	26.72	-	9.84	5.42	27.59	27.95	25.75	22.64	-	0.875	-
SIZE 50	5.3	9.22	34.72	-	9.84	5.42	27.59	27.59	25.75	22.64	-	1.375	-
2 + DX SINGLE 3 ROWS COIL RH (PRE-HEAT)													
	K	F	H	G	J	M	N	O	P	Q	R	S	T
SIZE 30	5.3	9.22	22.72	-	9.84	7.74	27.59	28.09	25.61	22.64	-	1.125	-
SIZE 40	5.3	9.22	26.72	-	9.84	5.42	27.59	28.15	25.55	22.64	-	0.875	-
SIZE 50	5.3	9.22	34.72	-	9.84	5.42	27.59	27.59	25.56	22.64	-	1.375	-
DX SINGLE 6 ROWS COIL RH (PRE-HEAT)													
	K	F	H	G	J	M	N	O	P	Q	R	S	T
SIZE 30	-	-	-	-	-	-	-	-	-	-	-	-	-
SIZE 40	-	-	-	-	-	-	-	-	-	-	-	-	-
SIZE 50	-	-	-	-	-	-	-	-	-	-	-	-	-
1 + DX INTERLACE 3 ROWS COIL RH (PRE-HEAT)													
	K	F	H	G	J	M	N	O	P	Q	R	S	T
SIZE 30	5.31	9.22	22.72	9.84	14.47	7.74	27.59	27.95	25.75	23.46	21.32	0.625	0.875
SIZE 40	5.31	9.22	26.72	11.84	10.47	5.42	27.59	27.95	25.75	23.62	21.07	0.875	1.375
SIZE 50	5.31	9.22	34.72	11.84	10.47	5.42	27.59	27.59	25.75	23.62	21.07	1.375	1.375
2 + DX INTERLACE 3 ROWS COIL RH (PRE-HEAT)													
	K	F	H	G	J	M	N	O	P	Q	R	S	T
SIZE 30	5.31	9.22	22.72	9.84	14.47	7.74	27.59	28.09	25.61	23.46	21.32	0.625	0.875
SIZE 40	5.31	9.22	26.72	11.84	10.47	5.42	27.59	28.15	25.55	23.62	21.07	0.875	1.375
SIZE 50	5.31	9.22	34.72	11.84	10.47	5.42	27.59	27.59	25.56	23.62	21.07	1.375	1.375
1 + DX INTERLACE 6 ROWS COIL RH (PRE-HEAT)													
	K	F	H	G	J	M	N	O	P	Q	R	S	T
SIZE 30	5.31	9.22	22.72	9.84	14.47	7.74	27.59	27.95	25.75	23.46	21.32	0.625	0.875
SIZE 40	5.31	9.22	26.72	11.84	10.47	5.42	27.59	27.95	25.75	23.62	21.07	0.875	1.375
SIZE 50	5.31	9.22	34.72	11.84	10.47	5.42	27.59	27.59	25.75	23.62	21.07	1.375	1.375
2 + DX INTERLACE 6 ROWS COIL RH (PRE-HEAT)													
	K	F	H	G	J	M	N	O	P	Q	R	S	T
SIZE 30	5.31	9.22	22.72	9.84	14.47	7.74	27.59	28.09	25.61	23.46	21.32	0.625	0.875
SIZE 40	5.31	9.22	26.72	11.84	10.47	5.42	27.59	28.15	25.55	23.62	21.07	0.875	1.375
SIZE 50	5.31	9.22	34.72	11.84	10.47	5.42	27.59	27.59	25.56	23.62	21.07	1.375	1.375
Steam Coils													
	K	F	H	G	J	M	N	O	P	Q	R	S	T
SIZE 30	5.31	-	-	9.67	21.71	-	-	-	-	25.72	28.03	-	1.125
SIZE 40	5.31	-	-	9.58	23.71	-	-	-	-	25.72	28.03	-	1.125
SIZE 50	5.31	-	-	9.84	27.71	-	-	-	-	25.82	27.97	-	1.375

Mixing Box Dimensions

Figure 41: Horizontal Mixing Box – Top and End Damper, Left Hand Sizes 006–020 and Right Hand Sizes 030–050 – Side Filter Access

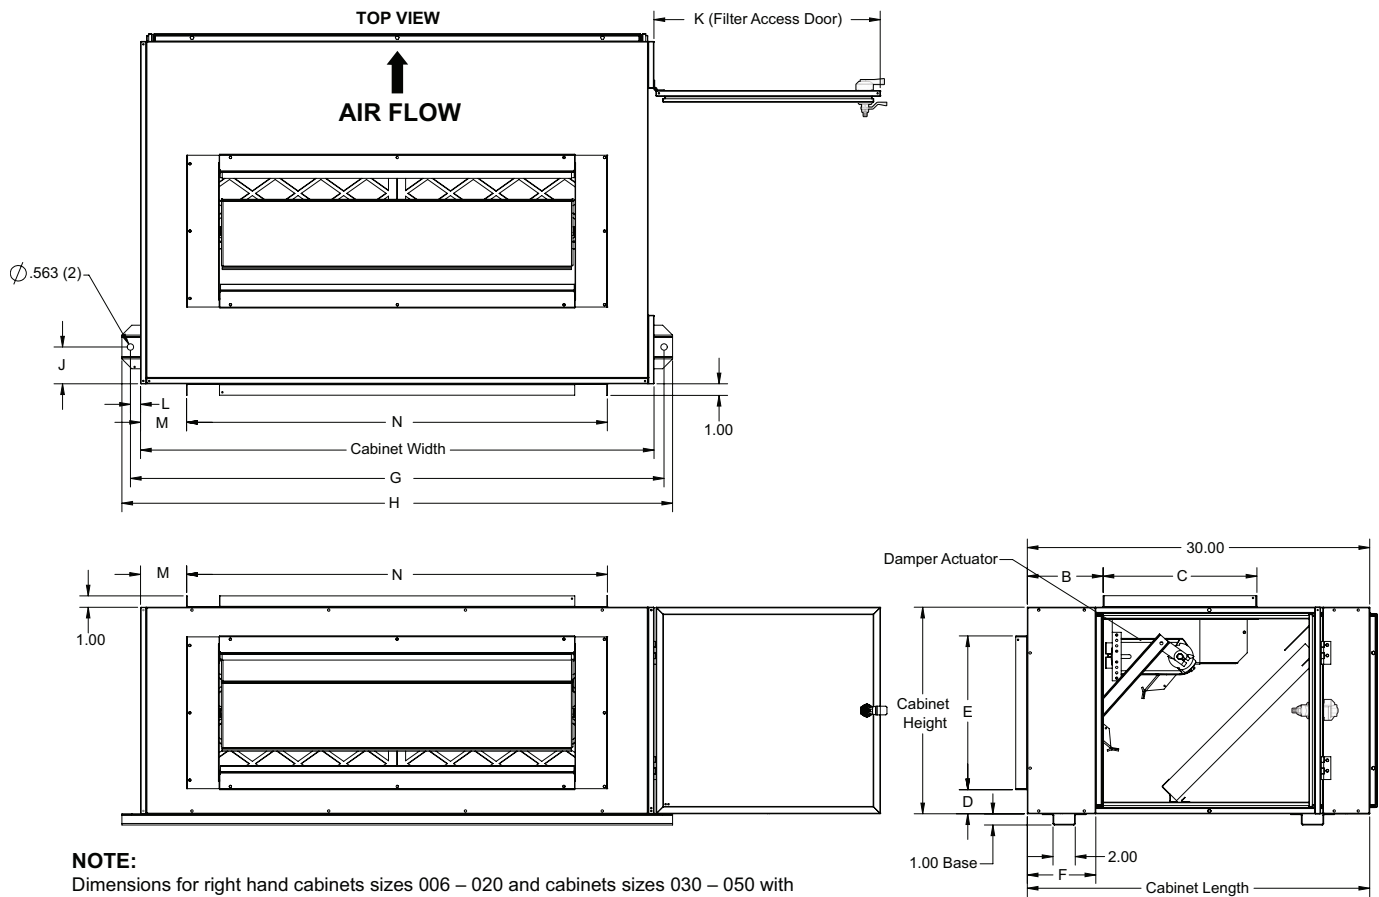


Table 41: Mixing Box Dimension Letter Reference for Figure 41

Cabinet	006	008	010	012	016	018	020	030	040	050
B	6.64	6.64	6.64	6.64	6.64	6.64	6.64	5.54	5.54	5.54
C	13.47	13.47	13.47	13.47	13.47	13.47	13.47	18.39	18.39	18.39
D	2.11	2.11	2.11	2.11	2.11	2.11	2.11	3.80	5.80	6.80
E	13.47	13.47	13.47	13.47	13.47	13.47	13.47	18.39	18.39	18.39
F	6.12	6.12	6.12	6.12	6.12	6.12	6.12	14.06	14.06	14.06
G	16.75	21.75	29.75	29.75	38.25	46.75	46.75	51.00	56.00	63.00
H	18.25	23.25	31.25	31.25	39.75	48.25	48.25	52.50	57.50	64.50
J	3.22	3.22	3.22	3.22	3.22	3.22	3.22	3.22	3.22	3.22
K	19.75	19.75	19.75	19.75	19.75	19.75	19.75	14.75	14.75	14.75
L	0.87	0.87	0.87	0.87	0.87	0.87	0.87	1.00	1.00	1.00
M	0.98	2.66	2.29	2.29	2.80	4.04	4.04	6.32	3.82	2.82
N	10.18	14.66	23.41	30.90	30.90	36.87	36.87	36.34	46.34	55.34

Figure 42: Vertical Mixing Box - Top and End Damper. Sizes 030-050 - Side Filter Access.

Table 42: Mixing Box Dimension Letter Reference

Mixing Box	Vertical Mixing Box																	
	A	B	C	D	I	J	K	L	M	N	O	P	Q	R	S	T	W	X
910298850																		
SIZE 30	5.5	24	42.5	44	26.31	33	2.87	38.27	3.5	9.82	18.37	31	34.5	36.76	70.12	34	18.37	14.19
SIZE 40	5.5	24	46.5	48	26.31	33	2.87	42.31	3.5	11.82	18.37	35	38.5	40.76	74.12	34	18.37	14.19
SIZE 50	5.5	24	46.5	48	26.31	33	2.87	42.31	3.5	15.82	18.37	43	46.5	48.76	74.12	34	18.37	14.19

Figure 43: Horizontal Mixing Box – Bottom and End Damper, Left Hand Sizes 006–020 and Right Hand Sizes 030–050 – Side Filter Access

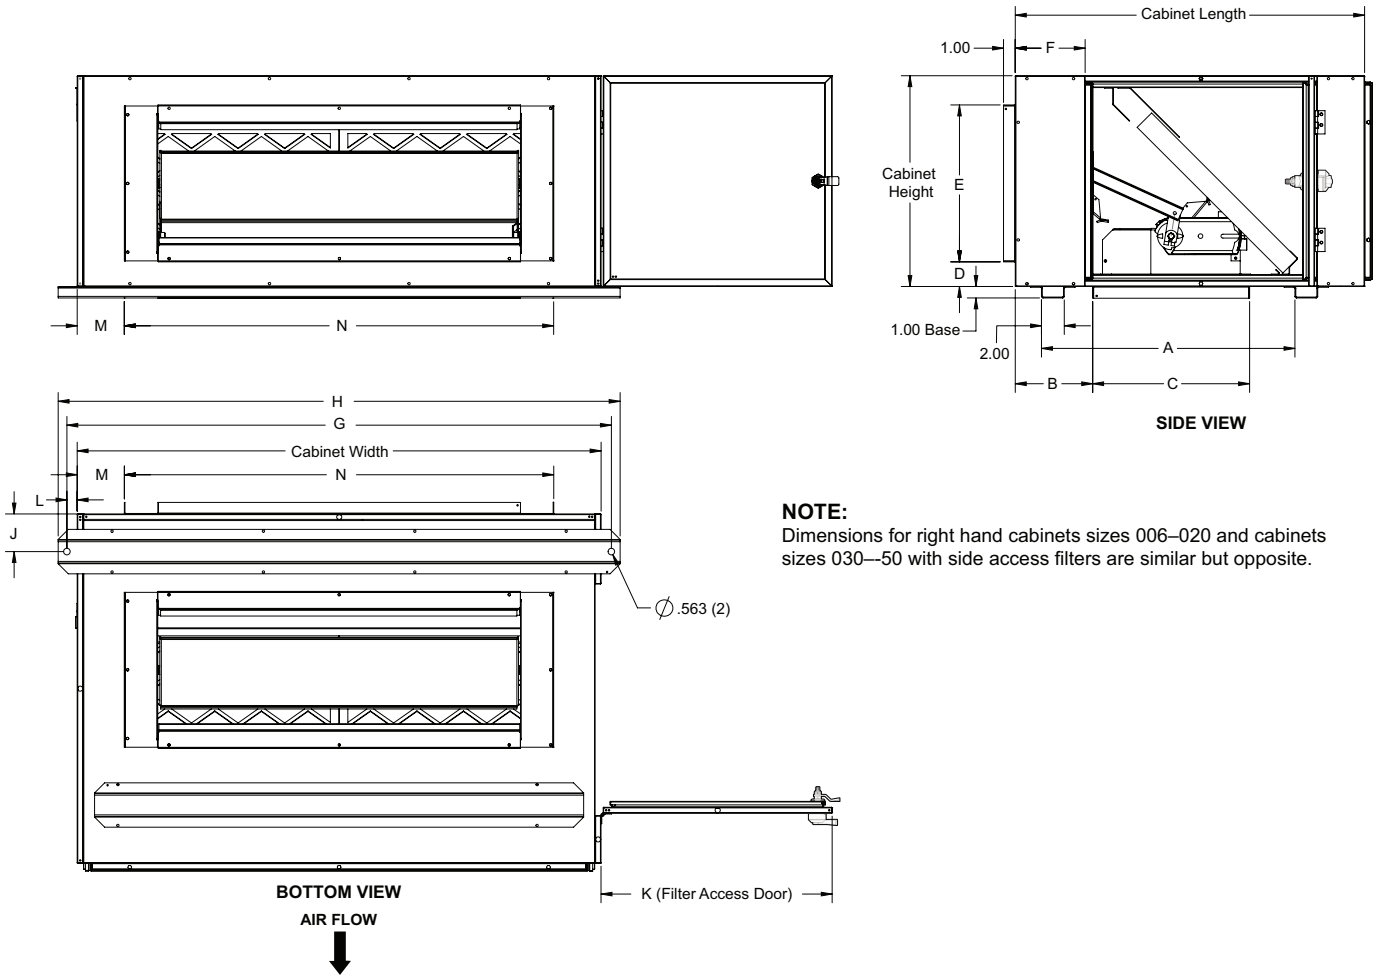


Table 43: Mixing Box Dimension Letter Reference for Figure 43

Cabinet	006	008	010	012	016	018	020	030	040	050
A	20.51	20.51	20.51	20.51	20.51	20.51	20.51	27.27	27.27	27.27
B	6.64	6.64	6.64	6.64	6.64	6.64	6.64	5.54	5.54	5.54
C	13.47	13.47	13.47	13.47	13.47	13.47	13.47	18.39	18.39	18.39
D	2.11	2.11	2.11	2.11	2.11	2.11	2.11	3.80	5.80	6.80
E	13.47	13.47	13.47	13.47	13.47	13.47	13.47	18.39	18.39	18.39
F	6.12	6.12	6.12	6.12	6.12	6.12	6.12	14.06	14.06	14.06
G	16.75	21.75	29.75	29.75	38.25	46.75	46.75	51.00	56.00	63.00
H	18.25	23.25	31.25	31.25	39.75	48.25	48.25	52.50	57.50	64.50
J	3.22	3.22	3.22	3.22	3.22	3.22	3.22	3.22	3.22	3.22
K	19.75	19.75	19.75	19.75	19.75	19.75	19.75	14.75	14.75	14.75
L	0.87	0.87	0.87	0.87	0.87	0.87	0.87	1.00	1.00	1.00
M	0.98	2.66	2.29	2.29	2.80	4.04	4.04	6.32	3.82	2.82
N	10.18	14.66	23.41	30.90	30.90	36.87	36.87	36.34	46.34	55.34

Figure 44: Horizontal Mixing Box Dimensions – Left Hand Sizes 006–020 and Right Hand Sizes 030–050 – Bottom Filter Access

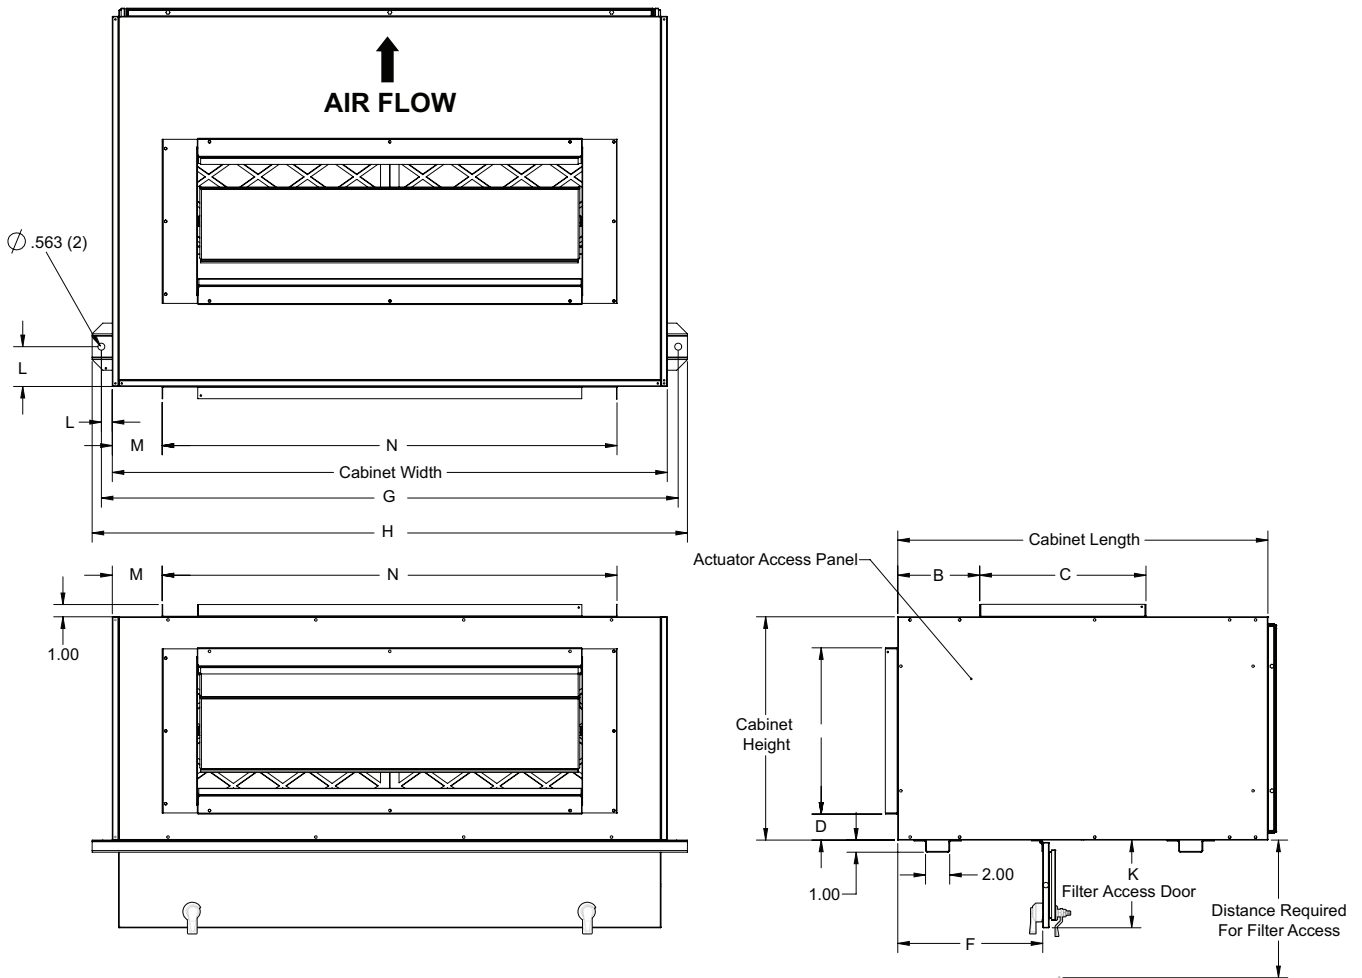


Table 44: Mixing Box Dimension Letter Reference for Figure 44


Cabinet	006	008	010	012	016	018	020	030	040	050
B	6.64	6.64	6.64	6.64	6.64	6.64	6.64	5.54	5.54	5.54
C	13.47	13.47	13.47	13.47	13.47	13.47	13.47	18.39	18.39	18.39
D	2.11	2.11	2.11	2.11	2.11	2.11	2.11	3.80	5.80	6.80
E	13.47	13.47	13.47	13.47	13.47	13.47	13.47	18.39	18.39	18.39
F	11.62	11.62	11.62	11.62	11.62	11.62	11.62	19.56	17.86	17.36
G	16.75	21.75	29.75	29.75	38.25	46.75	46.75	51.00	56.00	63.00
H	18.25	23.25	31.25	31.25	39.75	48.25	48.25	52.50	57.50	64.50
J	3.22	3.22	3.22	3.22	3.22	3.22	3.22	3.22	3.22	3.22
K	7.00	7.00	7.00	7.00	7.00	7.00	7.00	7.00	7.00	7.00
L	0.87	0.87	0.87	0.87	0.87	0.87	0.87	1.00	1.00	1.00
M	0.98	2.66	2.29	2.29	2.80	4.04	4.04	6.32	3.82	2.82
N	10.18	14.66	23.41	30.90	30.90	36.87	36.87	36.34	46.34	55.34

Discharge Plenum Dimensions

Figure 45: Horizontal Discharge Plenum

Notes:

- 1. Discharge opening is offered on any one particular side, but is shown here on all available surfaces for dimensioning purposes only.
- 2. A discharge plenum is also available without discharge openings.

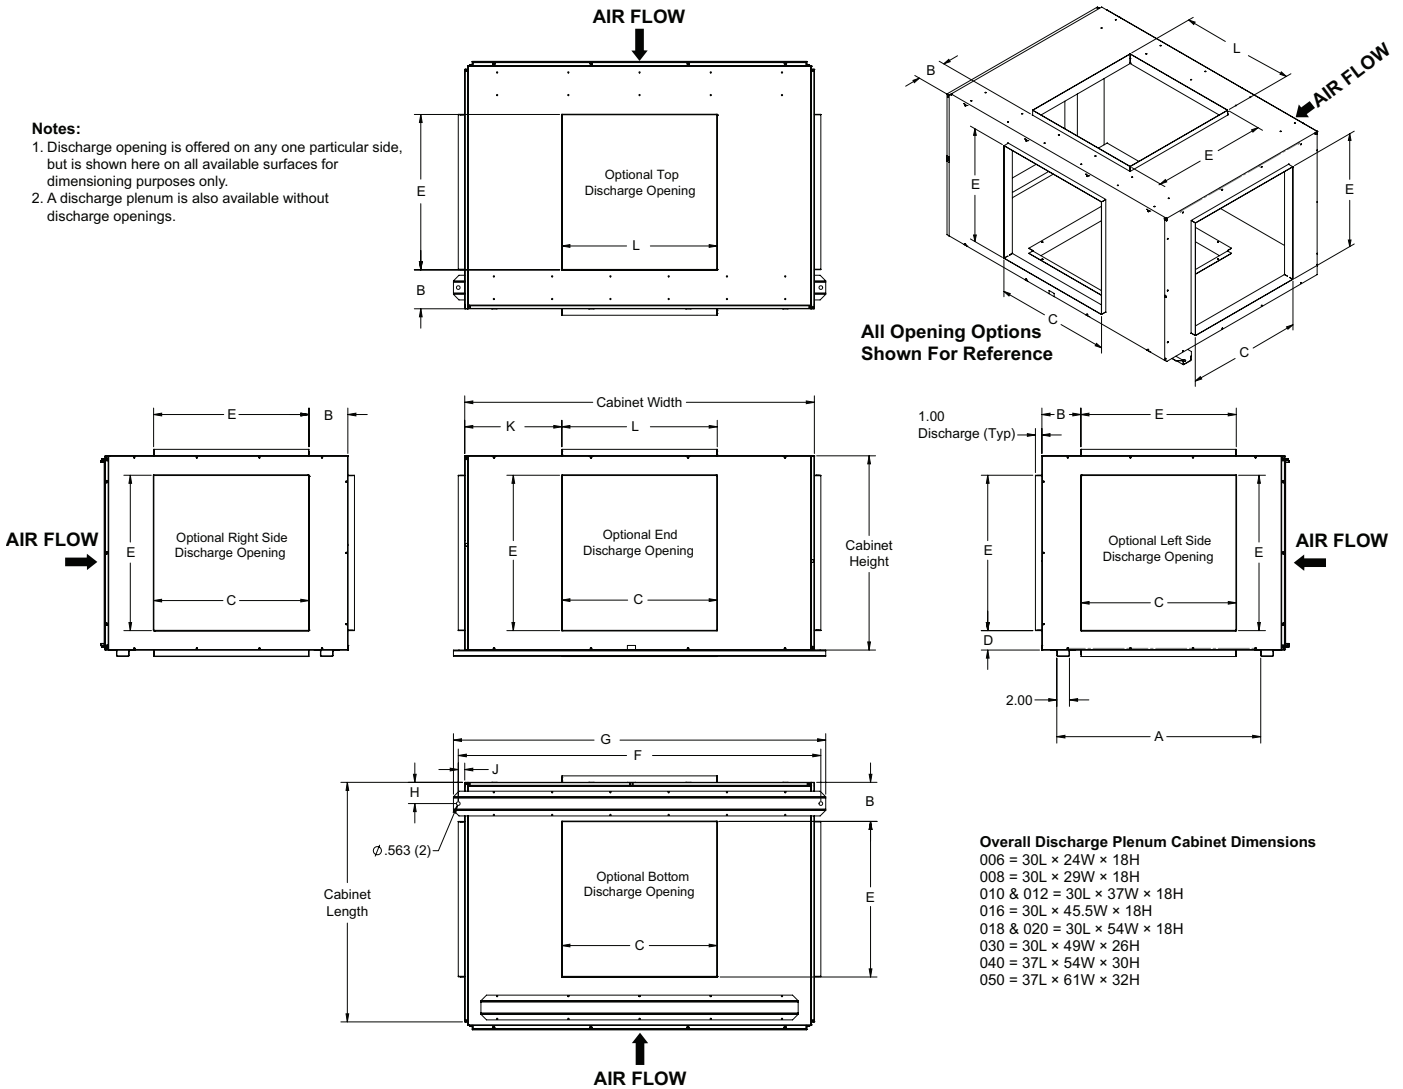

Overall Discharge Plenum Cabinet Dimensions

- 006 = 30L × 24W × 18H
- 008 = 30L × 29W × 18H
- 010 & 012 = 30L × 37W × 18H
- 016 = 30L × 45.5W × 18H
- 018 & 020 = 30L × 54W × 18H
- 030 = 30L × 49W × 26H
- 040 = 37L × 54W × 30H
- 050 = 37L × 61W × 32H

Table 45: Discharge Plenum Dimension Letter Reference for Figure 45

Cabinet	006	008	010	012	016	018	020	030	040	050
A	22.00	22.00	22.00	22.00	22.00	22.00	22.00	24.50	31.50	32.88
B	6.56	6.10	6.56	6.56	6.56	6.56	6.56	5.53	6.02	5.06
C	12.00	12.00	14.00	14.00	16.00	20.00	20.00	24.00	24.00	28.00
D	5.00	3.00	2.00	2.00	2.00	2.00	2.00	3.00	3.00	2.00
E	8.00	12.00	14.00	14.00	14.00	14.00	14.00	20.00	24.00	28.00
F	26.00	30.00	39.00	39.00	48.00	56.00	56.00	50.50	56.00	62.50
G	27.50	31.50	40.50	40.50	49.50	57.50	57.50	52.00	57.50	64.00
H	3.25	3.25	3.25	3.25	3.25	3.25	3.25	3.25	3.25	2.63
J	1.00	0.50	1.00	1.00	1.25	1.00	1.00	0.75	1.00	0.75
K	6.00	8.50	11.50	11.50	14.75	17.00	17.00	12.50	15.00	16.50
L	12.00	12.00	14.00	14.00	16.00	20.00	20.00	24.00	24.00	28.00

NOTE: Discharge opening is offered on any one particular side, but is shown here on all available surfaces for dimensioning purposes only. A discharge plenum is also available without discharge openings.

Figure 46: Vertical Discharge Plenum

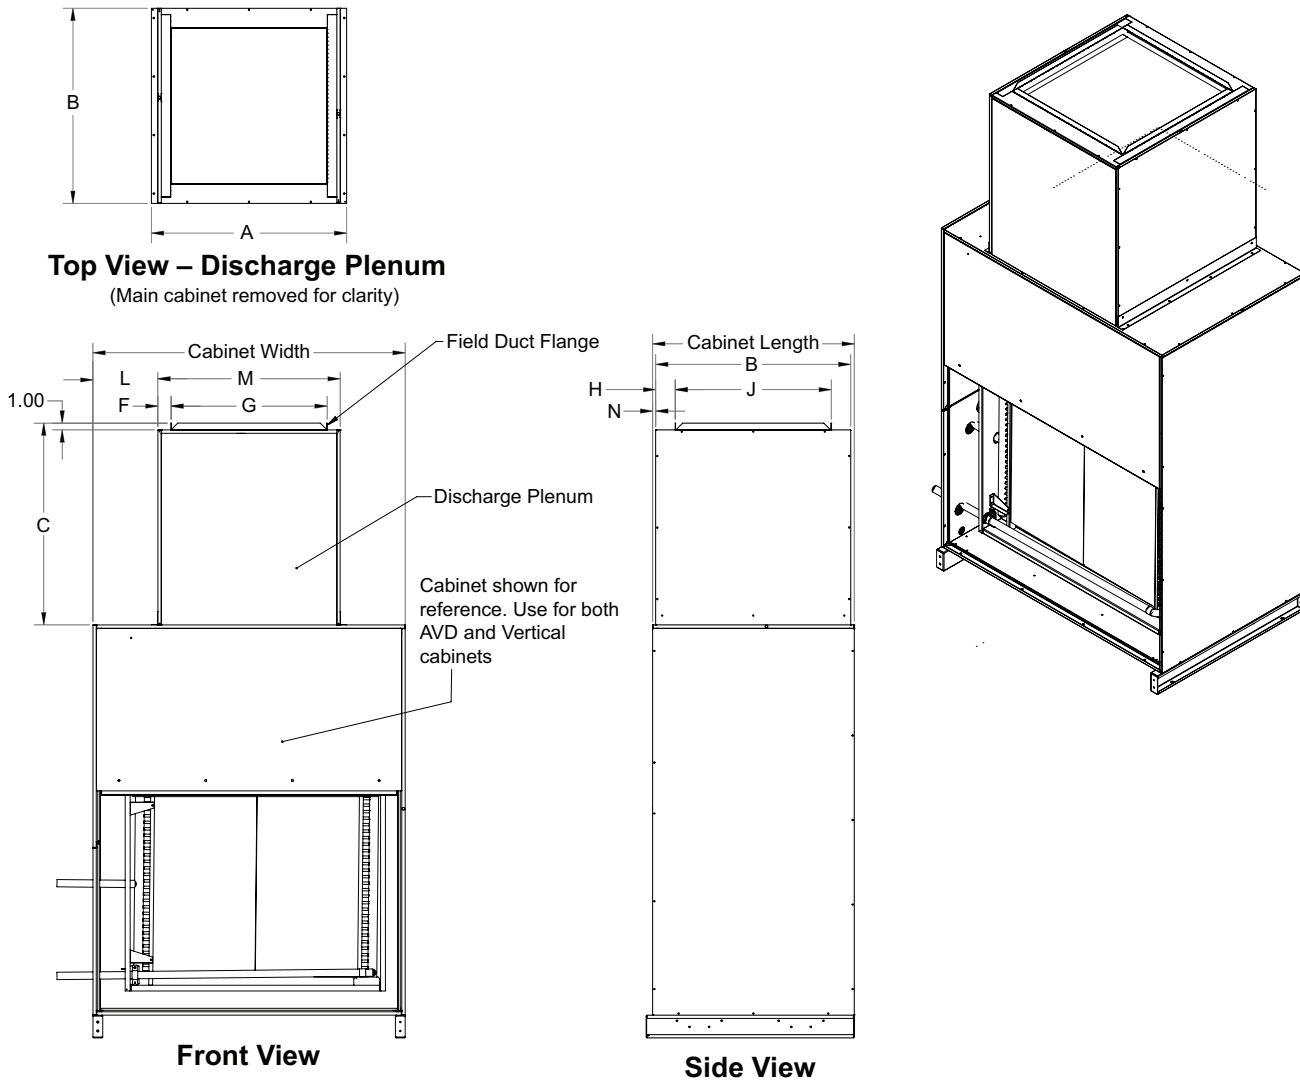


Table 46: Discharge Plenum Dimension Letter Reference

AVD										Cabinet Length	Cabinet Width	Cabinet Height
A	B	C	F	G	H	J	L	M	N			
14.00	17.50	25.00	2.00	8.06	2.75	12.00	6.50	12.00	0.25	18.00	25.00	58.00
18.00	17.50	25.00	2.00	12.00	2.75	12.00	6.00	16.00	0.25	18.00	28.00	60.00
20.00	17.50	25.00	2.00	14.00	2.75	12.00	6.75	18.00	0.25	18.00	31.50	62.00
31.00	17.50	25.00	5.47	20.00	1.75	14.00	6.75	29.00	0.25	18.00	38.00	63.50
33.00	17.50	25.00	2.47	20.00	1.75	14.00	6.00	31.00	0.25	18.00	43.00	64.00
Vertical										Cabinet Length	Cabinet Width	Cabinet Height
A	B	C	F	G	H	J	L	M	N			
26.00	30.00	31.00	2.00	20.00	5.00	20.00	10.00	24.00	0.50	31.00	44.00	56.00
30.00	30.00	31.00	2.00	24.00	3.00	24.00	10.00	28.00	0.50	31.00	48.00	60.00
30.00	30.00	31.00	2.00	24.00	3.00	24.00	10.00	28.00	0.50	31.00	48.00	68.00

BCHD Guide Specifications

Part 1: General

1.01 Section Includes

- A. Horizontal Air Handler

1.02 References

- A. Load ratings and fatigue life for ball bearings.
- B. Standards handbook.
- C. Laboratory methods of testing fans for rating purposes.
- D. Test code for sound rating air moving devices.
- E. Test methods for louver, dampers, and shutters.
- F. Room fan coil unit.
- G. Standard practice for operating salt spray apparatus.
- H. Motors and generators.
- I. National electrical code.
- J. HVAC duct construction standards - metal and flexible
- K. Test for surface burning characteristics of building materials.
- L. Test performance of air filter units.
- M. Standard for heating and cooling equipment.
- N. Test for flammability of plastic materials for parts in devices and appliances.

1.03 Submittals

- A. Shop Drawings: Indicate assembly, unit dimensions, weight loading, required clearances, construction details, field connection details, and electrical characteristics and connection requirements.
- B. Product Data:
 - 1. Provide literature that indicates dimensions, weights, capacities, ratings, fan performance, gauges and finishes of materials, and electrical characteristics and connection requirements.

1.04 Operation and Maintenance Data

- A. Maintenance Data: Include instructions for lubrication and filter replacement.

1.05 Qualifications

- A. Manufacturer: Company specializing in manufacturing Air Handler products specified in this section must show a minimum five years documented experience and complete catalog data on total product.

1.06 Delivery, Storage, and Handling

- A. Deliver, store, protect and handle products to site.
- B. Accept products on site wrapped in protective cardboard wrap. Inspect for damage.
- C. Store in a clean dry place and protect from weather and construction traffic. Handle carefully to avoid damage.

1.07 Environmental Requirements

- A. Do not operate units for any purpose, temporary or permanent, until ductwork is clean, filters are in place, bearings lubricated, and fan has been test run under observation.

Part 2: Products

2.01 Manufacturers

- A. The following manufacturers are approved for use. No substitutions will be permitted.
 - 1. Daikin Applied – “PreciseLine” air handler is the basis of design, including standard product features and all special features required per plans and specifications.
 - 2. First Co.

2.02 Fan Coil Type And Arrangement

- A. The air handler shall be furnished as a draw-through style hydronic air handler.
- B. A Secondary electric-resistive heater shall be factory furnished [upstream][downstream] of the primary coil. An automatic-style thermal cut out switch and a manual-reset-style thermal cut-out switch are to be furnished and installed by the manufacturer. The automatic thermal cut out switch is to disconnect the electric heater at air temperatures exceeding 160°F. The manual thermal cut out switch is to disconnect the electric heater at air temperatures exceeding 180°F.
- C. A Secondary [preheat][reheat] coil located downstream of the primary coil shall be factory furnished. Entering water conditions are not to exceed 200°F.

2.03 General Construction

- A. The air handling unit shall include a blower, fan housing, coil, and drain-pan enclosed within and mounted to a rigid cabinet. Steel parts exposed to moisture shall be galvanized and insulated to prevent condensation. The complete fan assembly shall be wired via quick connect electrical contacts and easily removable for service and maintenance.
- B. The air handling unit shall include a blower, fan housing, coil, and drain-pan enclosed within and mounted to a rigid cabinet. Steel parts exposed to moisture shall be galvanized and insulated to prevent condensation.
- C. Cabinet
 - 1. Unit will be supplied with 1-inch, double-wall panels. The cabinet is to be thermally isolated through injected foam insulation inside each cabinet. Single wall cabinets with fiberglass insulation exposed in the airstream are not acceptable. Frame channels which allow heat conductance between the inside and outside of the cabinet are not acceptable. Base rails used for unit mounting/hanging are acceptable. Panel shall have a minimum thermal insulation of R6. Foam injected insulation conforms to:
 - a. ASTM C1071 (including C665)
 - b. UL 181 for erosion
 - c. 25/50 rating for flame spread/smoke developed per ASTM E-84, UL 723 and NFPA 90A

2.04 Supply Fan

- A. Supply fans shall be a DWDI forward-curved type. Fan assemblies shall be balance tested dynamically by the manufacturer. Manufacturer must ensure maximum fan RPM is below the first critical speed.
- B. The complete fan assembly, including motor and main drain pan shall be easily removable.
- C. Fan motor(s) assembly shall be direct-drive style and not include belts, pulleys, or sheaves.
- D. Fan motor(s) shall be of Direct Current Brushless type or minimum motor efficiency of 85 percent when rated in accordance of NEMA Standard MG 1-2016 at full load conditions.
- E. Manufacturer’s supply fan motor must have means to adjust motor speed for field balancing.
- F. Units shall be certified in accordance with the Central Station Air Handler certification program that is based on AHRI Standard 430.
- G. Supply fan must be capable of delivering 1.5" w.g. external static pressure and 3.0" w.g. total static pressure at nominal cabinet CFM.

2.05 Filters

- A. Filter section shall be a 2" [4"] flat [angle] type furnished with MERV 8 [MERV 11] [MERV 13] deep pleated panel filters.
- B. Filter media shall be UL 900 listed, Class I or Class II.
- C. Filters shall be easily accessible via a door or panel located on the side of the unit.
- D. Filters shall be easily accessible via a door or panel on the top of the unit.
- E. Filters shall be easily accessible via a door or panel on the front of the unit.
- F. Filters shall be easily accessible via a door or panel located on the bottom of the unit.
- G. Filters shall be arranged in a flat manner.
- H. Filters shall be arranged in an angled manner.
- I. Filters shall be 2" in depth.
- J. Filters shall be 4" in depth.
- K. Filter shall be of disposable type with a minimum arrestance of 75%-80% and rating of MERV 4.
- L. Filter shall be of disposable type with a minimum arrestance of greater than 90% and rating of MERV 8.
- M. Filter shall be of disposable type with a minimum arrestance greater than 98% and rating of MERV 13.
- N. The first filter shall be of disposable type with a minimum arrestance of 75%-80% and rating of MERV 4.
- O. The first filter shall be of disposable type with a minimum arrestance of greater than 90% and rating of MERV 8.
- P. The first filter shall be of disposable type with a minimum arrestance greater than 98% and rating of MERV 13.
- Q. The second filter shall be of disposable type with a minimum arrestance of 75%-80% and rating of MERV 4.

- R. The second filter shall be of disposable type with a minimum arrestance of greater than 90% and rating of MERV 8.
- S. The second filter shall be of disposable type with a minimum arrestance greater than 98% and rating of MERV 13.

2.06 Electrical

- A. Supply fans shall be driven by Electrically Commutated motors that are run-tested in the assembled unit and permanently lubricated. All motors shall have integral thermal overload protection with a maximum ambient operating temperature of 55°C. Motors shall be capable operating at 90 percent of rated voltage on all speed settings. Motors can operate up to 10 percent overvoltage.
- B. Supply fans shall be driven by NEMA Premium Efficiency motors that are run-tested in the assembled unit and permanently lubricated. All motors shall have integral thermal overload protection with a maximum ambient operating temperature of 40°C. Motors shall be capable of operating 90 percent of rated voltage on all speed settings. Motors can operate up to 10 percent overvoltage.
- C. Motor wires shall include a quick-disconnect motor plug.
- D. All controls equipment including ECM control module, low voltage transformers, safety switches, disconnects, fusing, and terminal strips must be located inside the main unit cabinet.

2.07 Cooling and Heating

- A. Cooling Coils
 - 1. Cooling performance shall be as specified on the unit schedule.
 - 2. [Water coil][Direct expansion][VRV] fins shall have full drawn collars to provide a continuous surface cover over the entire tube for maximum heat transfer. Seamless copper tubes shall be mechanically expanded into the fins to provide a continuous primary-to-secondary compression bond over the entire finned length for maximum heat transfer rates. Bare copper tubes shall not be visible between fins. Coil casing shall be constructed of [galvanized][stainless] steel.
 - 3. Water coils shall be provided with headers of seamless copper tubing with intruded tube holes to permit expansion and contraction without creating undue stress or strain. Coil connections shall be [female pipe thread][sweat] with connection size to be determined by manufacturer based upon the most efficient coil circuiting. Vent and drain connections shall be furnished on the coil connection, easily accessible inside the cabinet. Vent connections to be provided at the highest point to assure proper venting. Drain connections shall be provided at the lowest point.

- 4. Direct Expansion coils shall be provided with a distributor. The return coil connection shall be a sweat connection with size to be determined by manufacturer based upon the most efficient coil circuiting.
- 5. All steel parts exposed to moisture shall be galvanized.
- 6. Unit shall include a [galvanized][stainless] steel primary and secondary drain pan. The primary drain pan to be positively sloped in every plane. Primary and secondary drain pans to be insulated with anti-microbial closed-cell insulation. The drain pan shall be designed to ensure no pooling of condensate water per ASHRAE 62.2.
- 7. Coils shall have stub-outs off of the headers extending through the unit paneling.
- 8. Coils shall have stub-outs off the headers that end within the internal cabinet.

B. Water Heating Coil

- 1. Heating performance shall be as specified on the unit schedule.
- 2. Coil fins shall have full drawn collars to provide a continuous surface cover over the entire tube for maximum heat transfer. Seamless copper tubes shall be mechanically expanded into the fins to provide a continuous primary-to-secondary compression bond over the entire finned length for maximum heat transfer rates. Bare copper tubes shall not be visible between fins.
- 3. Coils shall be provided with headers of seamless copper tubing with intruded tube holes to permit expansion and contraction without creating undue stress or strain. Coil connections shall be [female pipe thread][sweat] connections with connection size to be determined by manufacturer based upon the most efficient coil circuiting. Vent and drain connections shall be furnished on the coil connection, external to the cabinet. Vent connections shall be provided at the highest point to ensure proper venting. Drain connections shall be provided at the lowest point.

2.08 Discharge Plenum

- A. A factory installed discharge plenum is to be furnished attached to the main unit. This component must be constructed of a similar cabinet paneling to the main unit.
- B. A factory-provided discharge plenum is to be furnished for attachment to the main unit (Vertical units Size 30+). This component must be constructed of a similar cabinet paneling to the main unit.
- C. Sound-absorbing material will be affixed to the internal walls of the discharge plenum.

2.09 Mixing Box

- A. A factory installed mixing box for mixing two separate airstreams is to be furnished attached to the main unit. This component must be constructed of a similar cabinet that the main unit is constructed of.
- B. Dampers intended for modulating each airstream are to be furnished to cover the openings of the supplied mixing box. Supporting linkages to connect the dampers to be furnished from the factory.
- C. Damper actuators are to be furnished factory installed on the mixing box. These actuators are to be controlled via 24VAC ON/OFF signal and factory wired back to the control area within the main cabinet.
- D. Damper actuators are to be furnished factory installed on the mixing box. These actuators are to be controlled via 0-10V modulating signal and factory wired back to the control area within the main cabinet.

2.10 Valve Packages

A. Coils

- 1. Fan coil units shall be provided with factory-installed valve / piping package(s) available for the [primary coil][primary and secondary coils]. All piping packages shall be factory assembled and tested at 400 psig (2760 kPa) and re-tested for leak when factory soldered to the coil(s) at 300 psig (2100 kPa) Maximum Working Pressure of the piping package shall be 300 psig (2100 kPa).
- 2. The valve package(s) shall be designed so that any condensation is directed into the secondary drain pan. With the secondary drain pan provided, insulation of the piping package is not required.

C. Type and Components

- 1. The valve package(s) shall be Deluxe type and provided with:
 - a. Interconnecting copper piping and shut-off ball valves.
 - b. Connecting supply and return lines to the unit. Four-pipe packages shall include a venting valve for the secondary coil.
 - c. An automatic circuit setter. The circuit setter includes a cartridge within the valve body that is sized to allow a specific flow rate through the coil. This valve sets flow through the coil without any action required by a system piping balancer.
 - d. P/T ports to measure the temperature or pressure drop across the valve. This pressure drop can be compared to factory-supplied curves that relate the pressure drop to a specific flow rate.
 - e. Unions on the valve package that allow the coil and valve package to be separated and removed from the unit.

- f. A 20 mesh strainer on the supply side that is easily removed for cleaning, with a blow-off valve. The strainer shall have a pressure rating of up to 400 psig (2,700 kPa).
- g. Isolating ball valve on the supply side.
- h. Two-Way valve body(s) positioned on the return side of the coil. A method to relieve pump head pressure to be employed when two-way systems are selected.

D. Type and Components

- 1. The valve package(s) shall be Basic type and provided with:
 - a. Interconnecting copper piping and shut-off ball valves.
 - b. Connecting supply and return lines to the unit. Four-pipe packages shall include a venting valve for the secondary coil.
 - c. P/T ports to measure the temperature or pressure drop across the valve. This pressure drop can be compared to factory-supplied curves that relate the pressure drop to a specific flow rate.
 - d. Unions on the valve package that allow the coil and valve package to be separated and removed from the unit.
 - e. Isolating ball valve on the supply side.
 - f. Two-Way valve body(s) positioned on the return side of the coil. A method to relieve pump head pressure to be employed when two-way systems are selected.
 - g. Three-Way, mixing-style valve body(s) to be positioned on the return side of the coil.
- 2. The valve package(s) shall be Deluxe type and provided with:
 - a. Interconnecting copper piping and shut-off ball valves.
 - b. Connecting supply and return lines to the unit. Four-pipe packages shall include a venting valve for the secondary coil.
 - c. An automatic circuit setter. The circuit setter includes a cartridge within the valve body that is sized to allow a specific flow rate through the coil. This valve sets flow through the coil without any action required by a system piping balancer.
 - d. A manual circuit setter. The circuit setter allows for flow balancing by adjusting flow resistance. Adjustments are made by twisting a handle.
 - e. P/T ports to measure the temperature or pressure drop across the valve. This pressure drop can be compared to factory-supplied curves that relate the pressure drop to a specific flow rate.

- f. Unions on the valve package that allow the coil and valve package to be separated and removed from the unit.
 - g. A 20 mesh strainer on the supply side that is easily removed for cleaning, with a blow-off valve. The strainer shall have a pressure rating of up to 400 psig (2,700 kPa).
 - h. Isolating ball valve on the supply side.
 - i. Three-Way, mixing-style valve body(s) to be positioned on the return side of the coil.
- E. Control
- 1. The valve package is to be furnished with two-position On/Off valve actuators.
 - 2. The furnished actuators are to be controlled via 24VAC control signal.
- F. Control
- 1. The valve package is to be furnished with proportional modulating actuators.
 - 2. The furnished actuators are to be controlled via 0-10VDC control signal.

2.11 Controls

- A. Unit shall be supplied with a digital controls ready interface. This interface is to be located inside the control box internal to the main unit. This interface shall include a 24VAC transformer and terminal blocks for connections to fan motor control, sensor control, safety switches, valve actuators, and damper control if applicable. (Code 43 = "D")
- B. Unit shall be furnished with a disconnect switch. The disconnect switch shall be operable from the outside of the cabinet to reduce hazards during field service and commissioning. (Code 42 = "D")
 - C. Unit shall be furnished with a disconnect switch and inline fusing to protect vital electrical components. The disconnect switch shall be operable from the outside of the cabinet to reduce hazards during field service and commissioning. (Code 42 = "F")
 - D. Fan motor control to be furnished as 0-10VDC. (Code 46 = "M")
 - E. Fan Motor Control to be furnished as three speed. These three speeds are field adjustable for precise air flow scheduling. (Code 46 = "T")

Part 3: Execution

3.01 Installation

- A. The air handling unit shall be installed per manufacturer's Installation & Maintenance Bulletin.
 - 1. Selected field mounted kits shall be specified on the unit schedule and installed per manufacturer's instruction.

Appendix A

Arrangement Examples – Main Unit, Mixing Box

		Main Unit			
		006-008	010-012	016-020	030-050
Left Hand	4-Pipe				
	2-Pipe				
Right Hand	4-Pipe				
	2-Pipe				

		Mixing Box (Right Hand)			
		006-008	010-012	016-020	030-050
Top and Rear					
Bottom and Rear					

Arrangement Examples – Discharge Plenum

		Discharge Plenum (Right Hand)	
		006-020	030-050
Discharge Opening Location	End		
	Left		
	Right		
	Bottom		
	Top		



Daikin Applied Training and Development

Now that you have made an investment in modern, efficient Daikin equipment, its care should be a high priority. For training information on all Daikin HVAC products, please visit us at www.DaikinApplied.com and click on Training, or call 540-248-9646 and ask for the Training Department.

Warranty

All Daikin equipment is sold pursuant to its standard terms and conditions of sale, including Limited Product Warranty. Consult your local Daikin Applied representative for warranty details. To find your local Daikin Applied representative, go to www.DaikinApplied.com.

Aftermarket Services

To find your local parts office, visit www.DaikinApplied.com or call 800-37PARTS (800-377-2787). To find your local service office, visit www.DaikinApplied.com or call 800-432-1342.

This document contains the most current product information as of this printing. For the most up-to-date product information, please go to www.DaikinApplied.com.

Products manufactured in an ISO Certified Facility.